

HTE# 07-50017483

Harnett County Department of Public Health 24166

Improvement Permit

A building permit cannot be issued with only an Improvement Permit

ISSUED TO: Dwayne Maxwell PROPERTY LOCATION: 1139
SUBDIVISION: Patton's Point LOT # 71
NEW REPAIR EXPANSION
Type of Structure: SFD- 48x52- 4 BR
Proposed Wastewater System Type: Pump to 25% Reduction system
Projected Daily Flow: 430 GPD
Number of bedrooms: 4 Number of Occupants: 8 max
Basement Yes No
Pump Required: Yes No May be required based on final location and elevations of facilities
Type of Water Supply: Community Public Well Distance from well 50 feet
Permit conditions: Meet on site for final layout maintain all set back
Permit valid for: Five years No expiration

Authorized State Agent: Ja Wani Date: 6-29-07 SEE ATTACHED SITE SKETCH
The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: Dwayne Maxwell PROPERTY LOCATION: 1139
SUBDIVISION: Patton's Point LOT # 71
Facility Type: SFD- 48x52 4 BR New Expansion Repair
Basement? Yes No Basement Fixtures? Yes No
Type of Wastewater System** Pump to 25% Reduction system (initial) Wastewater Flow: 430 GPD
(See note below, if applicable) 385 LF of LPP (Repair)

Installation Requirements/Conditions

Septic Tank Size 1200 gallons Exact length of each trench 1x240 feet Trench Spacing: 9 Feet on Center
Pump Tank Size 1200 gallons Trenches shall be installed on contour at a Maximum Trench Depth of: 18-24 inches (Maximum soil cover shall not exceed 36" above the trench bottom)
Pump Requirements: _____ ft. TDH vs. _____ GPM Aggregate Depth: _____ inches below pipe _____ inches above pipe _____ inches total
Conditions: _____

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.

Owner/Legal Representative Signature: _____ Date: _____

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.

Authorized State Agent: Ja Wani Date: 06-29-07 SEE ATTACHED SITE SKETCH
Construction Authorization Expiration Date: 06-29-2012

HTE# 07-50017483

Permit # 24166

Harnett County Department of Public Health Site Sketch

ISSUED TO: Dwayne Maxwell


PROPERTY LOCATOR: 1139

SUBDIVISION Pattons Point

LOT # 71

Authorized State Agent: [Signature]

Date: 6-29-07

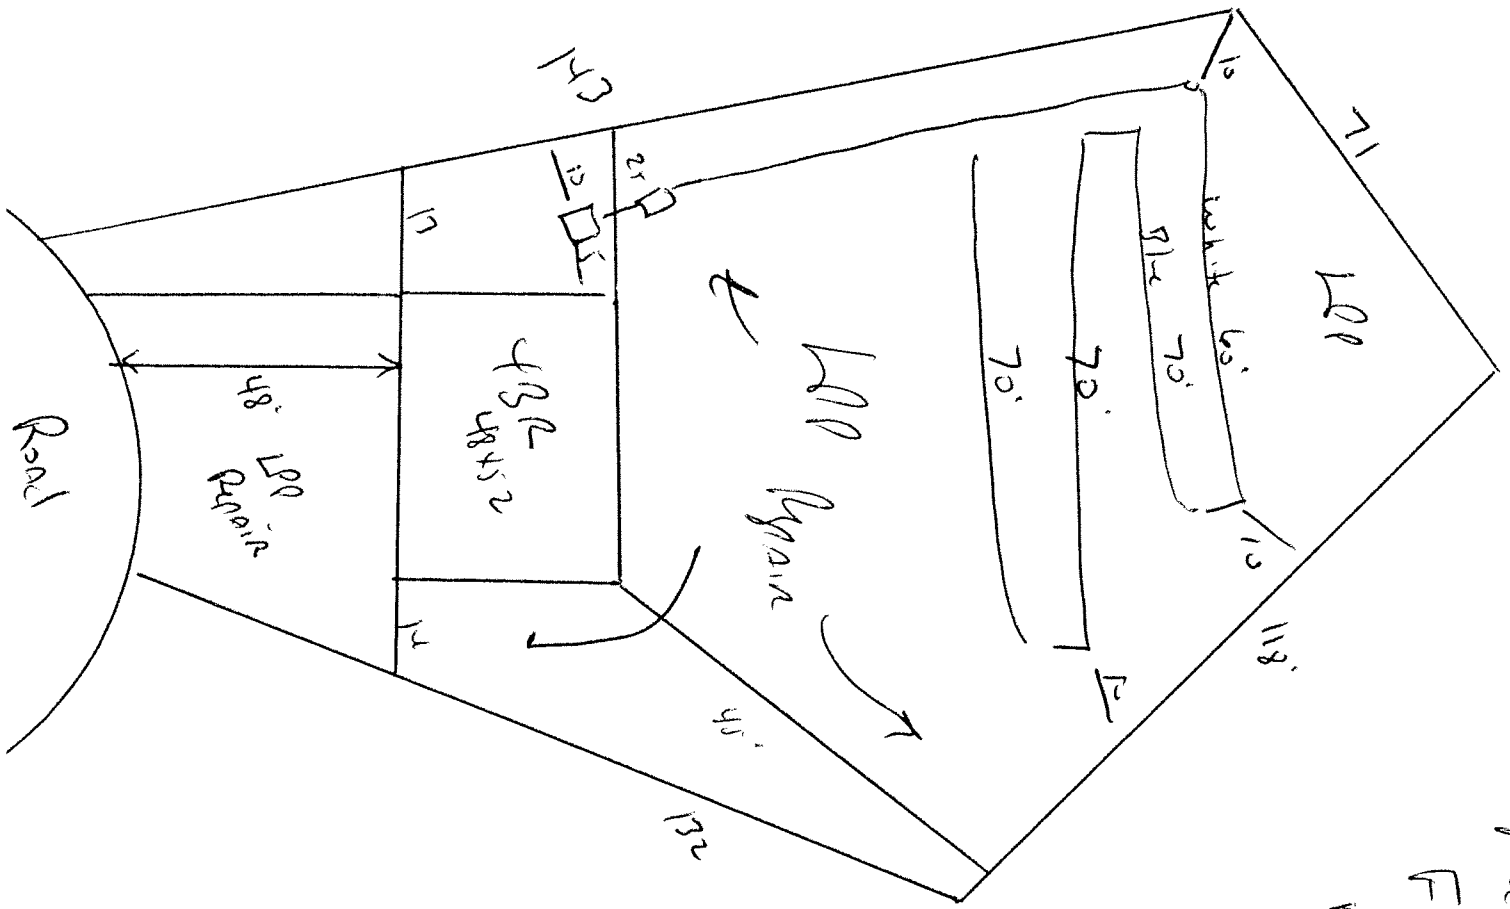

Meet on site for
 Final layout
 maintain all
 set Back,
 Install 1x2x4s
 of 25% Reduction
 SYSTEM
 AT 1875 24"
 STAG OUT
 Plumbing
 Where shown.