

HTE# 07-520-17801 RL

Harnett County Department of Public Health

20576

PERMIT # 25065

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

Name: (owner) Regency Homes PROPERTY LOCATION: Hoover Rd
SUBDIVISION: Pearlman Hill LOT # 9

System Installer: Ted Brown Registration # _____


Basement with plumbing: Garage Number of Bedrooms 4
Type of Water Supply: Community Public Well Distance from well 1000 feet

System Type: 2' Wide Chamber 15' Types V and VI Systems expire in 5 years.

(In accordance with Table V a) EQ 36 Owner must contact Health Department 6 months prior to expiration for permit renewal.

Hoover Rd

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

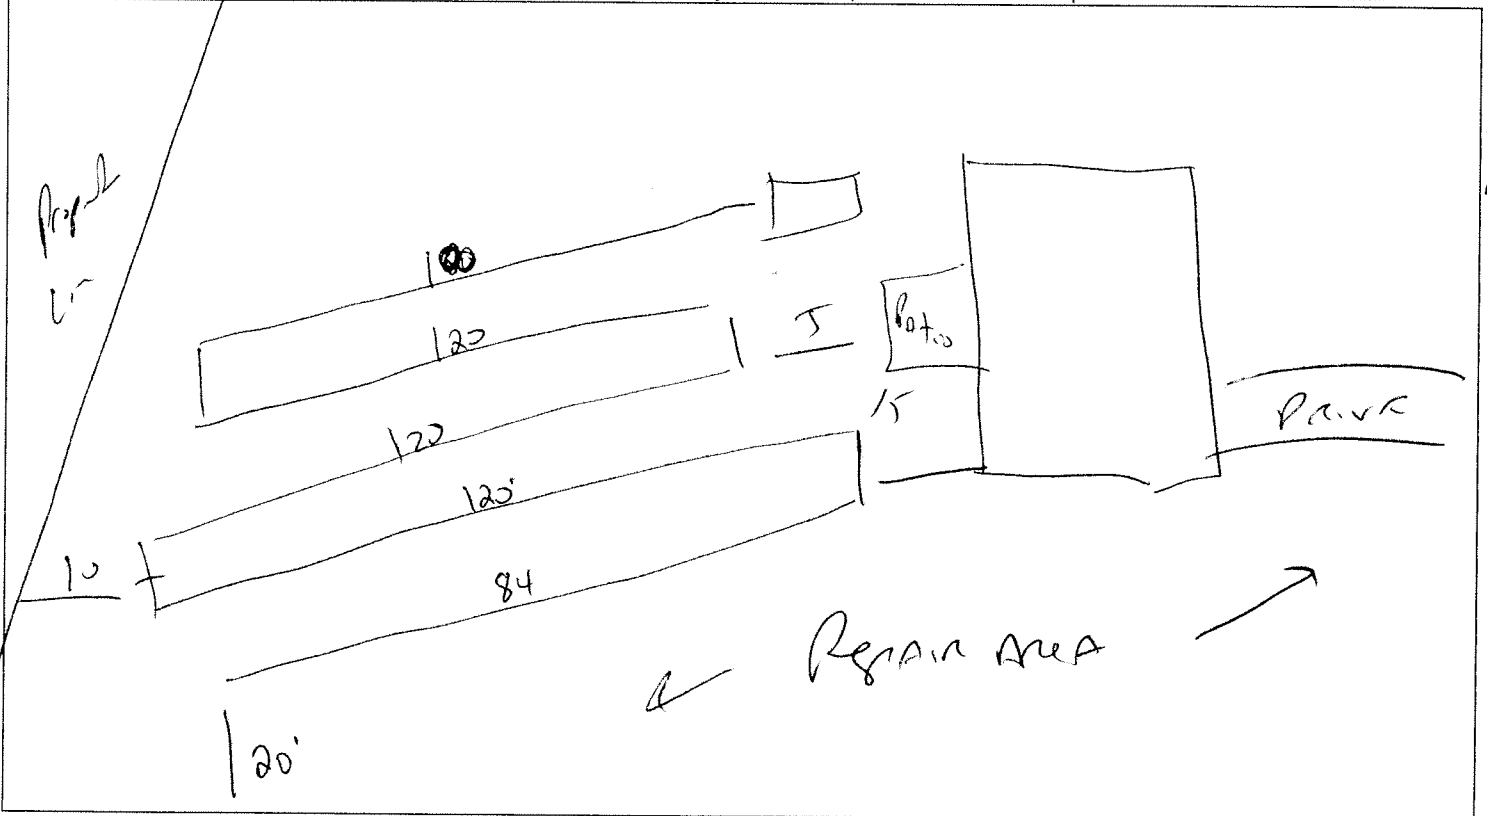

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961. Old Field Loop
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 2' wide chamber Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of _____ exact length _____ width of _____ depth of _____
 Drainage Field ditches 1 of each ditch 542 feet ditches 12 feet ditches 12 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 02-24-09