

HTE# 07-5-18628

Harmon County Department of Public Health 19930

PERMIT # 24336

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: _____

Name: (owner) WYNN CONSTRUCTION SUBDIVISION PIONEER FARMS LOT # 2

System Installer: COREY GILBERT Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: III Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

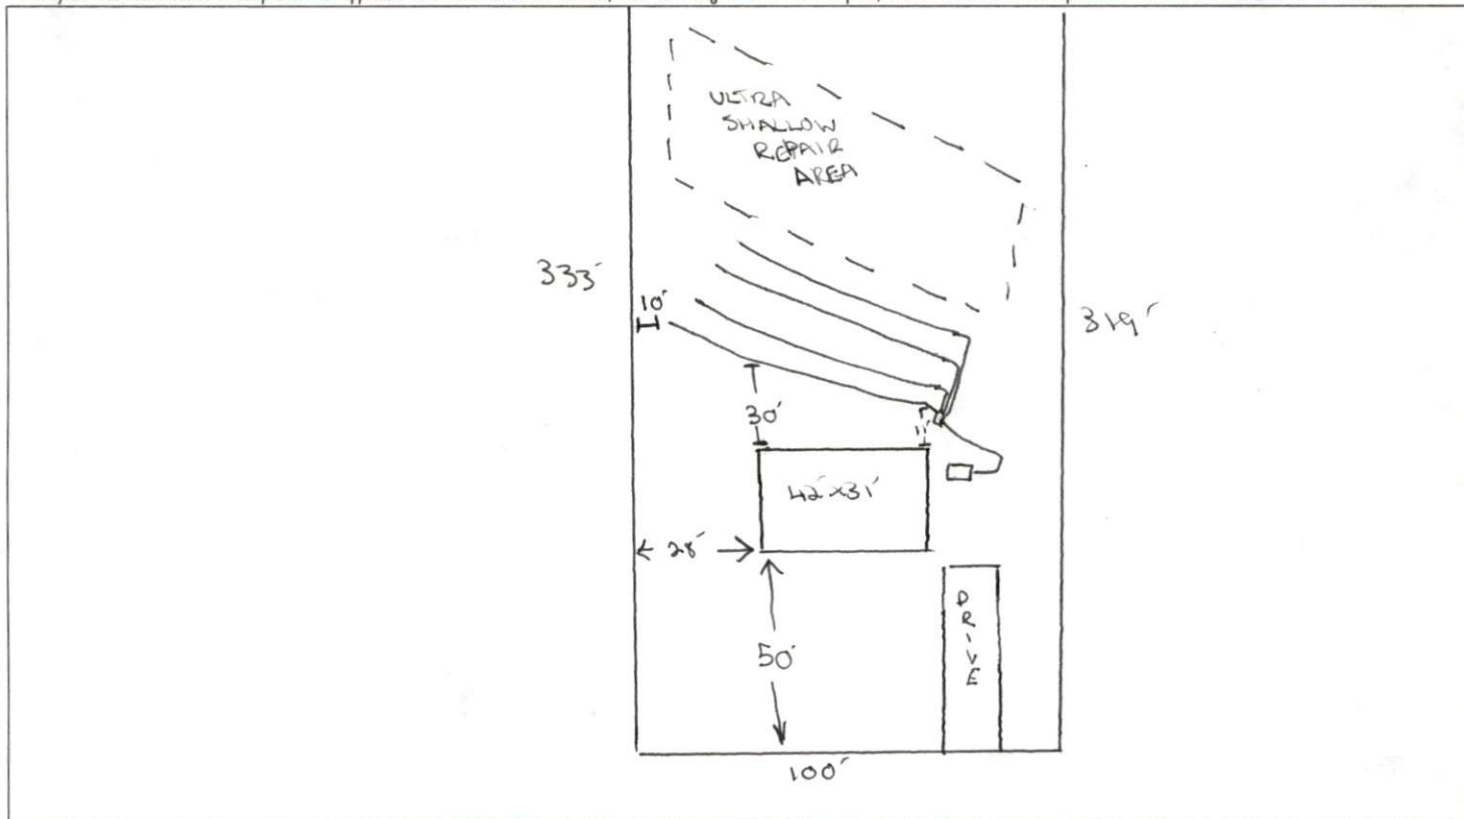

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: TOP 2 TRENCHES RUN 18" TO 24". SOIL DEPTH VERIFIED BY AUGER BORINGS

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other POLYSTYRENE AGG. TRENCH Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 75 feet width of ditches 3 feet depth of ditches 18-24 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] RS Date 2/7/08