

HTE# 07-500-18712

Harnett County Department of Public Health 19703

PERMIT # 23551

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: Cummings rd

Name: (owner) Victor M. Guerra

SUBDIVISION _____

LOT # 1

System Installer: O. Strickland

Registration # _____

5,000

Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well 100+ feet


System Type: Tire Chips 111b Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

Cummings rd

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

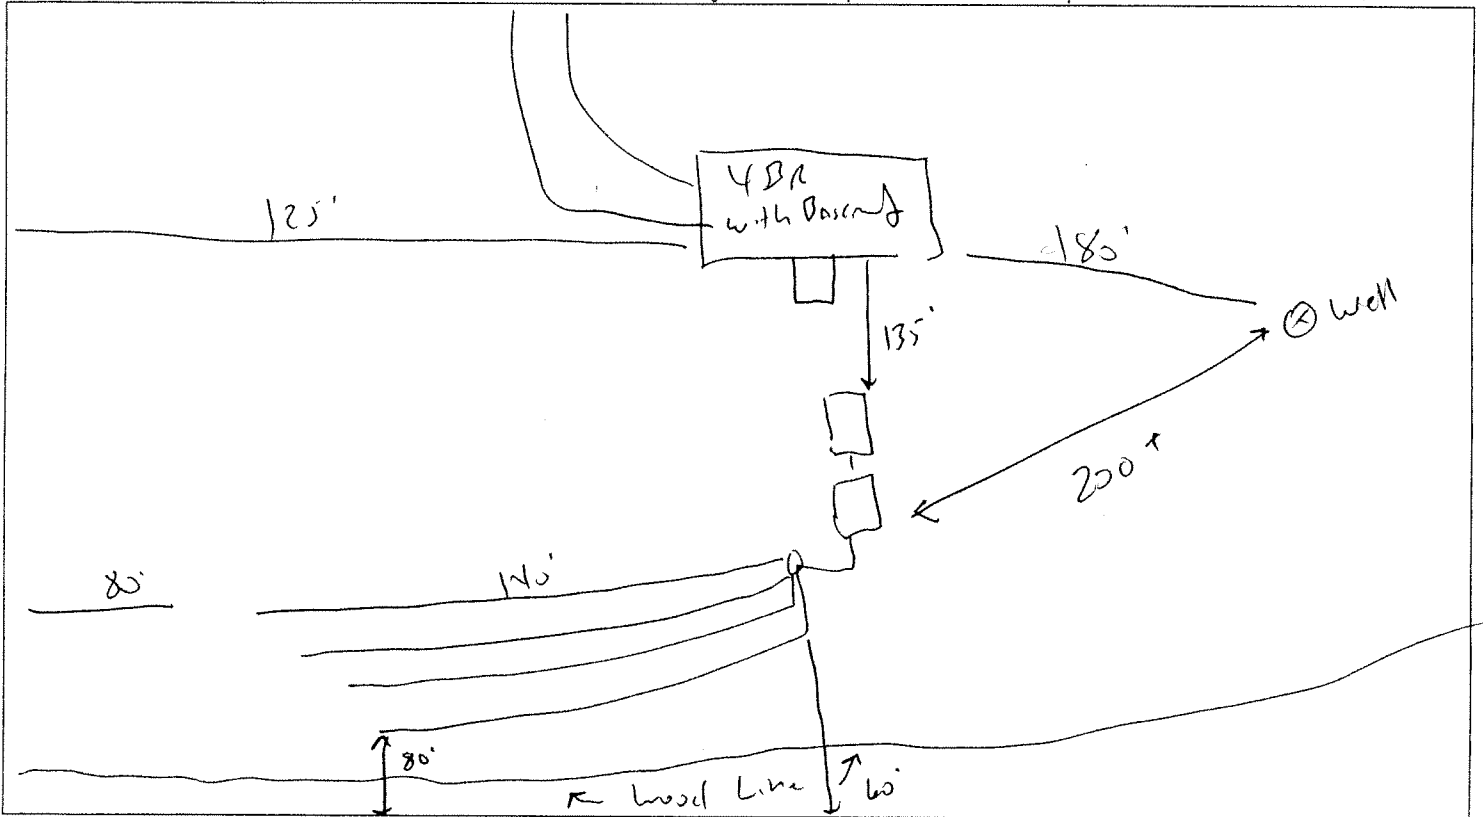

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump. Tire Chips Size of tank: Septic Tank: 1200 gallons Pump Tank: 1200 gallons
 Subsurface No. of 4 exact length width of depth of
 Drainage Field ditches 4 of each ditch 140 feet ditches 3 feet ditches 18 inches
 French Drain Required: _____ Linear feet

Authorized State Agent

[Signature]

Date

04-03-08