

HTE# 07-500-18802n

Harnett County Department of Public Health 2013

PERMIT # 24652

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

Name: (owner)

HeH Const

PROPERTY LOCATION: 1125

SUBDIVISION FOREST OAKS

LOT # 206

System Installer:

O. Stankland

Registration # _____

Basement with plumbing:

Garage

Number of Bedrooms 4

Type of Water Supply: Community

Public

Well

Distance from well 5 feet


System Type: E-2 FLOW

III Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

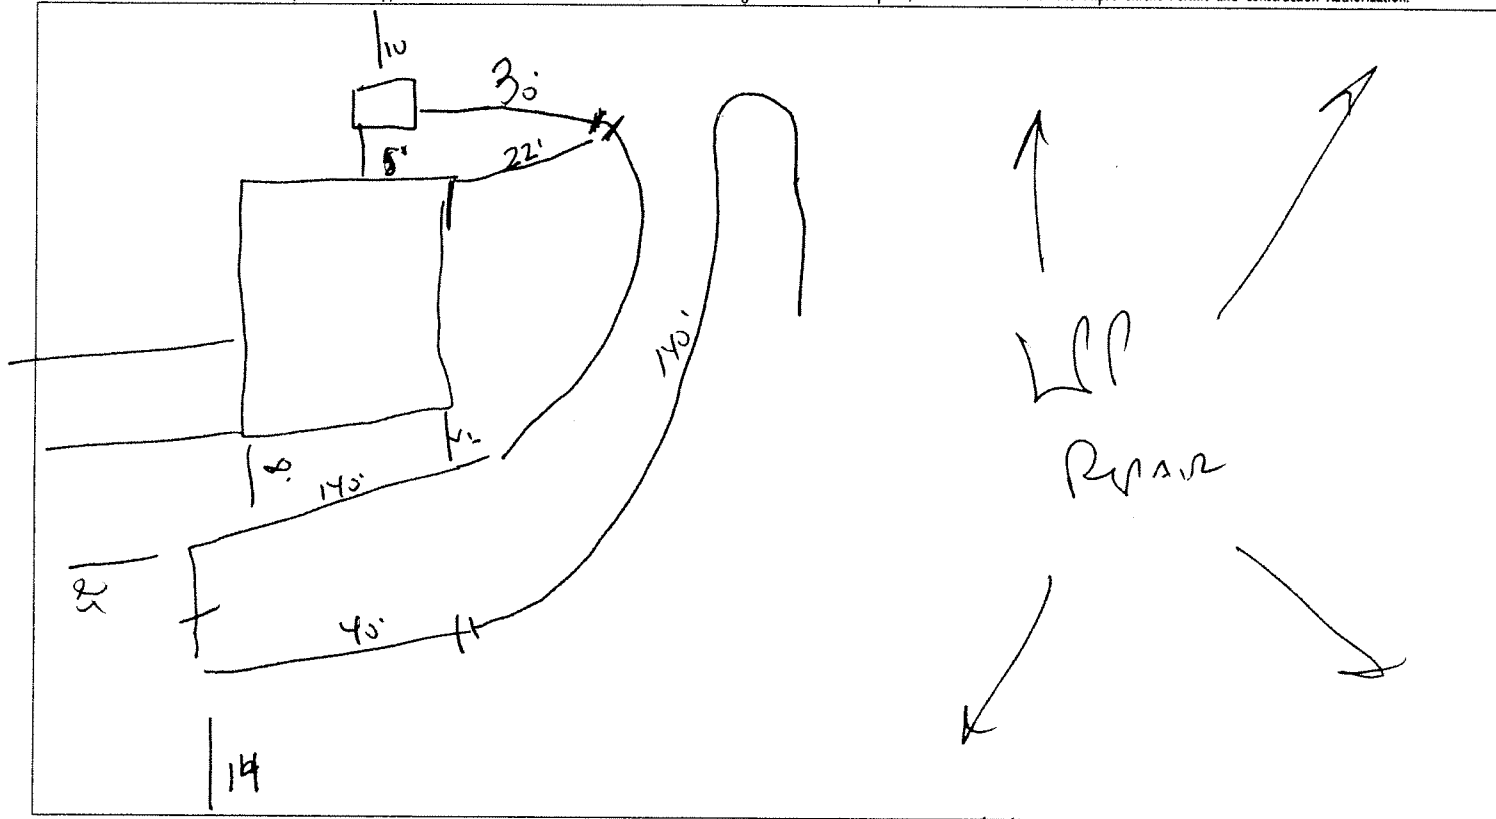

Drawn by O. Stankland

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other E-2 FLOW Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 1 of each ditch 350 feet ditches 3 feet ditches 18 inches
 French Drain Required: _____ Linear feet

Authorized State Agent

Joe LARU

Date

05-15-08