

Property ID:

Lot #:

File #:

Code:

SOIL SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner:

Applicant:

Address:

Date Evaluated: 1/14/08

Proposed Facility: 3 Bedroom Home Design Flow (.1949): 360 gpd

Property Size:

Location of Site:

Property Recorded:

Water Supply: ☒ Public ☐ Individual ☐ Well

☐ Spring ☐ Other

Evaluation Method: ☒ Auger Boring ☐ Pit

☐ Cut

Type of Wastewater: ☒ Sewage ☐ Industrial Process

☐ Mixed[illegible]

Description	Initial System	Repair System
Available Space (.1945)	✓	✓
System Type(s)	F122	F122
Site LTAR	.3	.3

Other Factors (.1946):

Site Classification (.1048):

Evaluated By:

Others Present:


COMMENTS: _____


LANDSCAPE POSITIONS	GROUP	TEXTURES	1955 LTAR	CONSISTENCE MOIST	WET
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE	NS-NON-STICKY
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6	FI-FIRM	SS-SLIGHTLY STICKY
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3	VFI-VERY FIRM	VS-VERY STICKY
H-HEAD SLOPE		SIL-SILT LOAM			
CC-CONCLAVE SLOPE		CL-CLAY LOAM			
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			
T-TERRACE		SICL-SILTY CLAY LOAM			
FP-FLOOD PLAN	IV	SIC-SILTY CLAY	0.4 - 0.1	EFI-EXTREMELY FIRM	NP-NON-PLASTIC
		C-CLAY			
		SC-SANDY CLAY			

STRUCTURE
 SG-SINGLE GRAIN
 M-MASSIVE
 CR-CRUMB
 GR-GRANULAR
 SBK-SUBANGULAR BLOCKY
 ABK-ANGULAR BLOCKY
 PL-PLATY
 PR-PRISMATIC

MINERALOGY
 SLIGHTLY EXPANSIVE
 EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

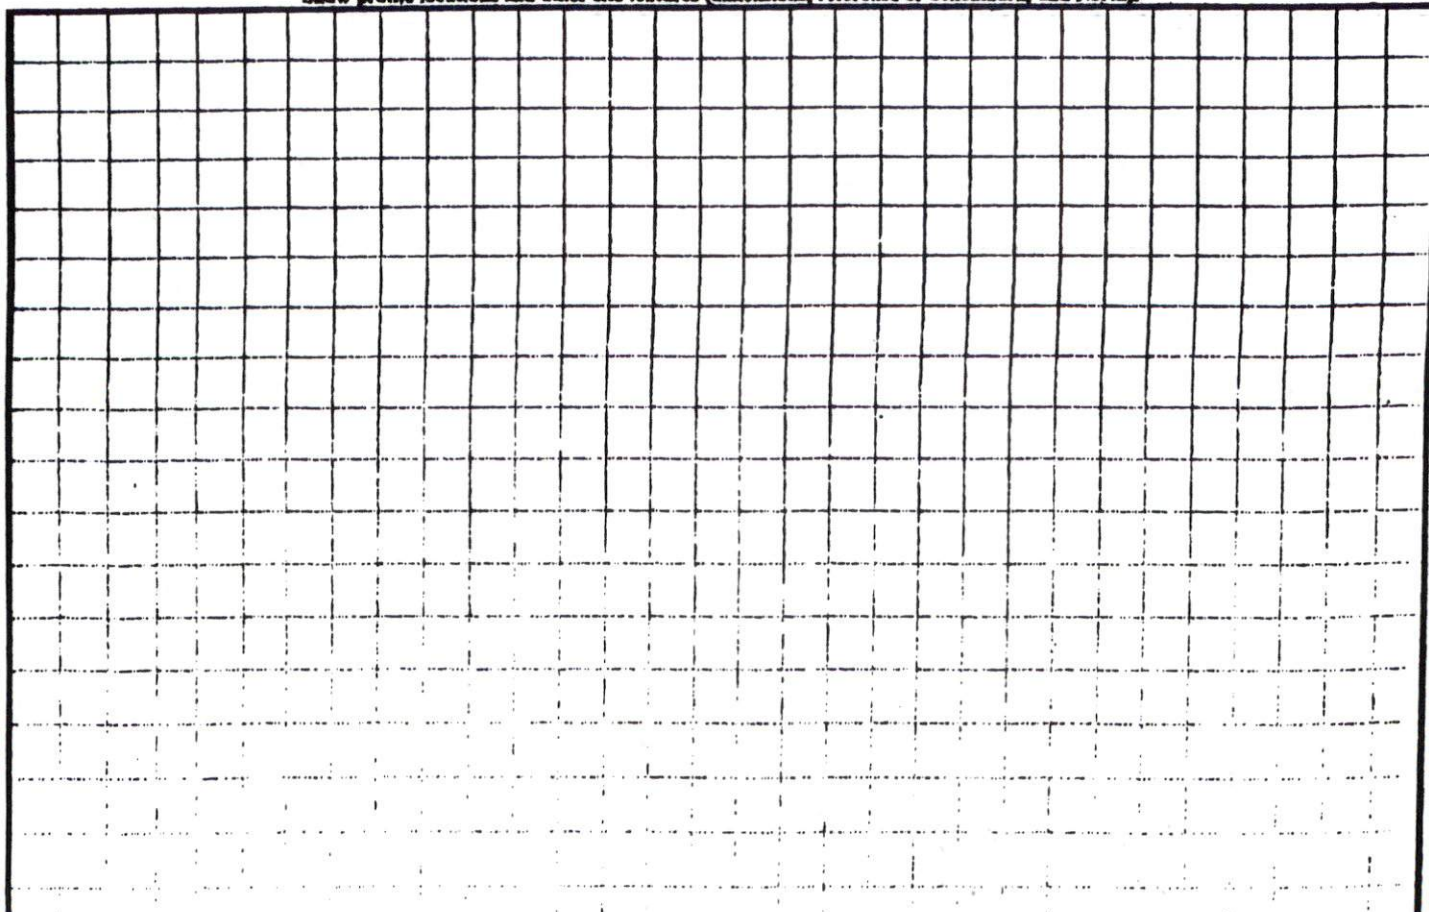

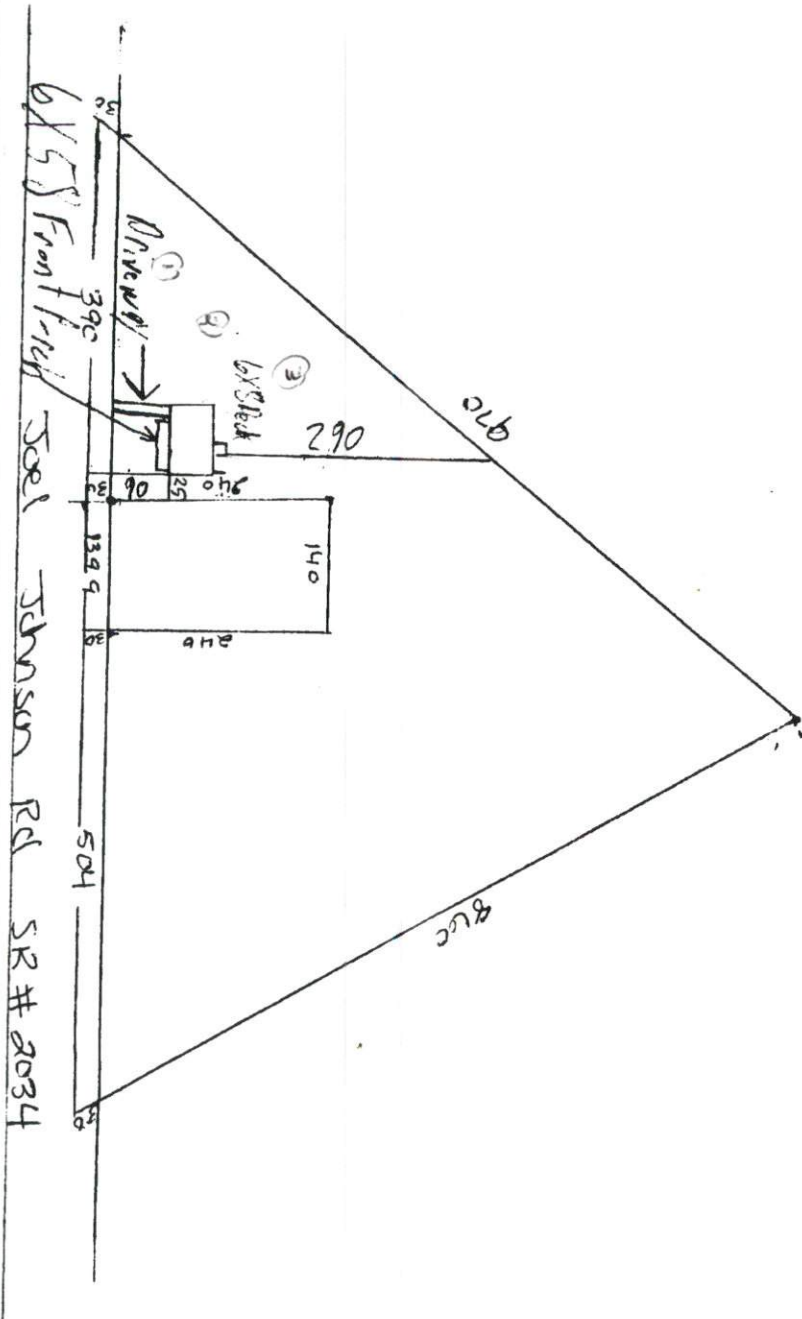

6458 Front Street
Soel Johnson Rd SR # 2034

1=200

SITE PLAN APPROVAL
 DISTRICT RA-20R USE SFD
 #BEDROOMS 3
11-21-07 V.L. [Signature]
 Date Zoning Administrator