

Improvement Permit

A building permit cannot be issued with only an Improvement Permit

ISSUED TO: Blackwell Homes PROPERTY LOCATION: 1125
 SUBDIVISION Woodshire
 NEW REPAIR EXPANSION Site Improvements required prior to Construction Authorization
 Type of Structure: SFD-46x55-4BR
 Proposed Wastewater System Type: Pump to 25% Reduction Sys.
 Projected Daily Flow: 480 GPD
 Number of bedrooms: 4 max Number of Occupants: 8 max
 Basement Yes No
 Pump Required: Yes No May be required based on final location and elevations of facilities
 Type of Water Supply: Community Public Well Distance from well 100 feet Permit valid for: _____
 Permit conditions: meet onsite for final layout maintain all set backs
Must sleeve pump supply line if it cross under Drive way

Authorized State Agent: J. Weber Date: 11-12-08 SEE ATTACHE
 The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meet site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to comp the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall with the attached system layout.

ISSUED TO: Blackwell Homes PROPERTY LOCATION: 1125
 SUBDIVISION Woodshire
 Facility Type: SFD-46x55-4BR New Expansion Repair
 Basement? Yes No Basement Fixtures? Yes No
 Type of Wastewater System** Pump to 25% Reduction system (Initial) Wastewater Flow: 4
 (See note below, if applicable) Panel Block (Repair)

Installation Requirements/Conditions
 Septic Tank Size 1000 gallons
 Pump Tank Size 1000 gallons
 Number of trenches 1
 Exact length of each trench 250' feet
 Trenches shall be installed on contour at a
 Maximum Trench Depth of: 18-24 inches
 (Trench bottoms shall be level to +/- 1/4" in all directions)
 Pump Requirements: _____ ft. TDH vs. _____ GPM
 Trench Spacing: 9 Feet
 Soil Cover: 6 inches
 (Maximum soil cover shall not e 36" above the trench bottom)
 Aggregate Depth: _____

Conditions: _____

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this p

Owner/Legal Representative Signature: _____ Date: _____

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownersh Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTA

Authorized State Agent: J. Weber Date: 11-12-08
 Construction Authorization Expiration Date: 11-12-2013

HTE# 07-520-19049 RRRR

Permit # 25100


Harnett County Department of Public Health Site Sketch

ISSUED TO: Blackwell Homes

PROPERTY LOCATOR: 1125
SUBDIVISION: Woodshine

Authorized State Agent: J. LARS

Date: 11-12-08

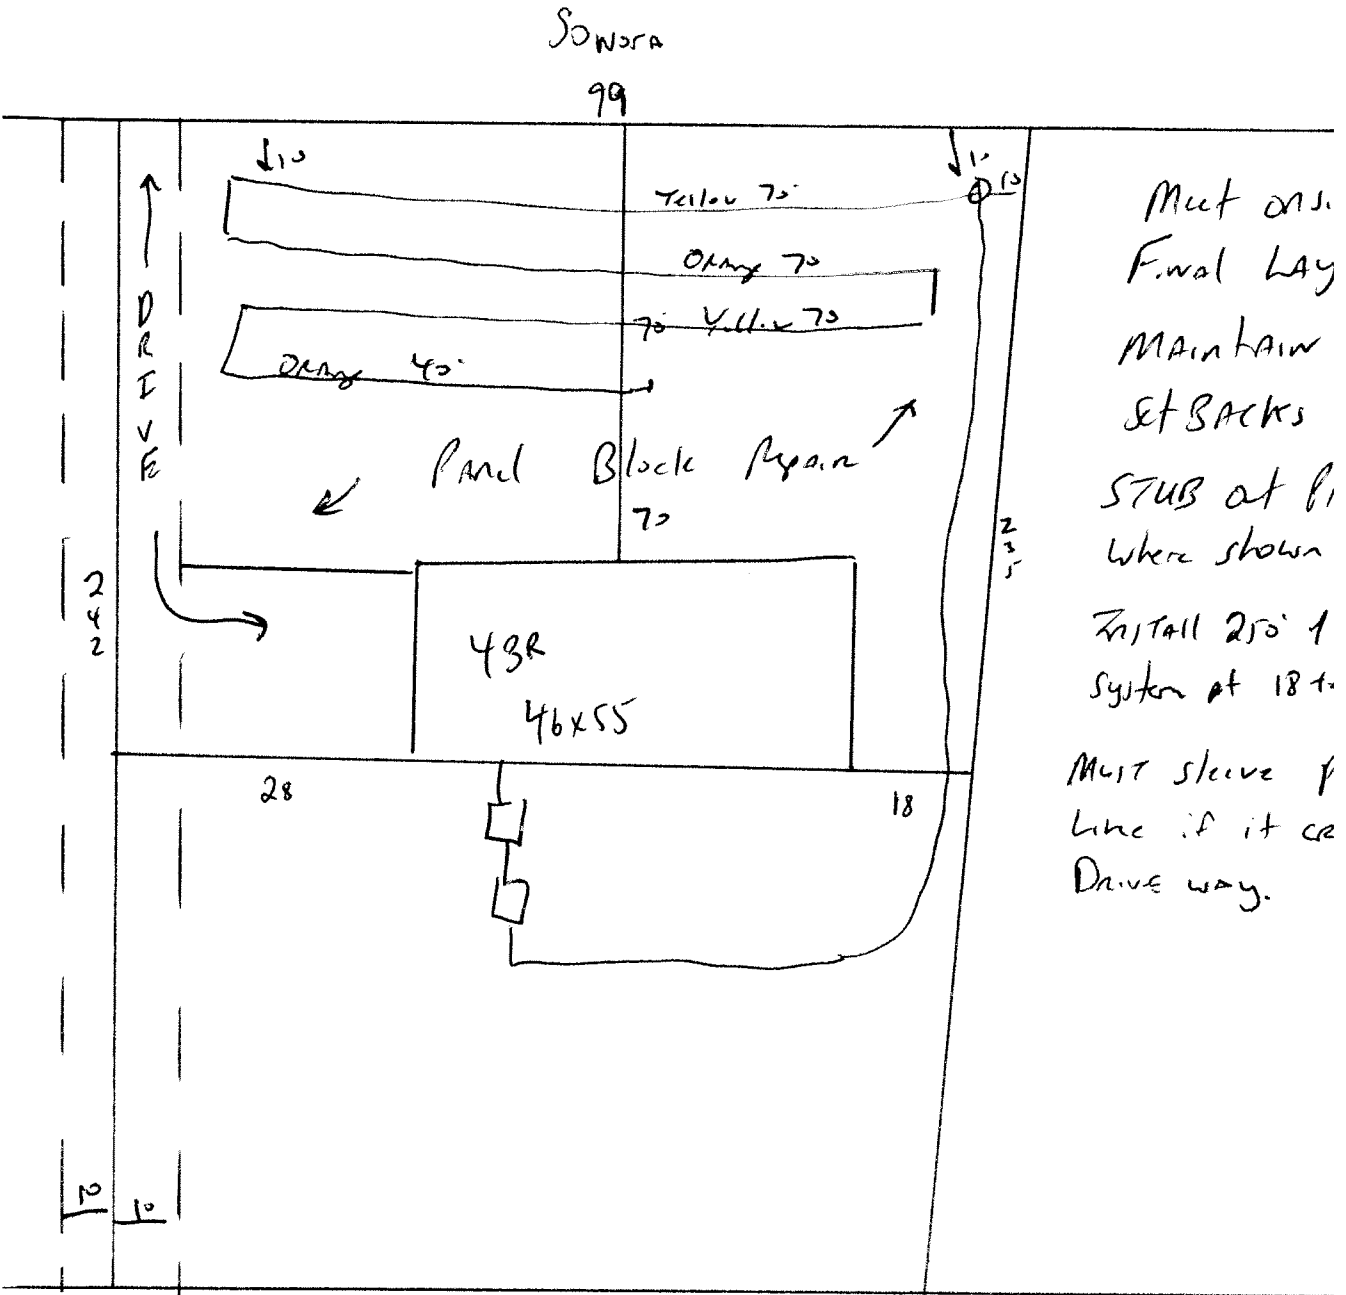

Must call
Final LAY
MAINTAIN
SETBACKS
STUB at P1
Where shown
Install 250' 1
System at 18"
Must sleeve p
line if it cr
Drive way.

20' EASEMENT
85
SR 1125