

Job J82615	Truss A3-2PLY	Truss Type ATTIC	Qty 2	Ply 2	Blackwell Homes - Lot 211 Woodshire Job Reference (optional)	E4966726
---------------	------------------	---------------------	----------	----------	---	----------

Comtech, Inc., Fayetteville, NC 28309

7.060 s Jul 22 2008 MiTek Industries, Inc. Wed Jul 30 09:40:55 2008 Page 1

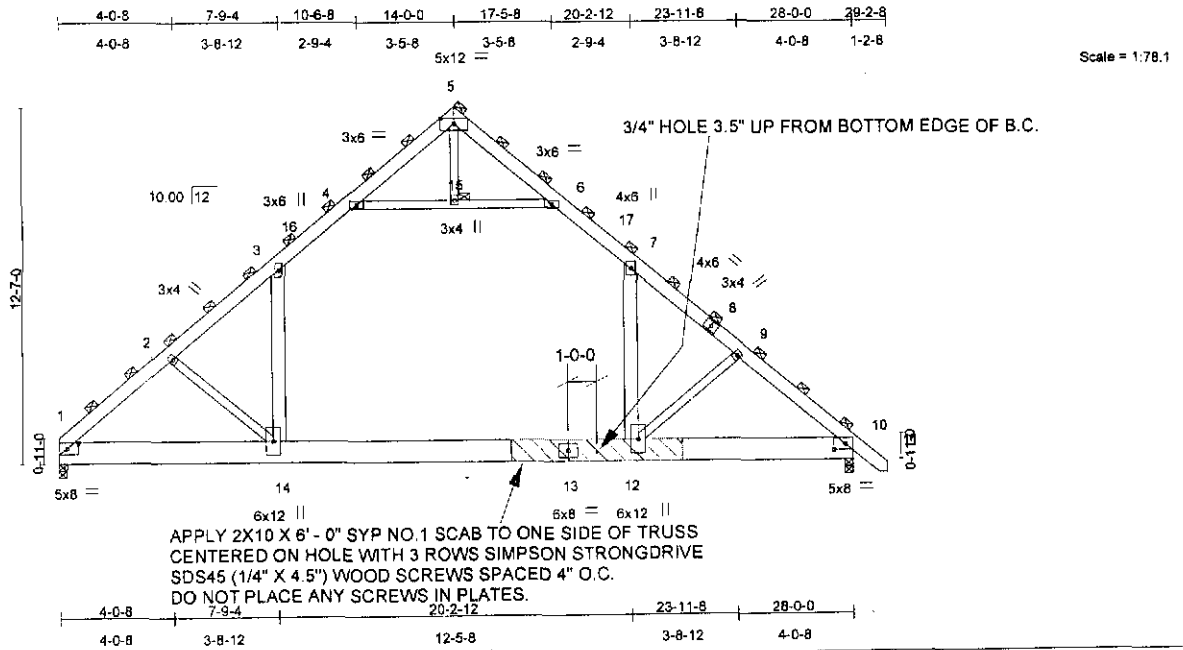


Plate Offsets (X,Y): [1-0-4-12-0-2-8], [10-0-4-(12-0-2-8)]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	4-8-0	TC 0.84	in (loc) l/def L/d	MT20	244/190
TCDL 10.0	Plates Increase 1.15	BC 0.85	Vert(LL) -0.37 12-14 >889 360		
BCLL 0.0	Lumber Increase 1.15	WB 0.18	Vert(TL) -0.72 12-14 >460 240		
BCDL 10.0	Rep Stress Incr NO	(Matrix)	Horz(TL) 0.04 10 n/a n/a		
	Code IRC2003/TPI2002				Weight: 516 lb

LUMBER
TOP CHORD 2 X 6 SYP 2700F 2.2E *Except*
 5-8: 2 X 6 SYP SS, 8-11: 2 X 6 SYP No.1
BOT CHORD 2 X 10 SYP No.1
WEBS 2 X 4 SYP No.3 *Except*
 4-6: 2 X 4 SYP No.1, 3-14, 7-12: 2 X 6 SYP No.1


BRACING
TOP CHORD 2-0-0 oc purlins (5-0-8 max.)
 (Switched from sheeted. Spacing > 2-0-0).
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
JOINTS 1 Brace at Jt(s): 5, 15

REACTIONS (lb/size) 1=4483/0-3-8, 10=4662/0-3-8
 Max Horz 1=-1142(LC 3)
 Max Uplift 1=-201(LC 5), 10=-384(LC 6)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-6648/95, 2-3=-6146/118, 3-16=-3871/314, 4-16=-3608/387, 4-5=-129/637, 5-6=-145/628, 6-17=-3625/390,
 7-17=-3889/319, 7-8=-5797/123, 8-9=-6112/60, 9-10=-6605/99, 10-11=0/82
BOT CHORD 1-14=-103/4844, 13-14=0/4082, 12-13=0/4082, 10-12=0/4812
WEBS 4-15=-4873/471, 6-15=-4873/471, 3-14=0/2896, 7-12=0/2839, 2-14=-1078/699, 9-12=-1019/669, 5-15=0/316

- NOTES**
- 2-ply truss to be connected together with 10d (0.148"x3") nails as follows:
 Top chords connected as follows: 2 X 6 - 2 rows at 0-9-0 oc.
 Bottom chords connected as follows: 2 X 10 - 2 rows at 0-9-0 oc.
 Webs connected as follows: 2 X 4 - 1 row at 0-9-0 oc, 2 X 6 - 2 rows at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-02; 100mph; TCCL=6.0psf; BCCL=5.0psf; h=28ft, Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Interior(1) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
 - Ceiling dead load (10.0 psf) on member(s), 3-4, 6-7, 4-15, 6-15; Wall dead load (5.0psf) on member(s), 3-14, 7-12
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room, 12-14
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 201 lb uplift at joint 1 and 384 lb uplift at joint 10.
 - This truss is designed in accordance with the 2003 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

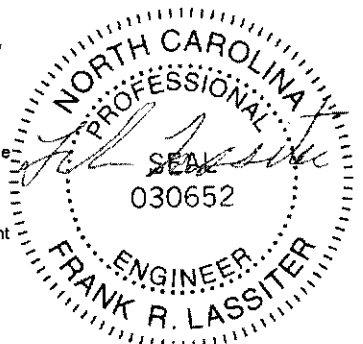

July 31, 2008

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MIT-7473 BEFORE USE.
 Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component.
 Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, DSB-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D Onofria Drive, Madison, WI 53719.

TRENCO
 ENGINEERING BY
 A MiTek Alliance
 818 Soundside Road
 Edenton, NC 27932

ADDRESS : 191 BLUE OAK DR SUBDIV: WOODSHIRE PH 5
CONTRACTOR : DBI-DUSTIN BLACKWELL INC PHONE : (919) 606-4696
OWNER : WOODSHIRE PARTNERS LLC #211 PHONE :
PARCEL : 01-0536-06- -0028- -51-
APPL NUMBER: 08-50019308 CP NEW RESIDENTIAL (SFD)
DIRECTIONS : WOODSHIRE #211
HWY 27W TO NURSERY RD, LEMUEL BLACK RD,
SUB DIV ON LEFT.
T/S: 01/28/2008 11:46 AM VBROWN ----

STRUCTURE: 000 000 42X52 3BDR 2.5BATH SFD
FLOOD ZONE : FLOOD ZONE X

PERMIT: CPSF 00 CP * SFD

TYP/SQ	REQUESTED COMPLETED	INSP RESULT	DESCRIPTION RESULTS/COMMENTS
B101 01	7/01/08	DT	R*BLDG FOOTING / TEMP SVC POLE VRU #: 001634781
	7/01/08	AP	
A814 01	7/08/08	TI	ADDRESS CONFIRMATION VRU #: 001637792
	7/15/08	AP	191 BLUE OAK DR LOT 211
B103 01	7/08/08	DT	R*BLDG FOUND & TEMP SVC POLE VRU #: 001637784
	7/08/08	AP	
B105 01	7/14/08	DT	R*OPEN FLOOR TIME: 17:00 VRU #: 001641208
	7/14/08	AP	
R427 01	7/28/08	TI	FOUR TRADE ROUGH IN >2500 VRU #: 001649631
	7/28/08	CA	HAD TO CANCEL BECAUSE INSPECTION DID NOT PRINT FOR INSPECTION. WILL SCHEDULE FOR TOMORROW. T/S: 07/28/2008 04:06 PM DJOHNSON -----
R427 02	7/29/08	JH	FOUR TRADE ROUGH IN >2500 TIME: 17:00 VRU #: 001651132
	7/29/08	DA	1)Missing big window in kitchen. 2)Need engineer letter for holes drilled in floor truss in kitchen in front of big window & 2ply roof truss in spare bath room upstairs. 3)Fire block @ top of fire place. 4)Fire caulk wire @ top plate to right of window in master bed closet. 5)Bond faucet to tub in master bath. 6)Smoke detector on 3rd floor. 7)Seal sleeve on drain line @ foundation wall. 8)Repair hole in drain line under house on long section of 3" pipe to right of crawl space hole,nail on ppipe marking hole.
R427 03	8/04/08	JH	FOUR TRADE ROUGH IN >2500 VRU #: 001654417
	8/04/08	AP	
I129 01	8/05/08	TI	R*INSULATION INSPECTION VRU #: 001655943
	8/05/08	CA	
I129 02	8/06/08	TI	R*INSULATION INSPECTION VRU #: 001656412
		AP JH	

COMMENTS AND NOTES

ADDRESS : 191 BLUE OAK DR SUBDIV: WOODSHIRE PH 5
 CONTRACTOR : DBI-DUSTIN BLACKWELL INC PHONE : (919) 606-4696
 OWNER : WOODSHIRE PARTNERS LLC #211 PHONE :
 PARCEL : 01-0536-06- -0028- -51-
 APPL NUMBER: 08-50019308 CP NEW RESIDENTIAL (SFD)
 DIRECTIONS : WOODSHIRE #211
 HWY 27W TO NURSERY RD, LEMUEL BLACK RD,
 SUB DIV ON LEFT.
 T/S: 01/28/2008 11:46 AM VBROWN ----

STRUCTURE: 000 000 42X52 3BDR 2.5BATH SFD
 FLOOD ZONE : FLOOD ZONE X
 # BEDROOMS : 3.00 PROPOSED USE : SFD
 SEPTIC - EXISTING? : NEW

PERMIT: CPSF 00 CP * SFD

TYP/SQ	REQUESTED COMPLETED	INSP RESULT	DESCRIPTION RESULTS/COMMENTS
B101 01	7/01/08	DT	R*BLDG FOOTING / TEMP SVC POLE VRU #: 001634781
	7/01/08	AP	
A814 01	7/08/08	TI	ADDRESS CONFIRMATION VRU #: 001637792
	7/15/08	AP	✓ 191 BLUE OAK DR LOT 211
B103 01	7/08/08	DT	R*BLDG FOUND & TEMP SVC POLE VRU #: 001637784
	7/08/08	AP	
B105 01	7/14/08	DT	R*OPEN FLOOR TIME: 17:00 VRU #: 001641208
	7/14/08	AP	
R427 01	7/28/08	TI	FOUR TRADE ROUGH IN >2500 VRU #: 001649631
	7/28/08	CA	HAD TO CANCEL BECAUSE INSPECTION DID NOT PRINT FOR INSPECTION. WILL SCHEDULE FOR TOMORROW. T/S: 07/28/2008 04:06 PM DJOHNSON -----
R427 02	7/29/08	JH	FOUR TRADE ROUGH IN >2500 TIME: 17:00 VRU #: 001651132
	7/29/08	DA	1)Missing big window in kitchen. 2)Need engineer letter for holes drilled in floor truss in kitchen in front of big window & 2ply roof truss in spare bath room upstairs. 3)Fire block @ top of fire place. 4)Fire caulk wire @ top plate to right of window in master bed closet. 5)Bond faucet to tub in master bath. 6)Smoke detector on 3rd floor. 7)Seal sleeve on drain line @ foundation wall. 8)Repair hole in drain line under house on long section of 3" pipe to right of crawl space hole, nail on pipe marking hole.
R427 03	8/04/08	JH	FOUR TRADE ROUGH IN >2500 VRU #: 001654417
	8/04/08	AP	
I129 01	8/05/08	TI	R*INSULATION INSPECTION VRU #: 001655943
	8/05/08	CA	
I129 02	8/06/08	JH	R*INSULATION INSPECTION VRU #: 001656412
	8/06/08	AP	
H824 01	8/25/08	JW	✓ ENVIR. OPERATIONS PERMIT TIME: 17:00 VRU #: 001668326
	8/25/08	AP	
R431 01	9/23/08	TI	FOUR TRADE FINAL >2500 VRU #: 001680693

AP-MR

**COUNTY OF HARNETT
DEPARTMENT OF BUILDING INSPECTION
AND PLANNING/DEVELOPMENT
CERTIFICATE OF OCCUPANCY**

This certificate issued pursuant to the requirements of Section 105 of the North Carolina State Building Code and the Harnett County Zoning Ordinance certifies at the time of issuance this structure was in compliance with the various ordinances of the County of Harnett regulating development and building construction or use. For the following:

Use Classification: R-3

PERMIT NUMBERS

Owner: Woodshire Partners Inc.

Building Permit No.: 08-50019308

911 Address: 191 Blue Oak

Electrical Permit No.: "

Insulation Permit No.: "

Plumbing Permit No.: "

State: _____ Zip Code: _____

Mech. Permit No.: "

MFG. Home: _____


Date: 9-23-8

Mike Kearn


Building Official

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in 1/16-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



*For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



*This symbol indicates the required direction of slots in connector plates.

*Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
 DSB-89: Building Component Safety Information
 BCSP 1: Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in 1/16-in-sixteenths (Drawings not to scale)

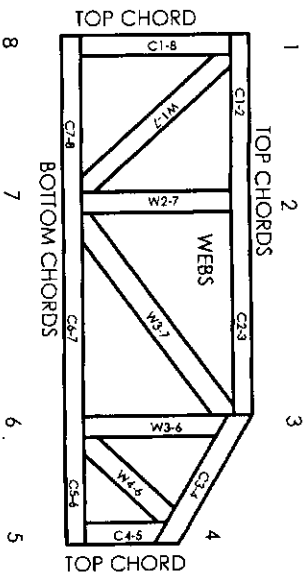

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ER-5243, 9604B
 9730, 95-43, 96-31, 9667A
 NER-487, NER-561
 95110, 84-32, 96-67, ER-3907, 9432A

© 2006 MITek® All Rights Reserved



POWER TO PERFORM™



AMERICA'S ANSWER

Mitek Engineering Reference Sheet: MII-7473

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSP1.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stock materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and warps at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient!
20. Design assumes manufacture in accordance with ANSI/TPI 1.

Trenco

818 Soundside Rd
Edenton, NC 27932


Re: J82614

Blackwell Homes - Lot 211 Woodshire

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: E4966649 thru E4966649

My license renewal date for the state of North Carolina is December 31, 2008.

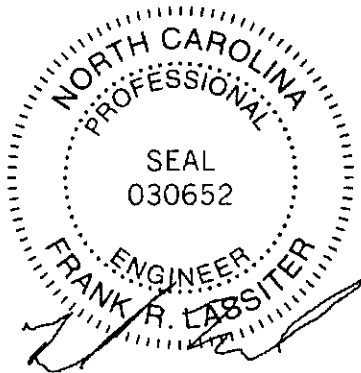

July 31, 2008

Lassiter, Frank

The seal on these drawings indicate acceptance of professional engineering responsibility solely for the truss components shown. The suitability and use of this component for any particular building is the responsibility of the building designer, per ANSI/TPI-2002 Chapter 2. Engineering services provided by Truss Engineering Company.

Trenco

818 Soundside Rd
Edenton, NC 27932

Re: J82614

Blackwell Homes - Lot 211 Woodshire

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: E4966649 thru E4966649

My license renewal date for the state of North Carolina is December 31, 2008.



July 31, 2008

Lassiter, Frank


The seal on these drawings indicate acceptance of professional engineering responsibility solely for the truss components shown. The suitability and use of this component for any particular building is the responsibility of the building designer, per ANSI/TPI-2002 Chapter 2. Engineering services provided by Truss Engineering Company.

Job J82614	Truss FD2	Truss Type FLOOR	Qty 2	Ply 1	Blackwell Homes - Lot 211 Woodshire	E4966649
Comtech, Inc., Fayetteville, NC 28309					Job Reference (optional)	

Comtech, Inc., Fayetteville, NC 28309


7.060 s Jul 22 2008 MiTek Industries, Inc. Wed Jul 30 09:39:33 2008 Page 1

0-1-8



0-1-8
Scale = 1:46.0

3/4" HOLE IN CENTERLINE OF TOP CHORD AND WEB
2" LEFT AND 6" RIGHT OF CENTER OF JOINT 17
PLATE JOINT 17 NOT "DISTURBED"

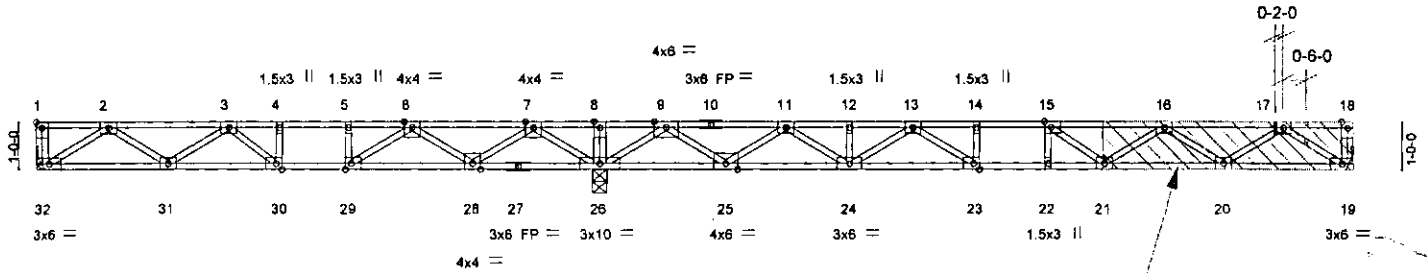

ATTACH 2 LAYERS 3/4" PLYWOOD OR OSB GUSSET (23/32" APA RATED SHEATHING 48/24 EXP 1)
TO ONE SIDE OF TRUSS WITH CONSTRUCTION QUALITY ADHESIVE AND ONE ROW OF
10d (3" X .131") NAILS SPACED 2" O.C. IN ALL MEMBERS.
GLUE PLYWOOD LAYERS TOGETHER PRIOR TO ATTACHING TO TRUSS.

11-8-4

27-5-0

11-8-4

15-8-12

Plate Offsets (X,Y): [1:Edge,0-1-8], [15:0-1-8,Edge], [23:0-1-8,Edge], [29:0-1-8,Edge], [30:0-1-8,Edge]

LOADING (psf)	SPACING 2-0-0	CSI	DEFL in (loc) V/defl L/d	PLATES GRIP
TCLL 40.0	Plates Increase 1.00	TC 0.63	Vert(LL) -0.17 22 >999 480	MT20 244/190
TCDL 10.0	Lumber Increase 1.00	BC 0.64	Vert(TL) -0.26 22 >734 360	
BCLL 0.0	Rep Stress Incr YES	WB 0.51	Horz(TL) 0.03 19 n/a n/a	
BCDL 5.0	Code IRC2003/TPI2002	(Matrix)		Weight: 135 lb

LUMBER

TOP CHORD 4 X 2 SYP No.1
BOT CHORD 4 X 2 SYP No.1
WEBS 4 X 2 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size) 32=433/Mechanical, 26=1847/0-3-8, 19=708/Mechanical
Max Grav 32=538(LC 2), 26=1847(LC 1), 19=739(LC 3)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-32=-42/0, 18-19=-46/0, 1-2=0/0, 2-3=-1146/63, 3-4=-1436/468, 4-5=-1436/468, 5-6=-1436/468, 6-7=-426/1249, 7-8=0/2624, 8-9=0/2624, 9-10=-339/492, 10-11=-339/492, 11-12=-1977/0, 12-13=-1977/0, 13-14=-2807/0, 14-15=-2807/0, 15-16=-2630/0, 16-17=-1746/0, 17-18=0/0


BOT CHORD 31-32=-5767, 30-31=-201/1468, 29-30=-468/1436, 28-29=-883/1050, 27-28=-1611/0, 26-27=-1611/0, 25-26=-1158/0, 24-25=-187/1298, 23-24=0/2482, 22-23=0/2807, 21-22=0/2807, 20-21=0/2382, 19-20=0/1072

WEBS 8-26=-105/0, 7-26=-1421/0, 7-28=0/945, 6-28=-963/0, 6-29=0/880, 5-29=-336/0, 4-30=-3/183, 2-32=-909/7, 2-31=-70/465, 3-31=-391/169, 9-26=-1738/0, 9-25=0/1262, 11-25=-1224/0, 11-24=0/872, 12-24=-103/0, 13-24=-665/0, 13-23=0/695, 3-30=-479/0, 14-23=-239/0, 15-22=-168/58, 17-19=-1271/0, 17-20=0/822, 16-20=-776/0, 16-21=0/326, 15-21=-325/147

NOTES

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x4 MT20 unless otherwise indicated.
- 3) Refer to girder(s) for truss to truss connections.
- 4) This truss is designed in accordance with the 2003 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-16d nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 6) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

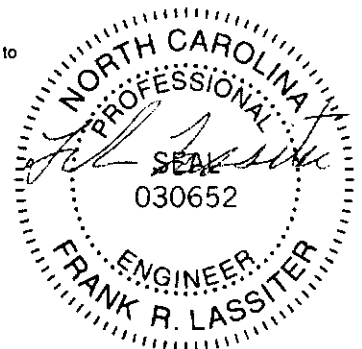

July 31, 2008


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE M11-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI Quality Criteria, D58-89 and SCS1 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



* For 4 x 2 orientation, locate plates 0- $\frac{1}{8}$ " from outside edge of truss.

* This symbol indicates the required direction of slots in connector plates.

* Plate location details available in Mitek 20/20 software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

ANSI/TPI1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSII: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

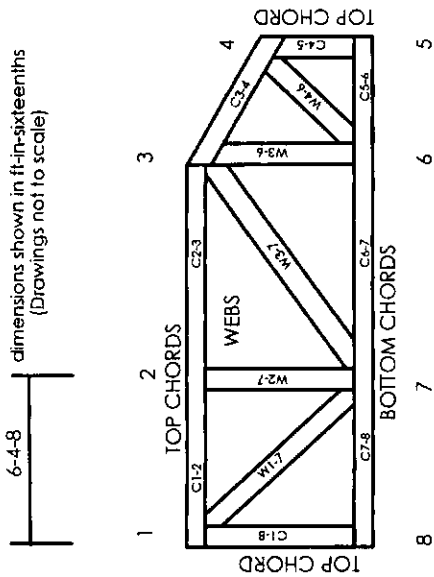

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ER-5243, 9604B
9730, 95-43, 96-31, 9667A
NER-487, NER-561
95110, 84-32, 96-67, ER-3907, 9432A

© 2006 Mitek® All Rights Reserved



Mitek Engineering Reference Sheet: MII-7473

General Safety Notes


Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSII.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knobs and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.

2


1

Job Reference (optional)



0-1-8
Scale = 1:46.0

3/4" HOLE IN CENTERLINE OF TOP CHORD AND WEB
2" LEFT AND 6" RIGHT OF CENTER OF JOINT 17
PLATE JOINT 17 NOT "DISTURBED"

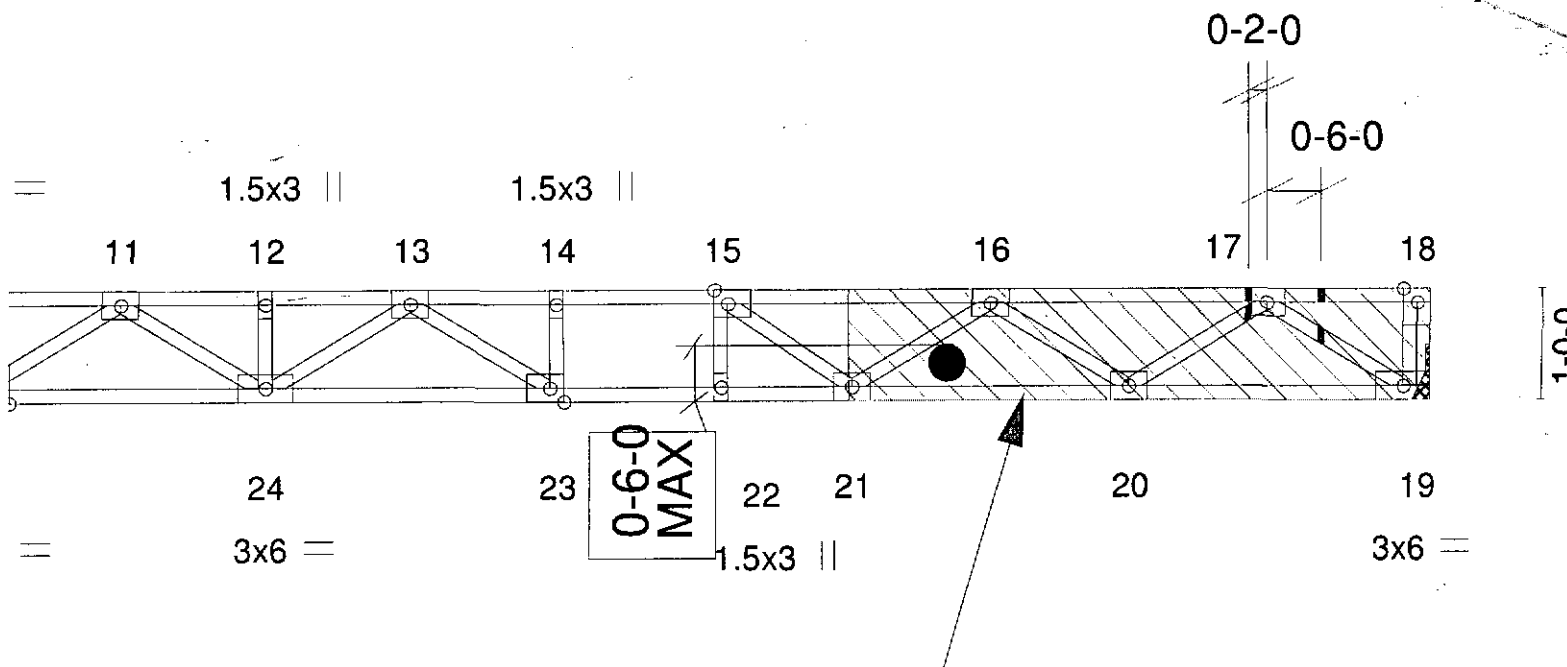

ADD OR OSB GUSSET (23/32" APA RATED SHEATHING 48/24 EXP 1)
CONSTRUCTION QUALITY ADHESIVE AND ONE ROW OF
1" O.C. IN ALL MEMBERS.
CHECK PRIOR TO ATTACHING TO TRUSS.

27-5-0

15-8-12

8,Edge]

L	in	(loc)	l/defl	L/d
(LL)	-0.17	22	>999	480
(TL)	-0.26	22	>734	360
:(TL)	0.03	19	n/a	n/a

PLATES **GRIP**
MT20 244/190

Weight: 135 lb

Trenco

818 Soundside Rd
Edenton, NC 27932

Re: J82615

Blackwell Homes - Lot 211 Woodshire

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: E4966726 thru E4966726

My license renewal date for the state of North Carolina is December 31, 2008.



July 31, 2008

Lassiter, Frank

The seal on these drawings indicate acceptance of professional engineering responsibility solely for the truss components shown. The suitability and use of this component for any particular building is the responsibility of the building designer, per ANSI/TPI-2002 Chapter 2. Engineering services provided by Truss Engineering Company.