

HTE# 08-5-19474R

Harnett County Department of Public Health

20552

PERMIT # 24906

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: VICKETH RD

Name: (owner) PAUL FLAHERTY

SUBDIVISION BUFFALO LAKES

LOT # 42

System Installer: OTIS STRICKLAND

Registration # _____

Basement with plumbing Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well 100 feet


System Type: IID

Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

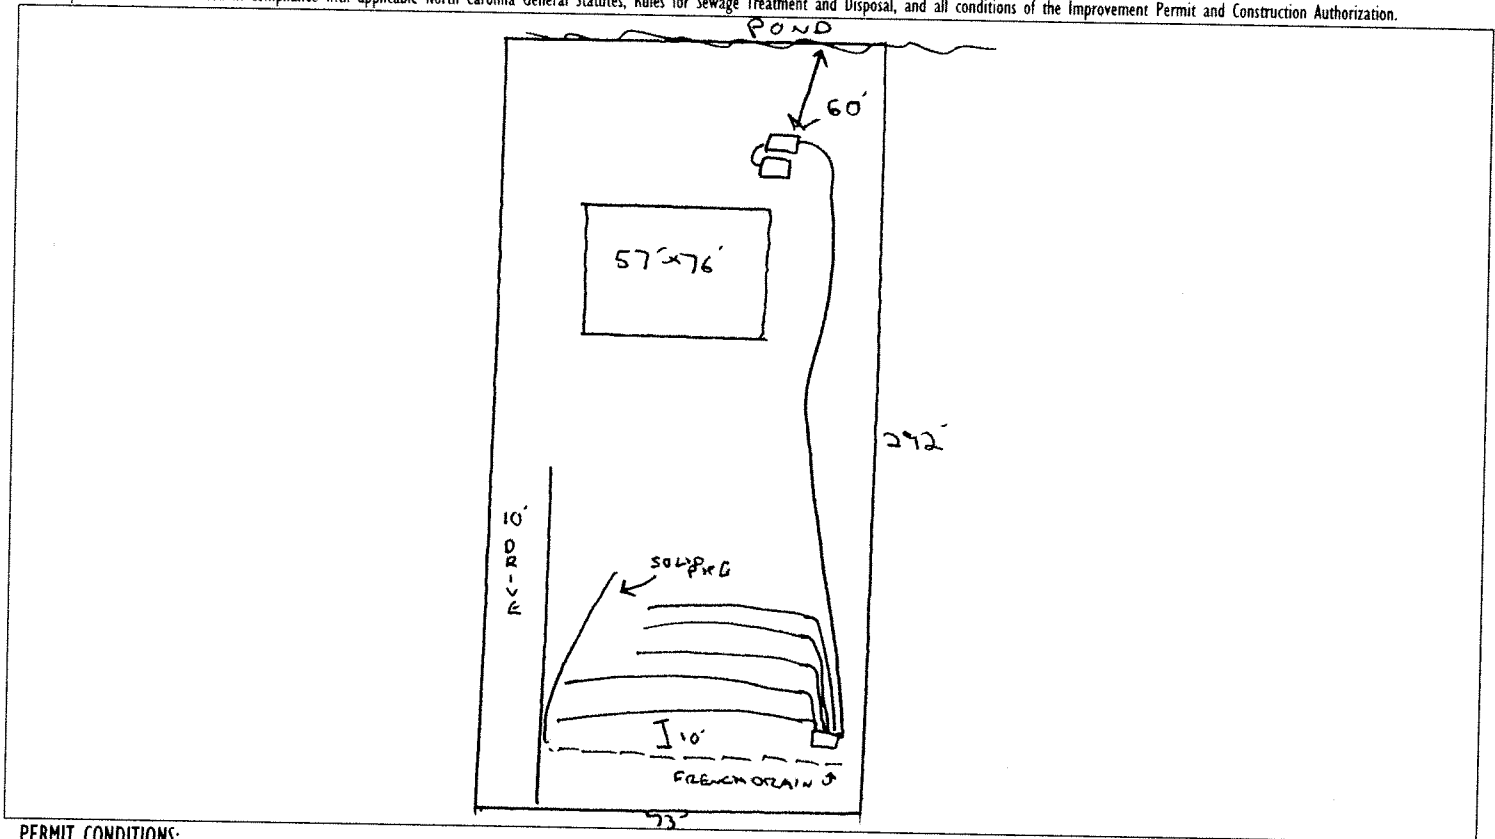

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: PRESSURE MANIFOLD DISTRIBUTION, LOT EXEMPT FROM REPAIR (ISA NCAC 18A .1945(G))

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other PUMP TO EZ-Flow Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field: No. of ditches 5 exact length of each ditch 2x65' width of ditches 3 feet depth of ditches 12 inches

French Drain Required: Linear feet

Authorized State Agent _____

RS

Date 4/20/09