

HTE# 08-5-19604

# Harnett County Department of Public Health

20338

PERMIT # 24711

## Operation Permit

New Installation  Septic Tank  Repair  Nitrification Line  Expansion

PROPERTY LOCATION: WILL LUCAS RD

Name: (owner) ACCENT HOME BUILDERS SUBDIVISION CAROLINA OAKS LOT # 37

System Installer: WAYNE JONES Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well 100 feet

System Type: IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

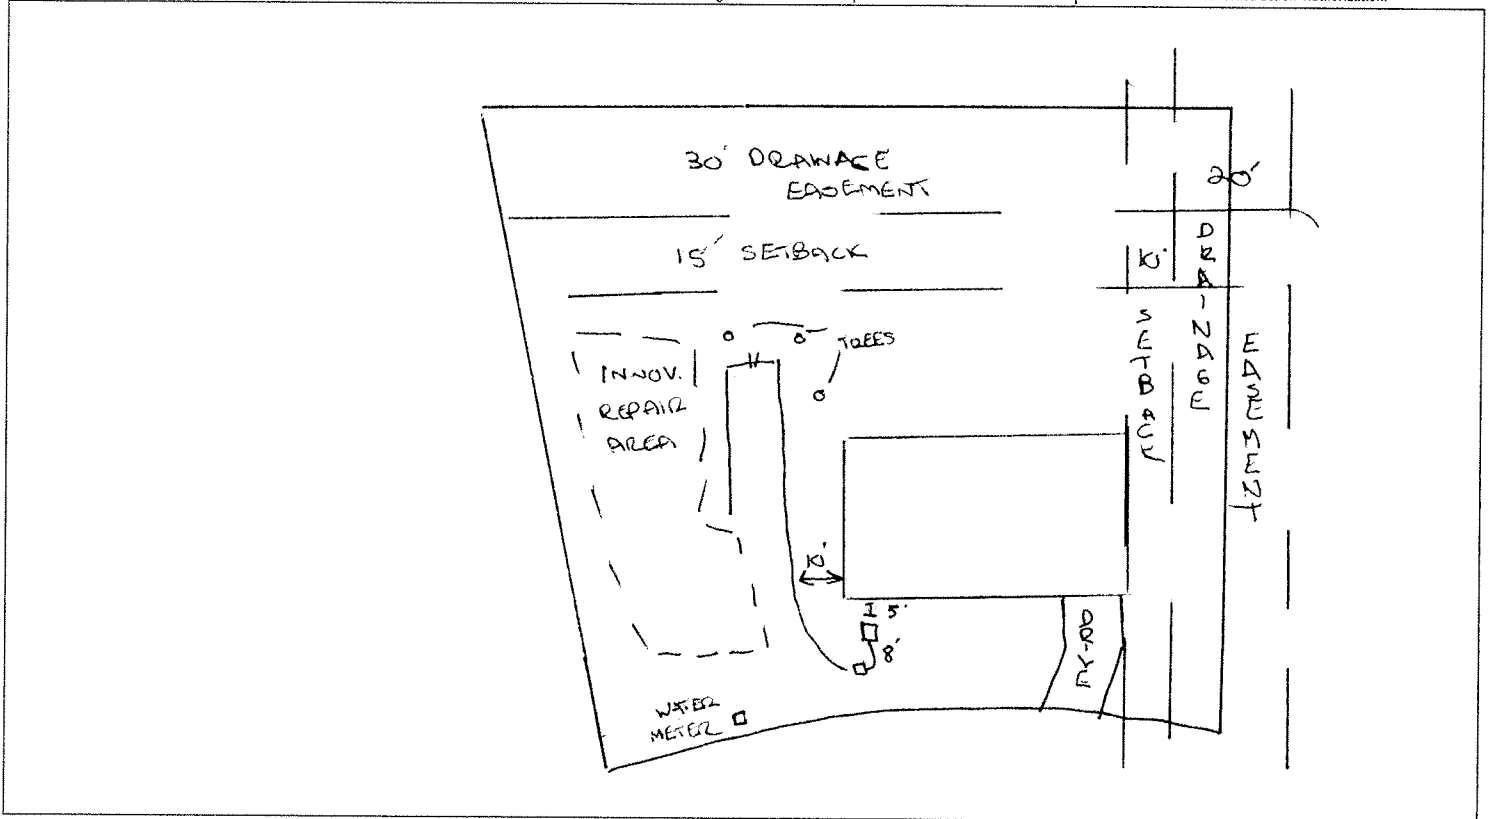

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_

V. Other: WATERLINE MUST BE VISUALLY INSPECTED BY HCHD TO VERIFY SETBACKS PRIOR TO OP BEING ISSUED  
\*WATER LINE INSPECTED ON 11/6/08 BY ST.

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other CHAMBER INFILTRATOR Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface No. of exact length (panels) width of depth of  
Drainage Field ditches \_\_\_\_\_ of each ditch 120 feet ditches 3 feet ditches 36 inches

French Drain Required \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 11/7/08