

HTE# 08-5-19642

Harnett County Department of Public Health

20098

PERMIT # 24714

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: _____

Name: (owner) TURLINGTON BUILDERS LLC SUBDIVISION DEER PATH FARMS II LOT # 15

System Installer: ANGIER EVERGREEN Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: IID Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

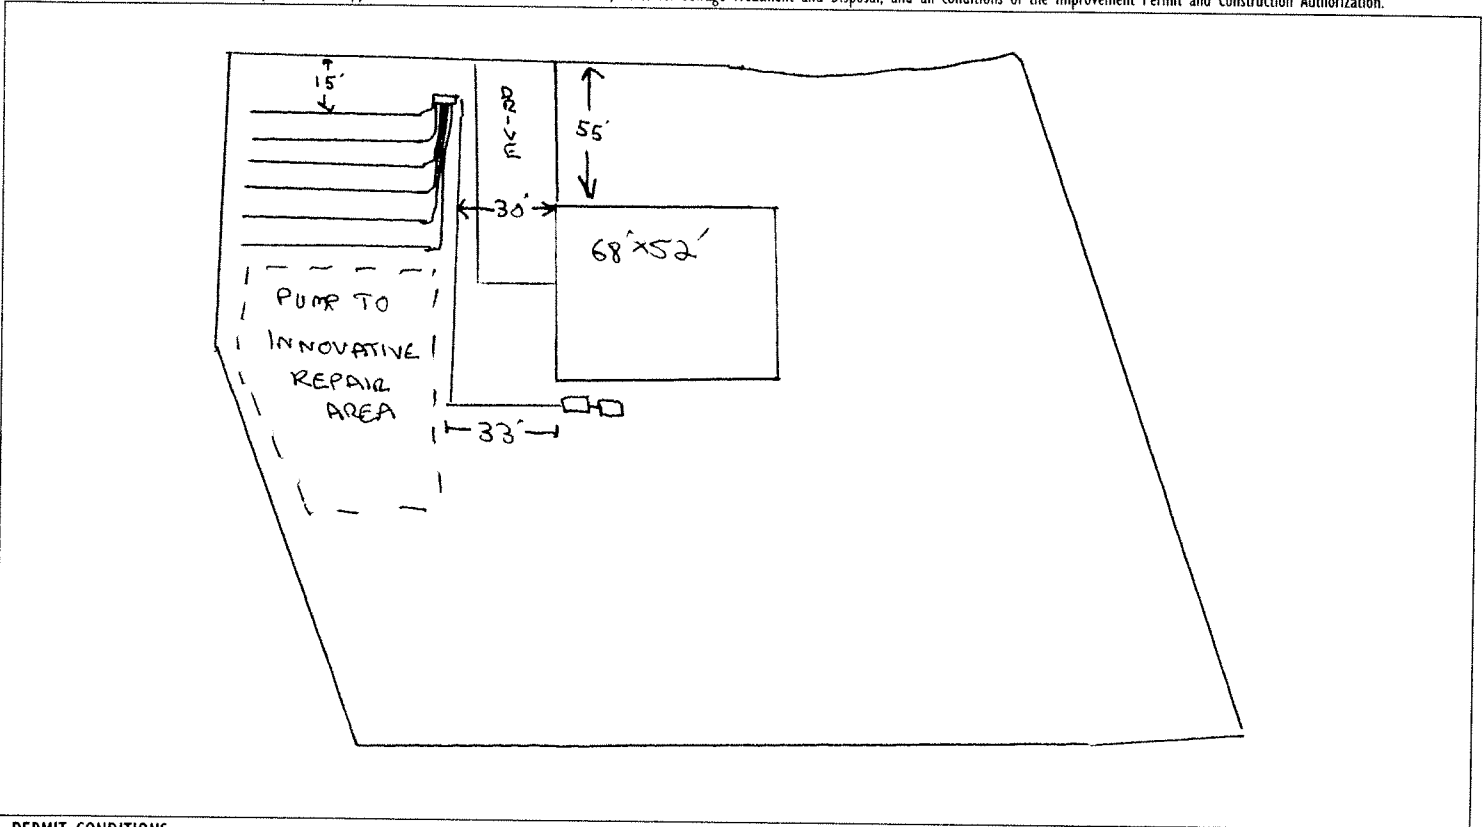

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: SYSTEM COMPONENTS CHECKED BY OT. PUMP, ALARM, & COVER SHALL TO BE CHECKED ^{BY} 10/1/08

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other PUMP TO EZ FLOW Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 6 of each ditch 100 feet ditches 3 feet ditches 12 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 10/1/08