

**SOIL/SITE EVALUATION
 for ON-SITE WASTEWATER SYSTEM**

Owner:
 Address:
 Proposed Facility: *SFD* Design Flow (.1949): *360*
 Location of Site:
 Water Supply: Public Individual Well
 Evaluation Method: Auger Boring Pit
 Type of Wastewater: Sewage Industrial Process

Applicant: *15898*
 Date Evaluated: *5-1-08*
 Property Size:
 Property Recorded:
 Spring Other
 Pit Cut
 Mixed

P R O F I L E #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
1	L 5%	0-32	SL	fin GRNSNP					-4
		32-48	SCL	fin 1 ^m GRNSNP	42" 7.5% w				
2	L 5%	0-24	SL	fin GRNSNP					-35
		24-42	SCL	fin 1 ^m GRNSNP	36" 7.5% w				
3	L 5%	0-18	SL	fin GRNSNP					-3
		18-36	SC	fin 1 ^m GRNSNP	30" 7.5% w				
4	L 5%	0-18	SL	fin GRNSNP					-3
		18-36	SC	fin 1 ^m GRNSNP	30" 7.5% w				
5	L 5%	0-24	SL	fin GRNSNP					-38
		24-38	SCL	fin 1 ^m GRNSNP	36" 7.5% w				

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)	<i>2500</i>	<i>2500</i>
Site LTAR	<i>.3</i>	<i>.3</i>

Other Factors (.1946): _____
 Site Classification (.1948): *PS*
 Evaluated By: *[Signature]*
 Others Present:


COMMENTS: _____


<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE FR-FRIABLE FI-FIRM VFI-VERY FIRM EFI-EXTREMELY FIRM	NS-NON-STICKY SS-SLIGHTLY STICKY S-STICKY VS-VERY STICKY NP-NON-PLASTIC SP-SLIGHTLY STICKY P-PLASTIC VP-VERY PLASTIC
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6		
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3		
H-HEAD SLOPE		SIL-SILT LOAM			
CC-CONCLAVE SLOPE		CL-CLAY LOAM			
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			
T-TERRACE		SICL-SILTY CLAY LOAM			
FP-FLOOD PLAN	IV	SIC-SILTY CLAY	0.4 - 0.1		
		C-CLAY			
		SC-SANDY CLAY			

STRUCTURE
 SG-SINGLE GRAIN
 M-MASSIVE
 CR-CRUMB
 GR-GRANULAR
 SBK-SUBANGULAR BLOCKY
 ABK-ANGULAR BLOCKY
 PL-PLATY
 PR-PRISMATIC

MINERALOGY
 SLIGHTLY EXPANSIVE
 EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

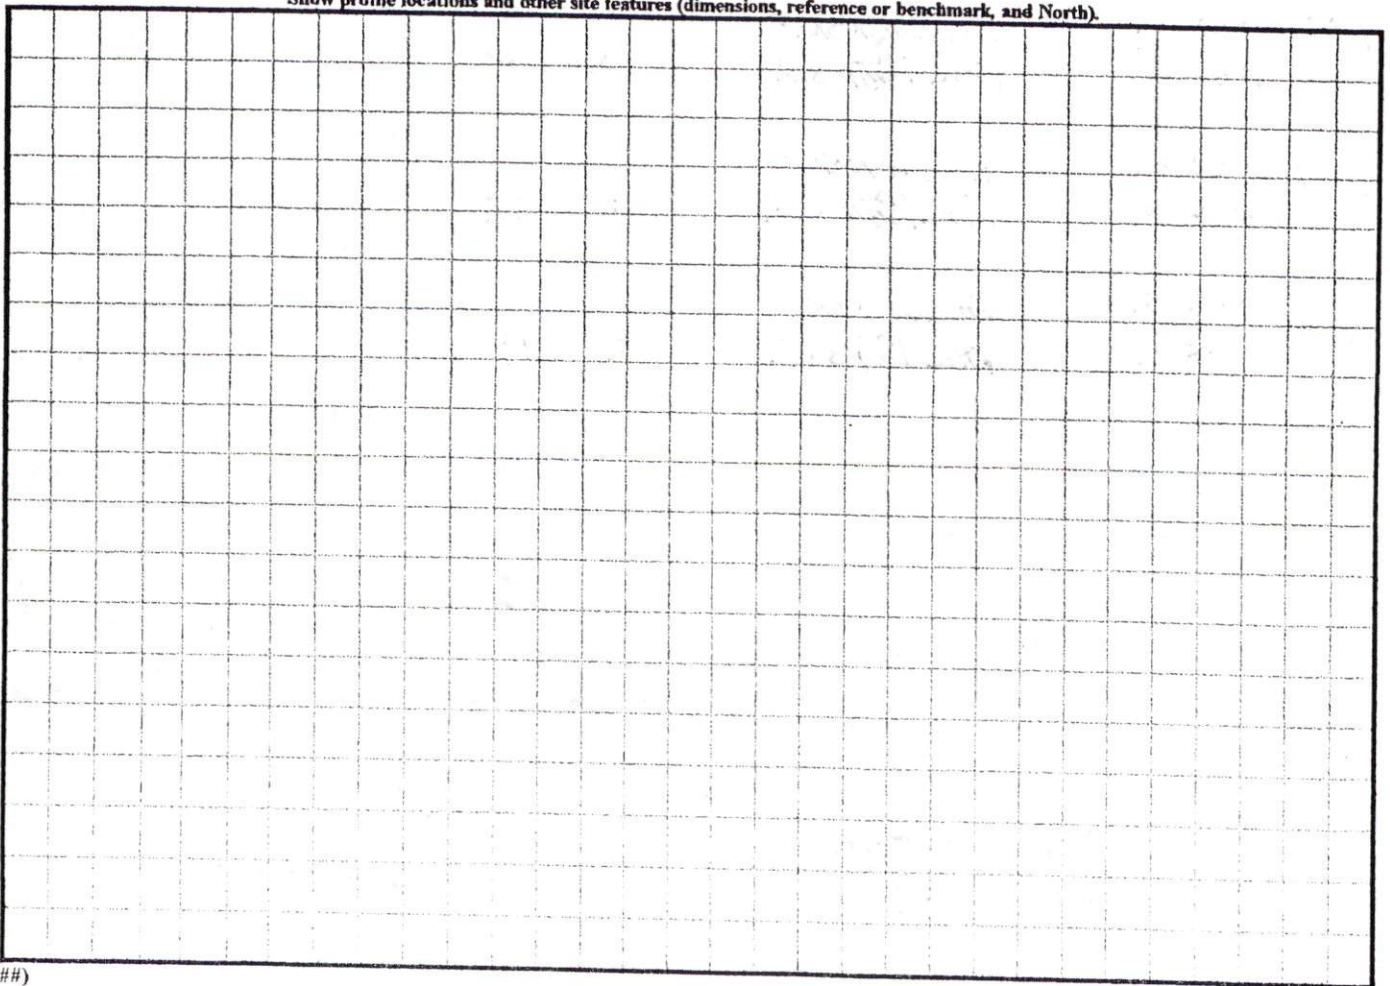


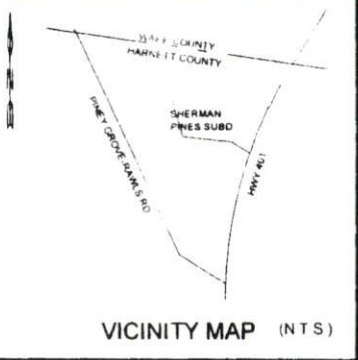

LEGEND

- Lines Surveyed
- - - Lines not surveyed
- E.I.P. Existing Iron Pipe
- I.P.S. Iron Pipe Set
- P.P. Power Pole
- M.H. Manhole

Id	Radius	Arc Length	Chord	Ch Bear
C1	50.00'	40.00'	38.94'	S 64°30'56" E

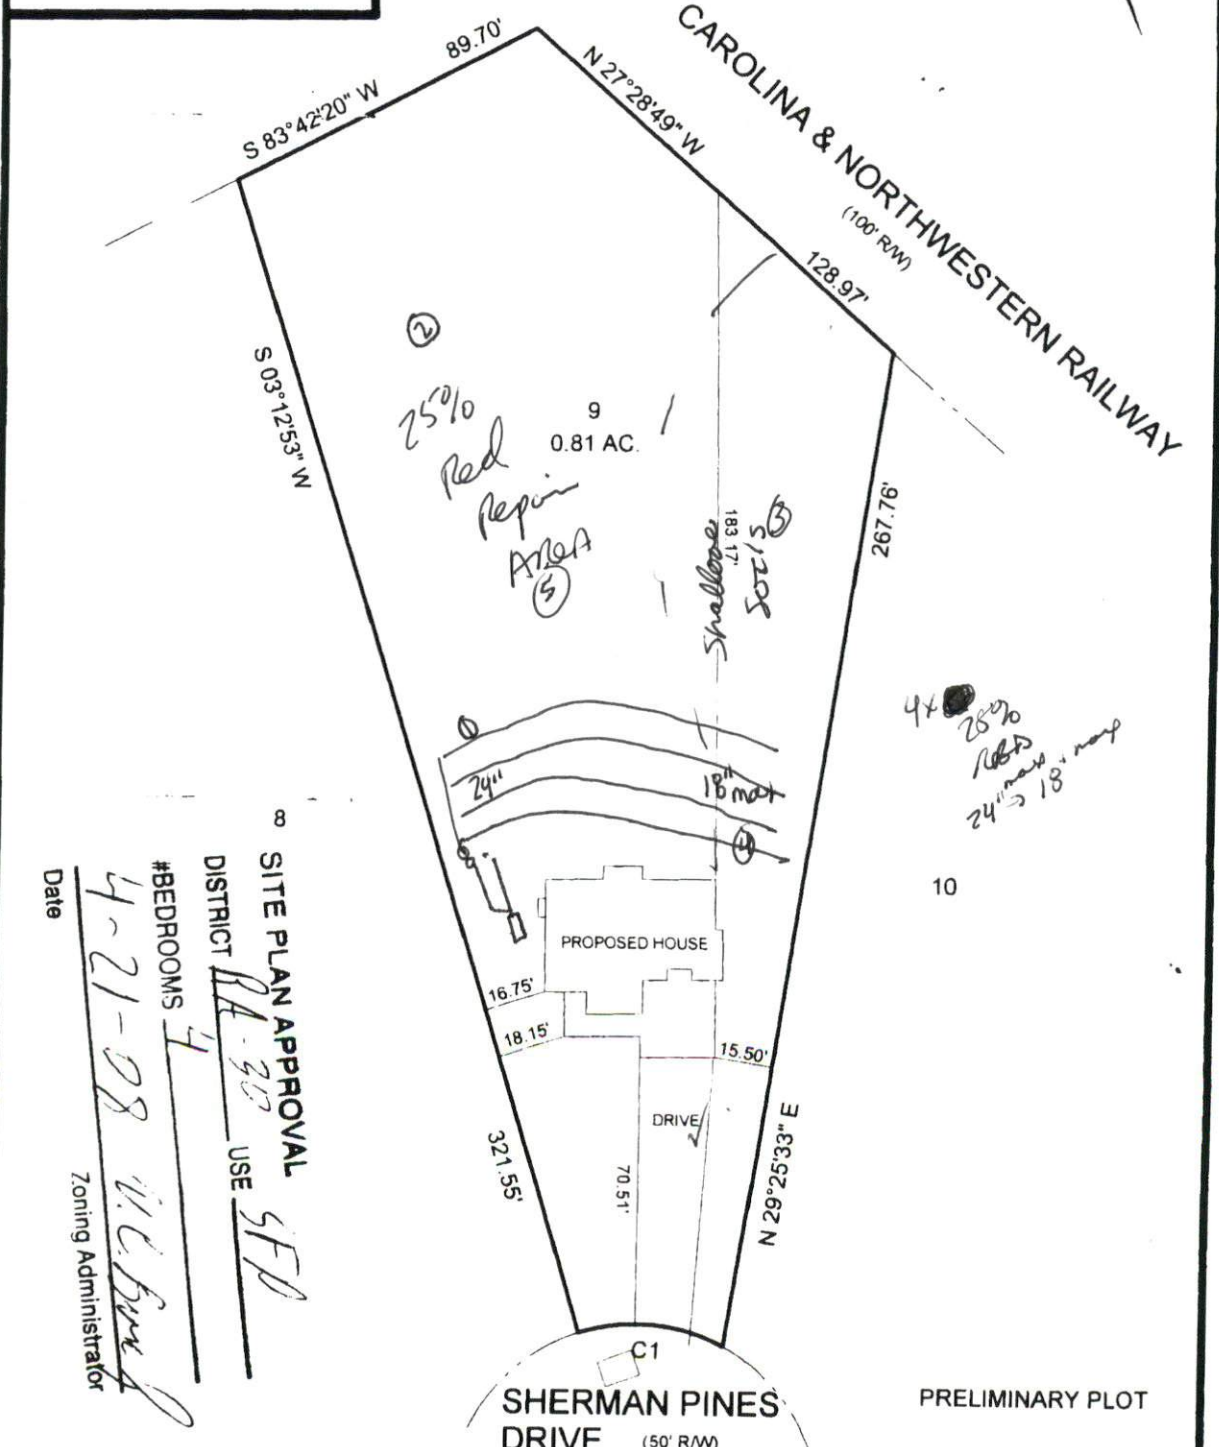

SITE PLAN APPROVAL
 DISTRICT RA-30 USE SFD
 #BEDROOMS 4
 Date 4-21-08 W.C. Bond
 Zoning Administrator

SHERMAN PINES DRIVE (50' R/W)
 C1

PRELIMINARY PLOT