

HTE# 0850020075

Hett County Department of Public Health

20170

PERMIT # 24793

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: NC27

Name: (owner) Wynn Court.

SUBDIVISION Tingen Pointe

LOT # 51

System Installer: Corey G. Ibert

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well 100 feet


System Type: Pump to E-Z Flow

Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

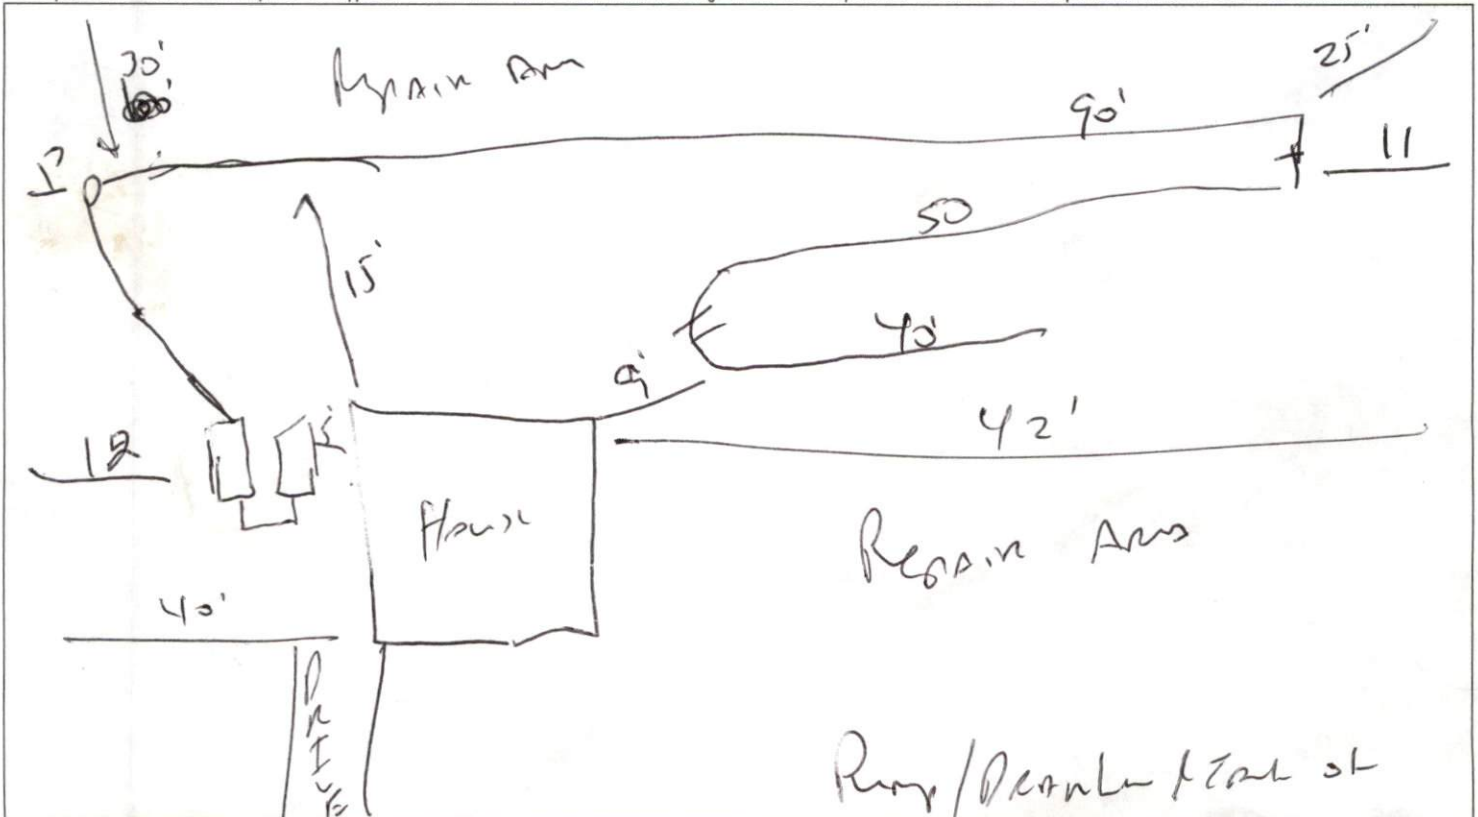

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump to E-Z Flow Septic Tank: 1200 gallons Pump Tank: 1200 gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 1 of each ditch 180 feet ditches 3 feet ditches 18 inches

French Drain Required: _____ Linear feet

Authorized State Agent

Corey G. Ibert

Date

09-26-08