

HTE# 08500-20079

Harnett County Department of Public Health

24798

Improvement Permit

A building permit cannot be issued with only an Improvement Permit

ISSUED TO: Cumberland Homes
PROPERTY LOCATION: 1210
SUBDIVISION: Persimmon H.II
LOT # 8
Type of Structure: SFD-57x42-3BR
Proposed Wastewater System Type: Pump to ultra shallow
Projected Daily Flow: 360 GPD 25% reduction system
Number of bedrooms: 3 Number of Occupants: 6 max
Basement: No
Pump Required: Yes
Type of Water Supply: Community
Permit conditions: meet on site maintain ALL set BACK, MUST BRING IN 8 TO 12" APPROVED COVER

Authorized State Agent: J. C. ... Date: 06-02-08
SEE ATTACHED SITE SKETCH
The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: Cumberland Homes
PROPERTY LOCATION: 1210
SUBDIVISION: Persimmon H.II
LOT # 8
Facility Type: SFD-57x42-3BR
Basement? No
Type of Wastewater System: ultra shallow 25% Red. SYSTEM
(Initial) Wastewater Flow: 360 GPD

Installation Requirements/Conditions
Septic Tank Size: 1000 gallons
Pump Tank Size: 1000 gallons
Number of trenches: 1
Exact length of each trench: 410 feet
Trench Spacing: 9 Feet on Center
Soil Cover: 6 inches
Maximum Trench Depth: 12 MAX inches
Pump Requirements: ft. TDH vs. GPM
Aggregate Depth: inches below pipe, inches above pipe, inches total

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.

Owner/Legal Representative Signature: Date:

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH

Authorized State Agent: J. C. ... Date: 06-02-08
Construction Authorization Expiration Date: 06-02-2013

HTE# 08500-20079


Permit # ~~24798~~ 24798

Harnett County Department of Public Health Site Sketch

ISSUED TO: Cumberland And Home PROPERTY LOCATOR: 1210
SUBDIVISION: Persimmon Hill LOT # 8

Authorized State Agent: J. L. M. Date: 06 02 08

Hoover Rd SR 1210
154

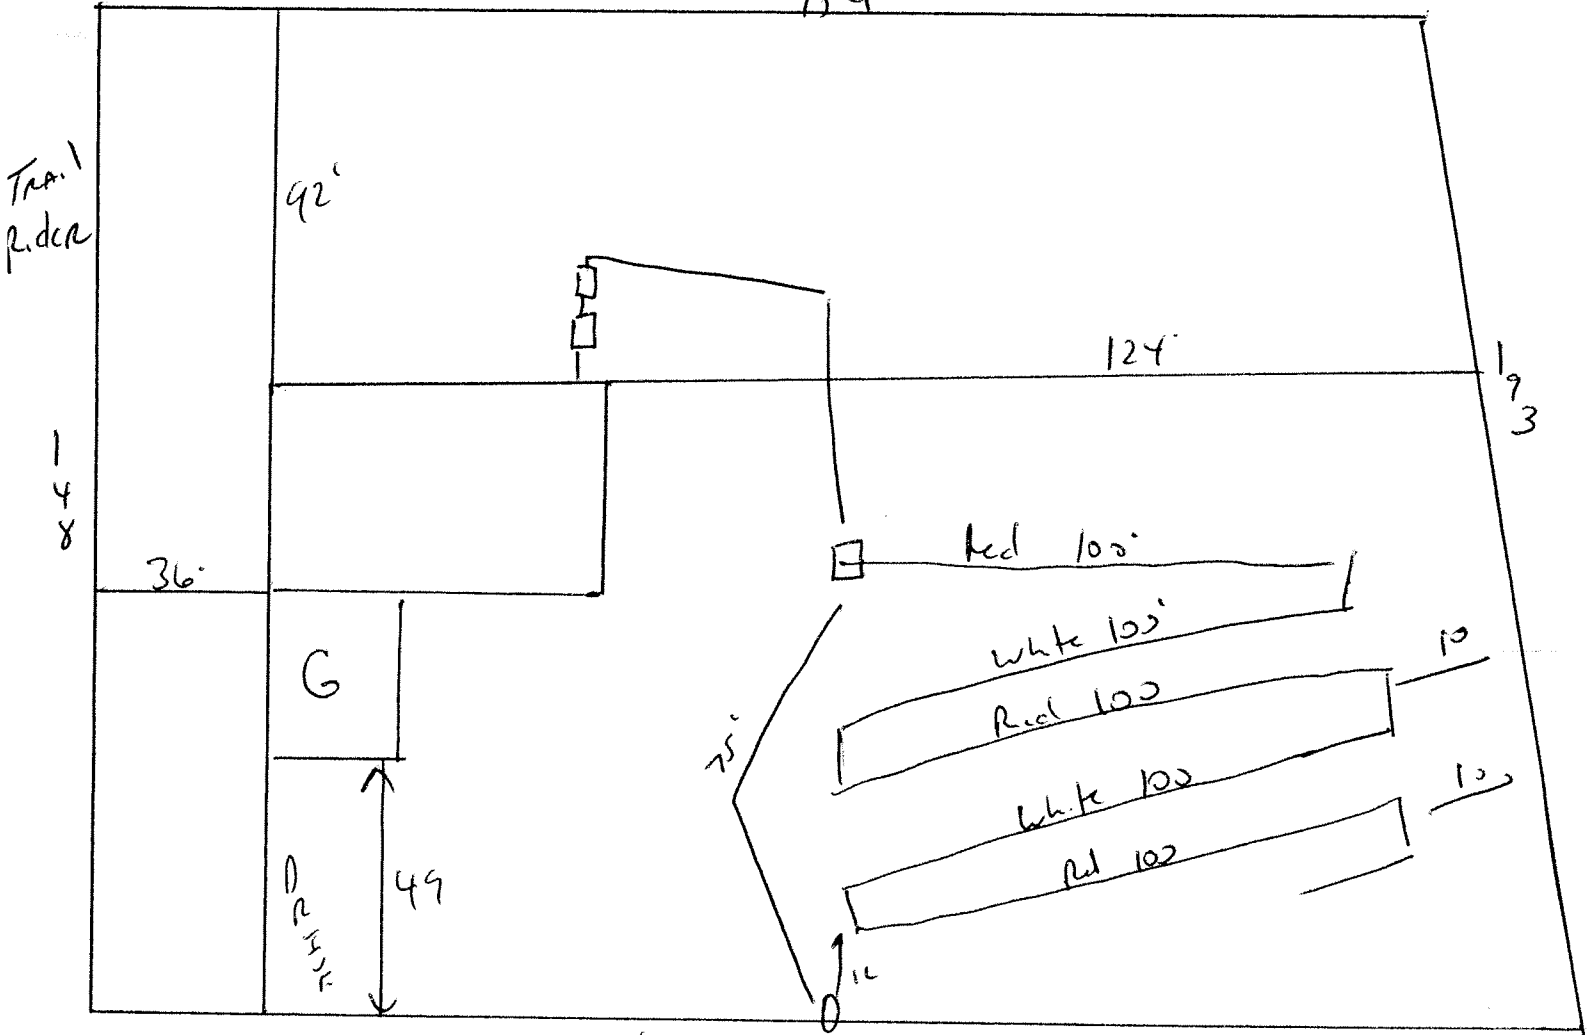

Old Field Loop H102 206

STUB OUT Plumbing shallow AT ground level or higher where shown
MAINTAIN ALL SET BACKS Meet on site - MAY NOT REQUIRED PERM.

INSTALL @ 40' of 25% Reduction system AT 12"
Being in 8 to 12" of approved cover