

HTE# 0850020079

Harnett County Department of Public Health

20381

PERMIT # 24798

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: 1210

Name: (owner) Cumberland Haver SUBDIVISION Per-Simmon Hill LOT # 8

System Installer: Ted Brown Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Septic Tank 4 410 Types V and VI Systems expire in 5 years.


(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

SR 1210

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

RECORD

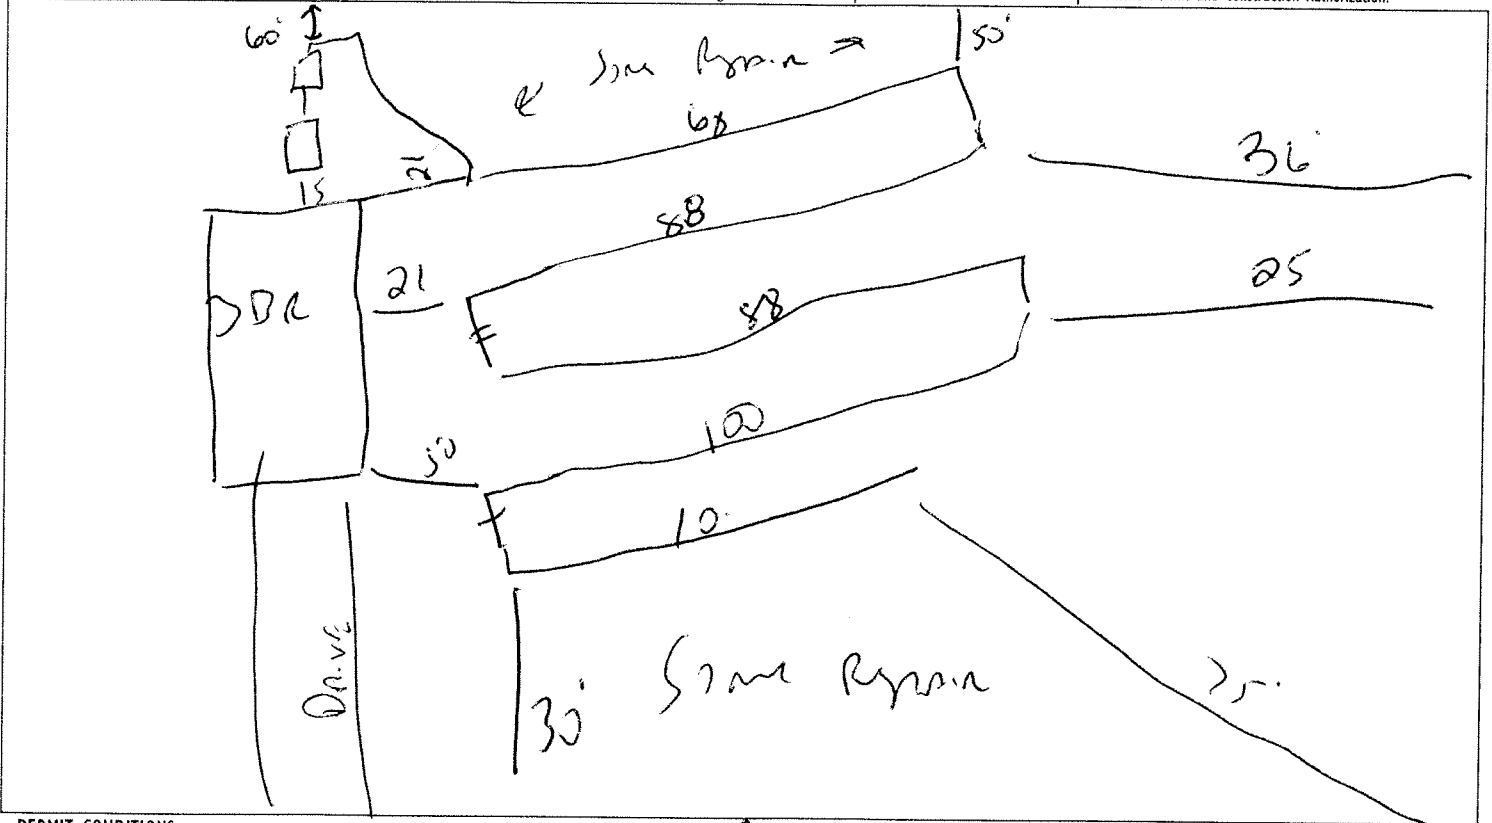

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961. old field loop
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Drain 4 Septic Tank: 1000 gallons Pump Tank: 1000 gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches _____ of each ditch 410 feet ditches 3 feet ditches 12 inches
 French Drain Required: _____ Linear feet

Authorized State Agent J. W. [Signature] Date 10-13-08