

HTE# 08-5-20426

Hart County Department of Public Health

20217

PERMIT # 24931


Operation Permit

☒ New Installation ☒ Septic Tank ☐ Repair ☒ Nitrification Line ☐ ExpansionPROPERTY LOCATION: TITAN ROBERTS RDName: (owner) MGM BUILDERS LLC SUBDIVISION _____ LOT # 2System Installer: CARDINEZ CONSTRUCTION Registration # _____Basement with plumbing: ☐ Garage ☒ Number of Bedrooms 3Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well 100 feetSystem Type: IIb Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

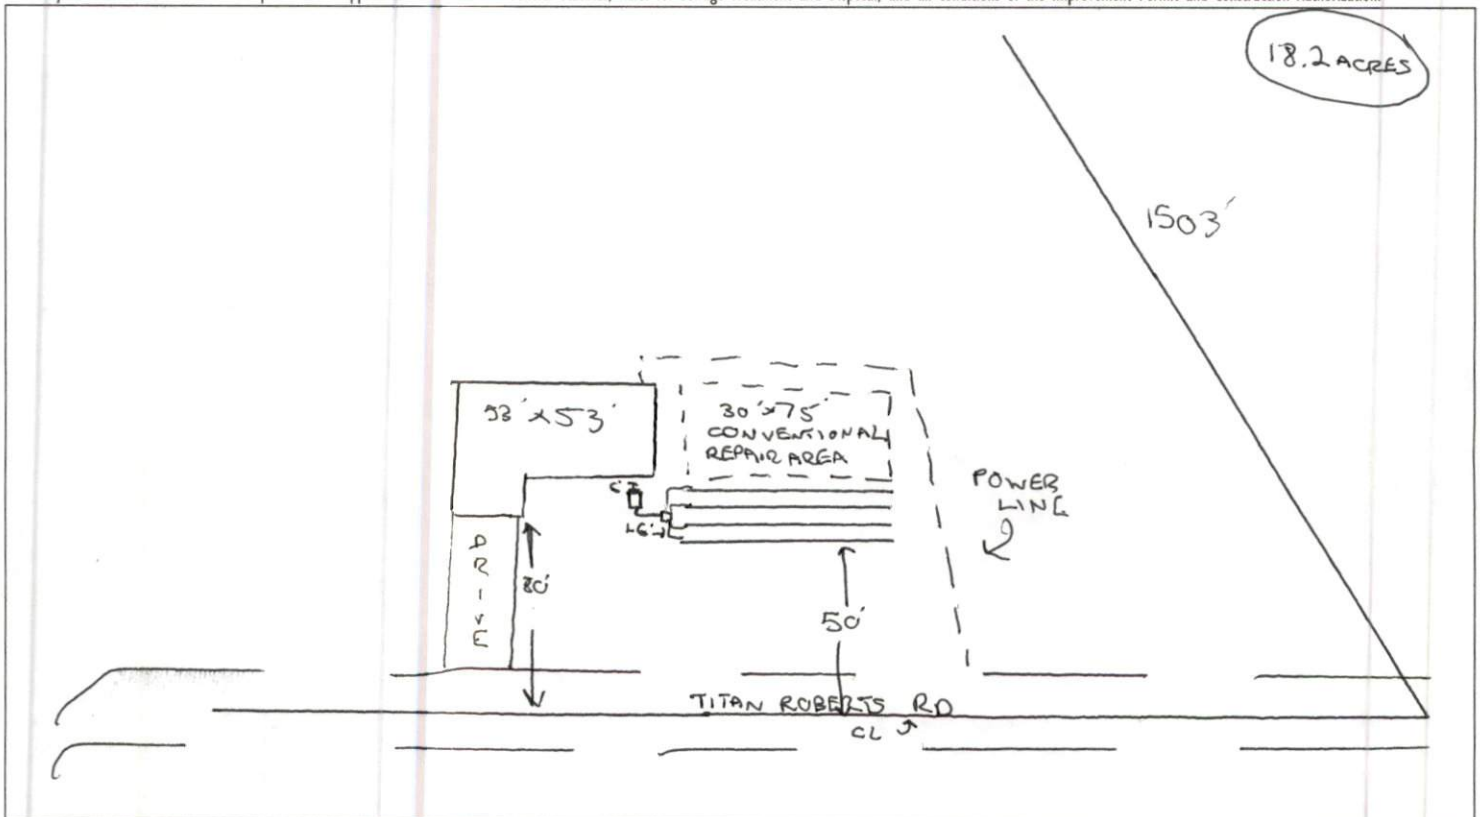

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes ☐ No ☒
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☒ Conventional ☐ Other _____ Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of _____ exact length _____ width of _____ depth of _____

Drainage Field ditches 4 of each ditch 75 feet ditches 3 feet ditches 24-28 inches

French Drain Required: _____ Linear feet _____

Authorized State Agent _____

Date 8/29/08