

HTE# 08-5-20834

Harnett County Department of Public Health

20430

PERMIT # 24840

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: SR 1551 County Line RD

Name: (owner) Brian Johnson Builders

SUBDIVISION William R Lee Tr

LOT # 2

System Installer: Glen Carroll

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: 25% REDUCTION System Type III G ELM Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

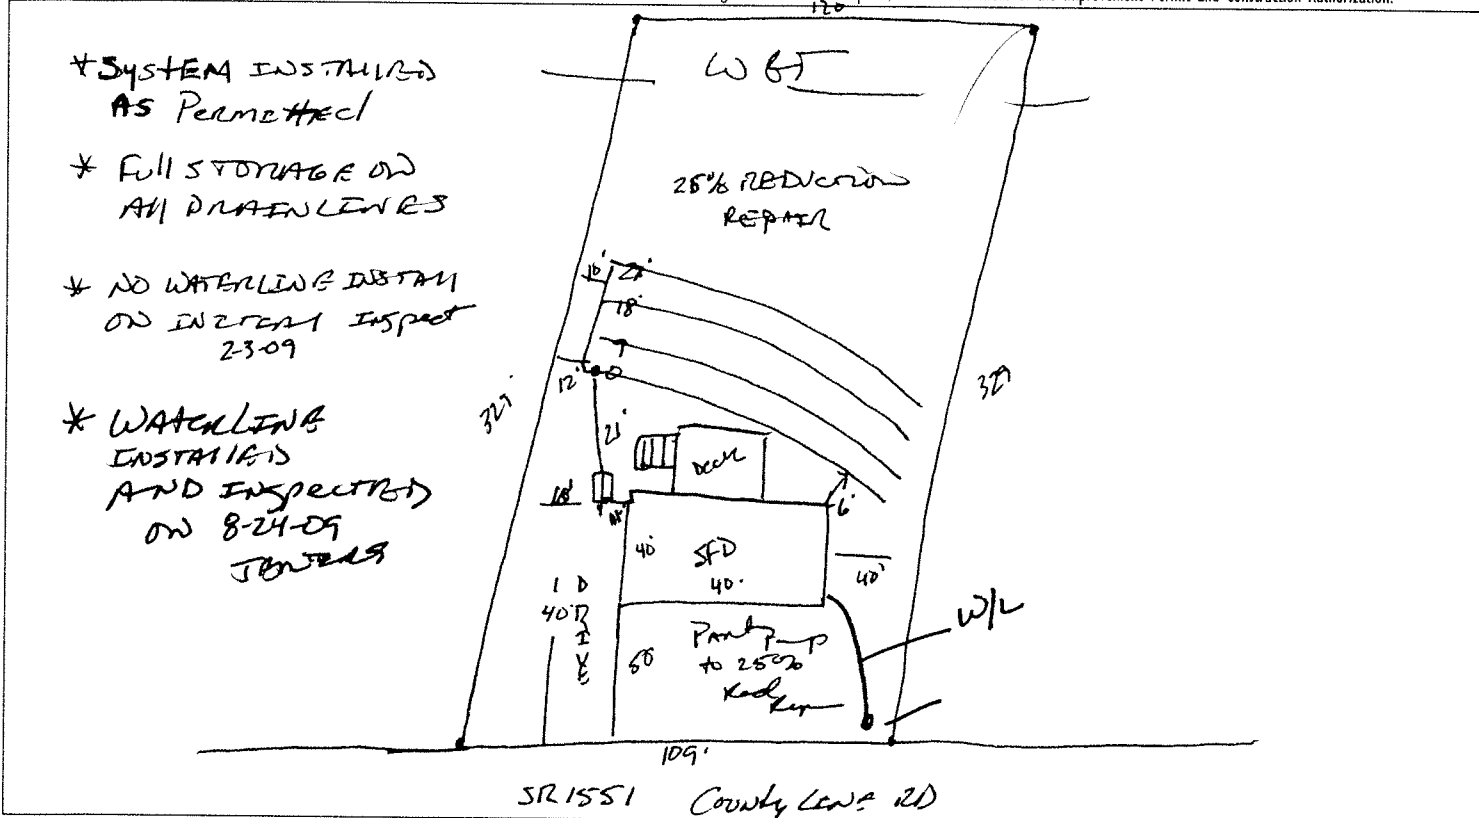

- * SYSTEM INSTALLED AS PERMITTED
- * FULL STORAGE ON ALL DRAIN LINES
- * NO WATERLINE INSTALLED ON INCREASING INSPECT 2-3-09
- * WATERLINE INSTALLED AND INSPECTED ON 8-24-09 JOWERS

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% REDUCTION SYSTEM Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 75 feet width of ditches 3 feet depth of ditches 24-18 inches

French Drain Required: _____ Linear feet

Authorized State Agent James E. Mankin Date 8-25-09