

HTE# 08-500-21028

# Harrold County Department of Public Health

21182

PERMIT # 25082

## Operation Permit

New Installation  Septic Tank  Repair  Nitrification Line  Expansion

PROPERTY LOCATION: NC 27

Name (owner) Wynn Const. SUBDIVISION Tinyon Pointe LOT # 46

System Installer: R Batten Registration # \_\_\_\_\_


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public  Well Distance from well 100 feet

System Type: Pumps Quick 4 Chambers Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

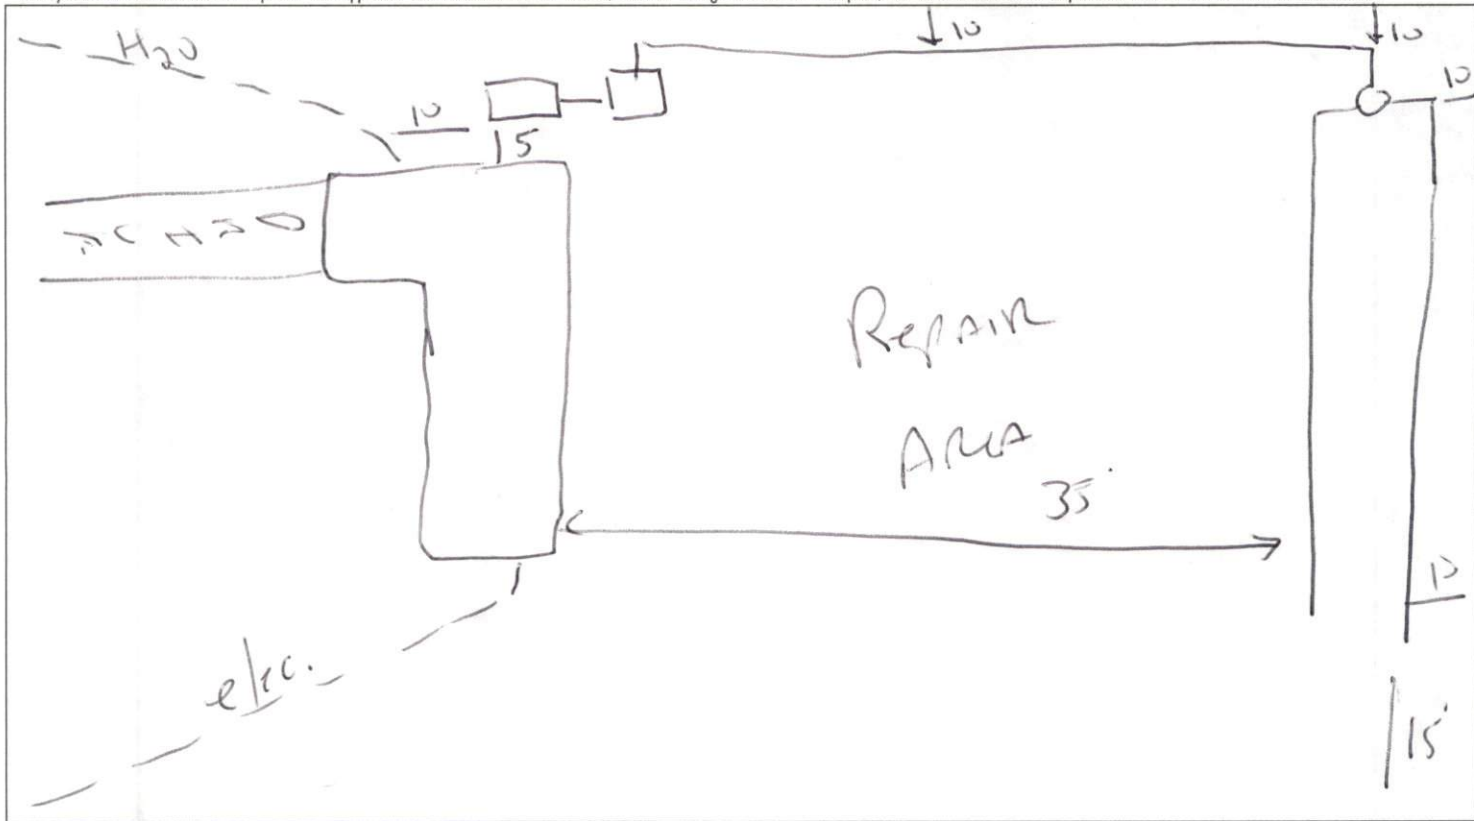

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: Line Tanks, Water Line & Power Line OK 2-19-2010 J. WEST REHS  
Needs Pump & Alarm check
- V. Other: \_\_\_\_\_

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other Pumps Quick 4 Chambers Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface No. of 2 exact length 76 feet width of 3 feet depth of 18-24 inches

Drainage Field ditches \_\_\_\_\_ of each ditch \_\_\_\_\_ feet ditches \_\_\_\_\_ feet ditches \_\_\_\_\_ inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent J. West REHS Date 3-10-10