

HTE# 08-500-21037

Harnett County Department of Public Health

21379

PERMIT # 25076

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: Ne 27

Name: (owner) Wynn Const

SUBDIVISION Tingen Pointe

LOT # 68

System Installer: Thornton

Registration #

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well 100 feet


System Type: Pump to E-2 Flow

Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

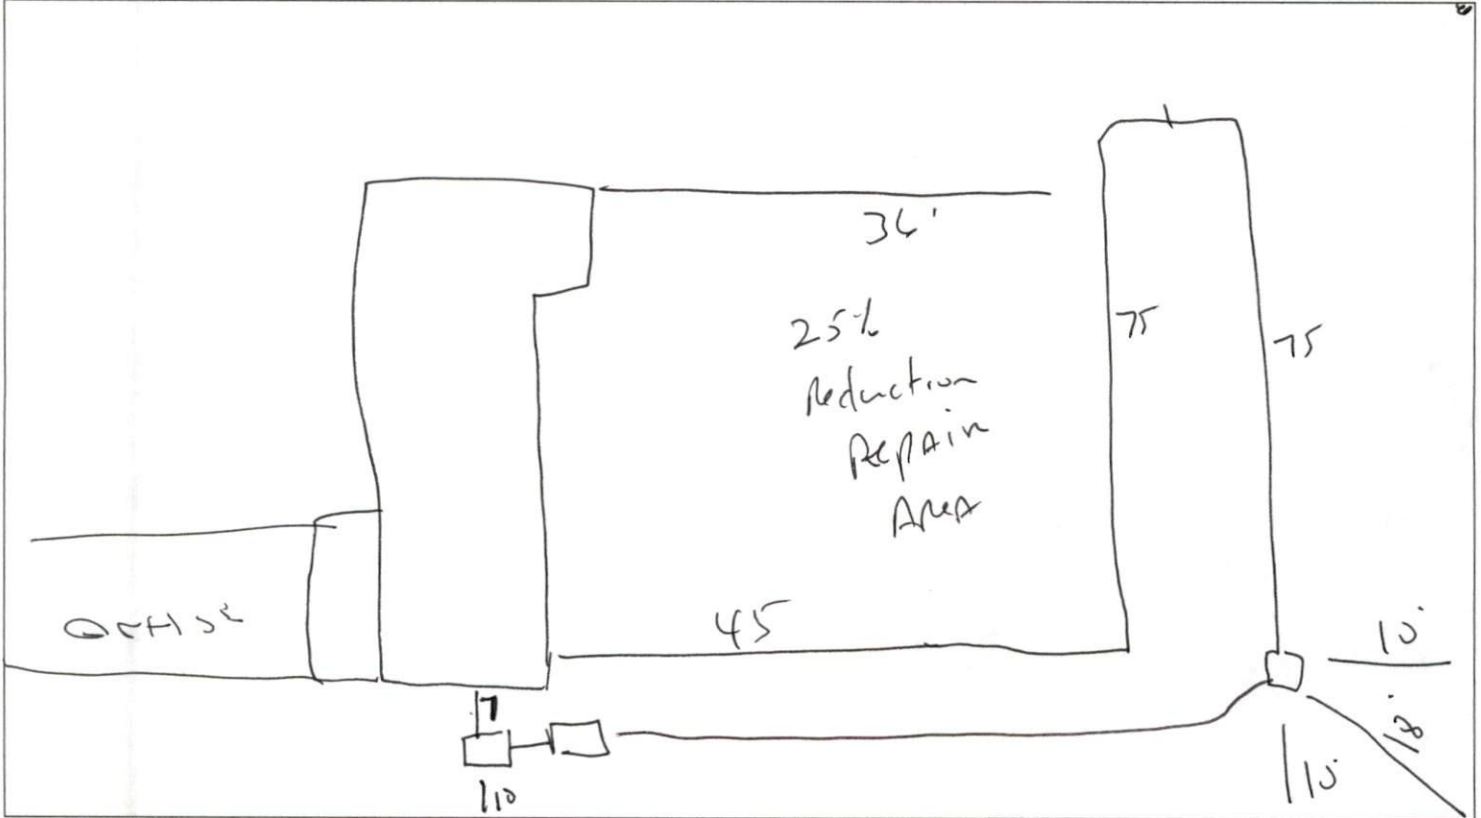

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

Pump, Alarm, Pongel, + WATER CHECKS ON 6/24/10 OK

Needs pump & Alarm check
Needs elect. & H₂O line checks

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump To E-2 Flow Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 1 exact length of each ditch 150 feet width of ditches 3 feet depth of ditches 18.24 inches

French Drain Required: _____ Linear feet

Authorized State Agent _____

REHS

Date 6/14/10