

HTE# 08-500-21301

Ha tt County Department of Publ ealth

20575

PERMIT # 25212

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: Holly Springs Ch Road

Name: (owner) Jerry Parsons

SUBDIVISION _____

LOT # _____

System Installer: D. Strickland

Registration # _____

1201A c

Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: E-2 Flow 148 Types V and VI Systems expire in 5 years.


(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

← To se

~~100~~ Road

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

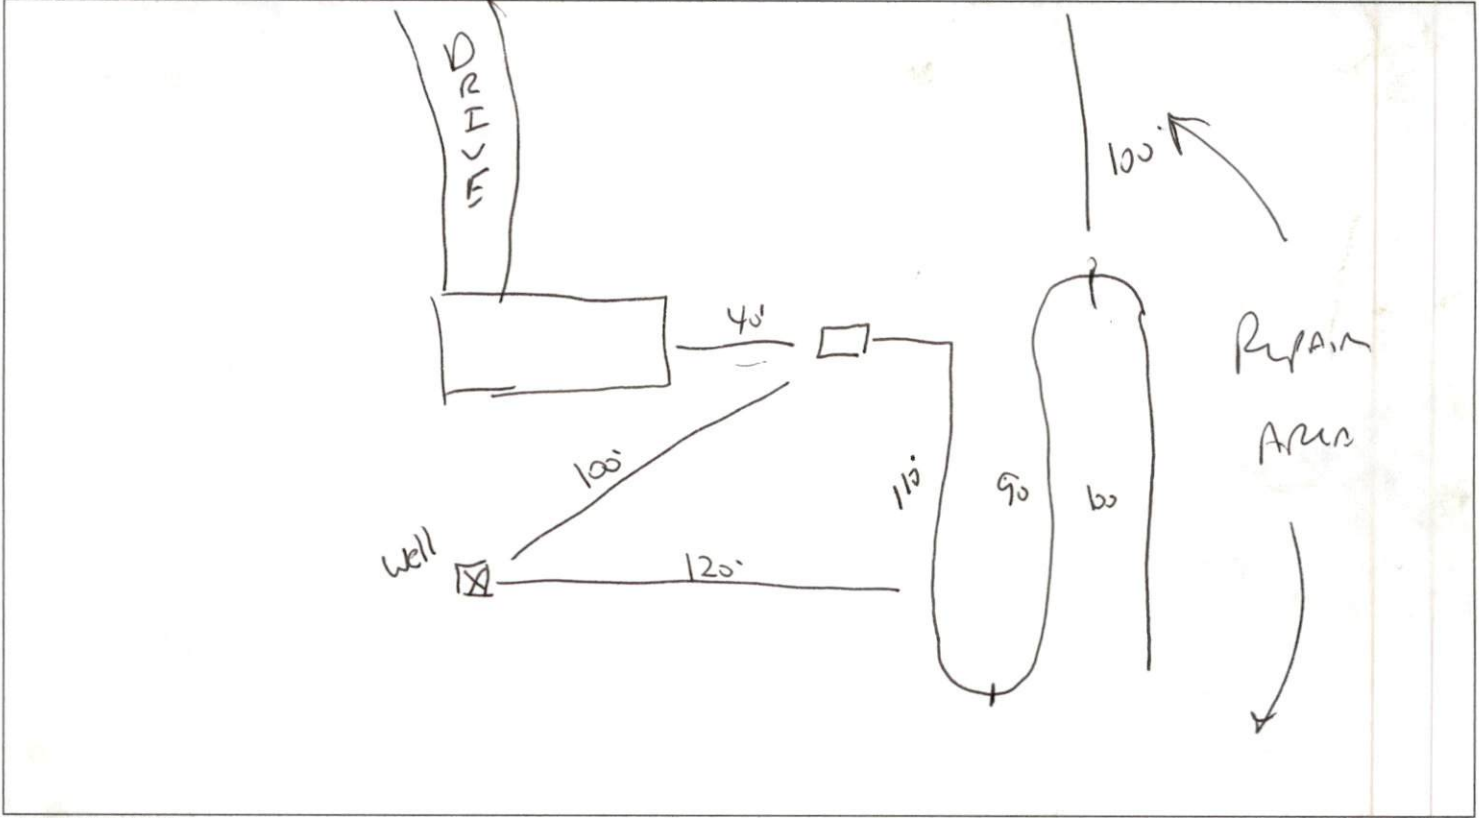

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other E-2 Flow Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 1 of each ditch 300 feet ditches 2 feet ditches 18-24 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 02-23-09