

HTE# 09-5-22087

Harnett County Department of Public Health

21133

PERMIT # 25253

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: 27 West

Name: (owner) Cumberland Homes

SUBDIVISION Laurel Valley

LOT # 69

System Installer: Ted Brown

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: T/B Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

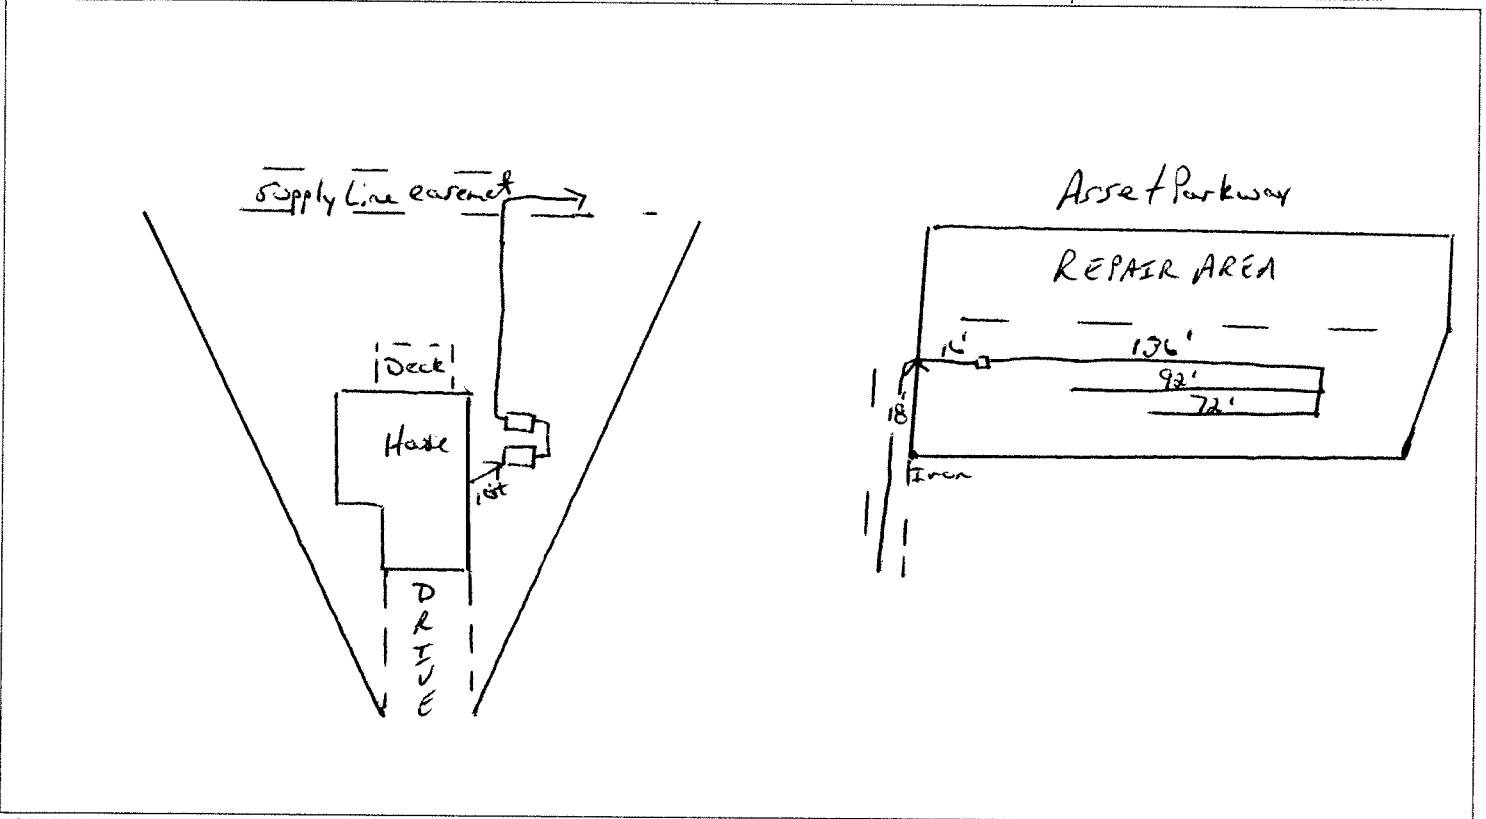

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

BM BM * Needs pump, alarm D-Box checked
TANKS & Filter OK 10/8/09 Lines OK 11/4/09 water + power line verified
CHUCKSO OR

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump to Quick 4 Chamber Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 1 exact length of each ditch 300 feet width of ditches 3 feet depth of ditches 18 inches

French Drain Required: _____ Linear feet

Authorized State Agent

REHS

Date 11/5/01