

HTE# 09-5-22089

# Harnett County Department of Public Health

21125

PERMIT # 25285

## Operation Permit

New Installation  Septic Tank  Repair  Nitrification Line  Expansion

PROPERTY LOCATION: 27 west

Name: (owner) Cumberland Homes

SUBDIVISION Laurel Valley

LOT # 71

System Installer: Ted Brown

Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: III B Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

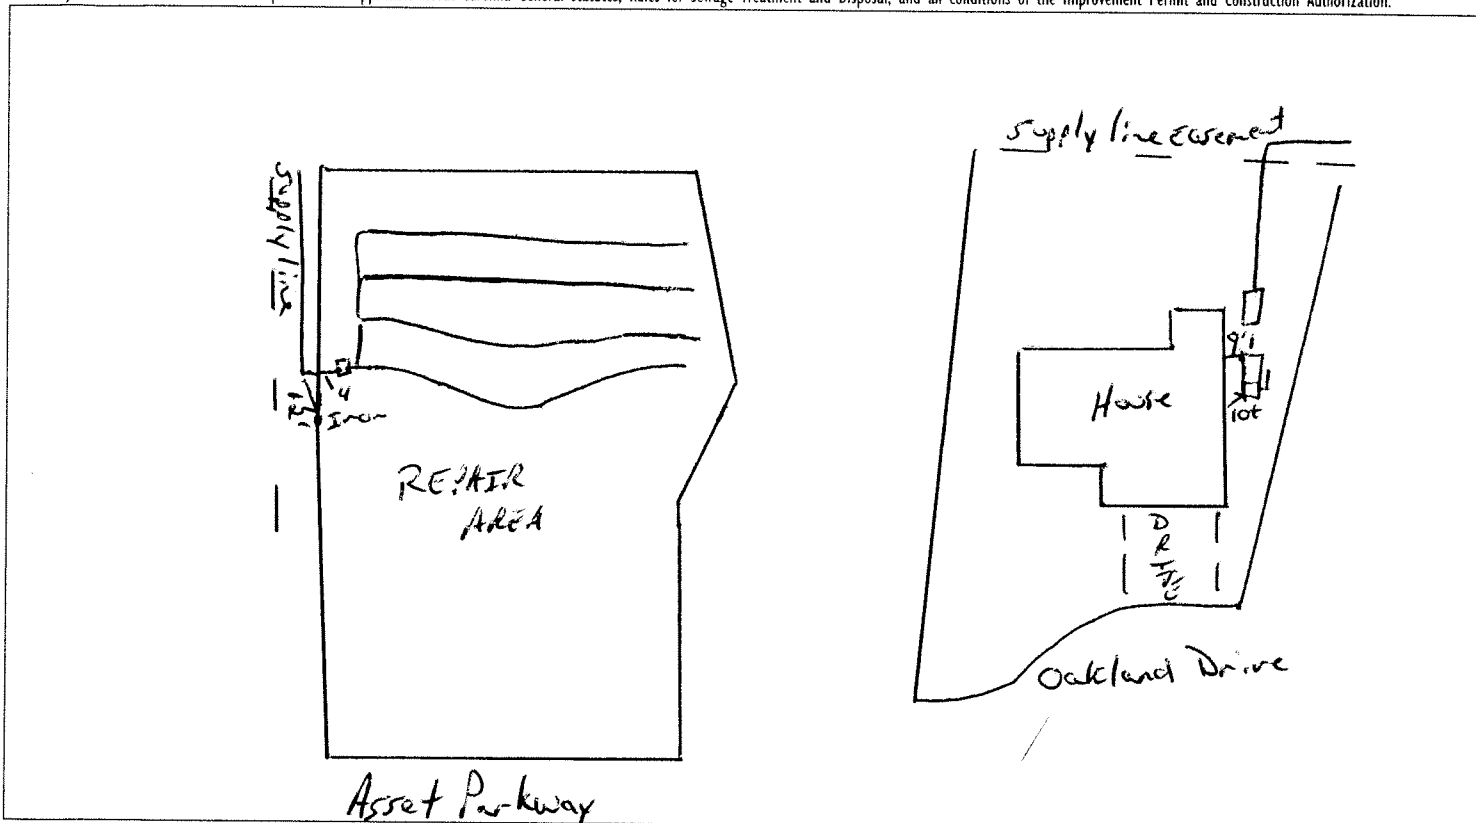

### PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes  No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

\*NEEDS pump alarm, Filter, water & power  
\*TANK & lines OK 11/2/09 lines checked checked on 11/5/09 or

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other Pumps Quick 4 Chamber Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface No. of exact length width of depth of  
Drainage Field ditches 1 of each ditch 300 feet ditches 3 feet ditches 20 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent \_\_\_\_\_

REMS

Date 11/5/09