

HTE# 09-522397

Hait County Department of Public Health

20818

PERMIT # 25555

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: NURSERY RD

Name: (owner) KENNETH CUMMINGS SUBDIVISION WOODSHIRE LOT # 192

System Installer: OTIS STACKLAND Registration # _____


Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: III g Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

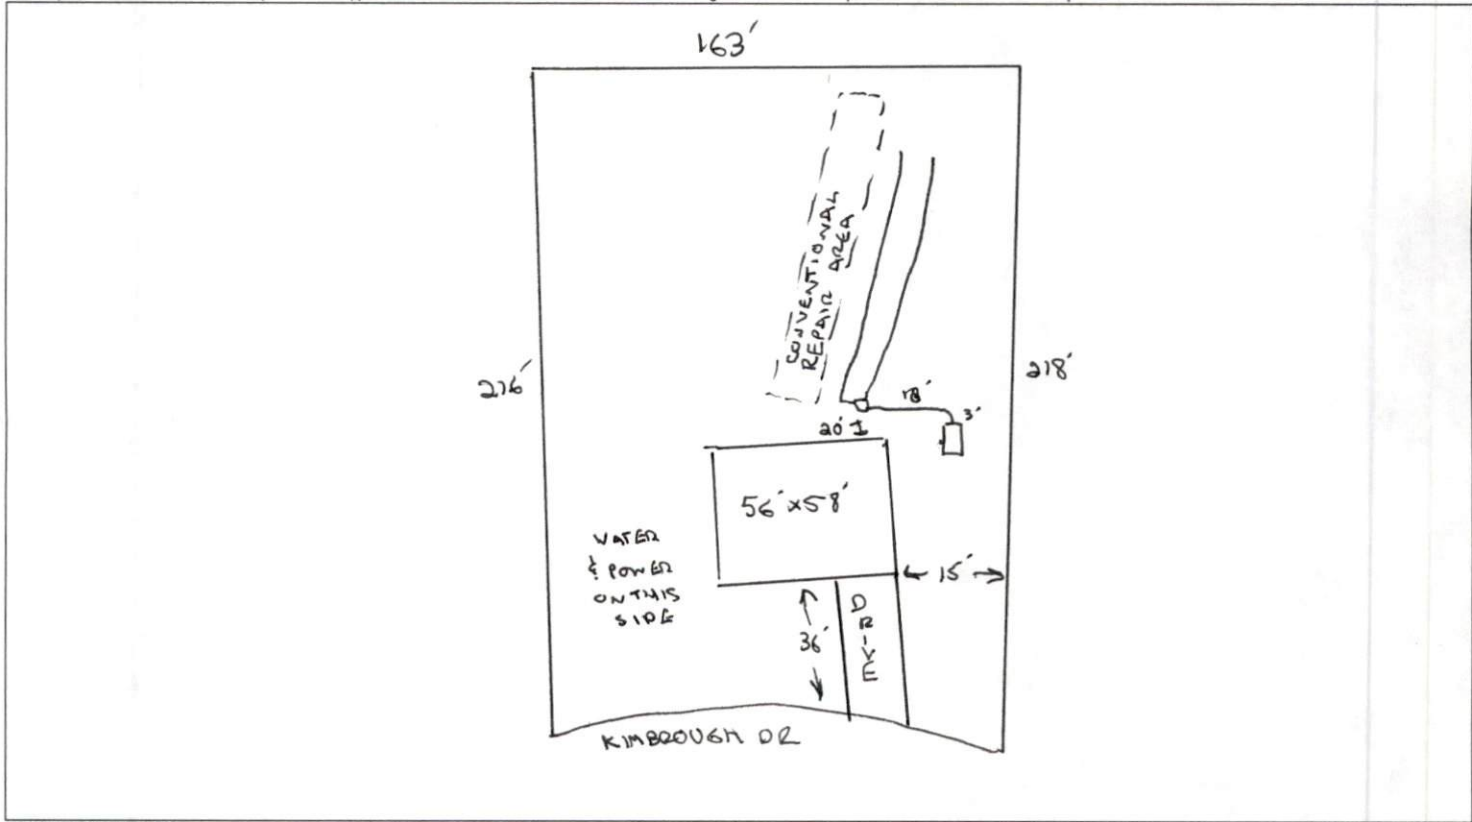

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____

V. Other: SYSTEM CHECKED BY OT. WATER & POWER LINE STILL TO BE VERIFIED. CHECKED ON 10/20/09 BY OT

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZ FLOW Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 2 exact length of each ditch 80 feet width of ditches 3 feet depth of ditches 24-30 inches

French Drain Required: _____ Linear feet

Authorized State Agent REMS Date 10/20/09