

HTE# 09-5-22422R

Harnett County Department of Public Health

21098

PERMIT # 25690

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: THORNTONS CREEK DR

Name: (owner) BIM BUILDERS SUBDIVISION THORNTONS CREEK PH. II LOT # 13

System Installer: KENNETH WEEKS Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

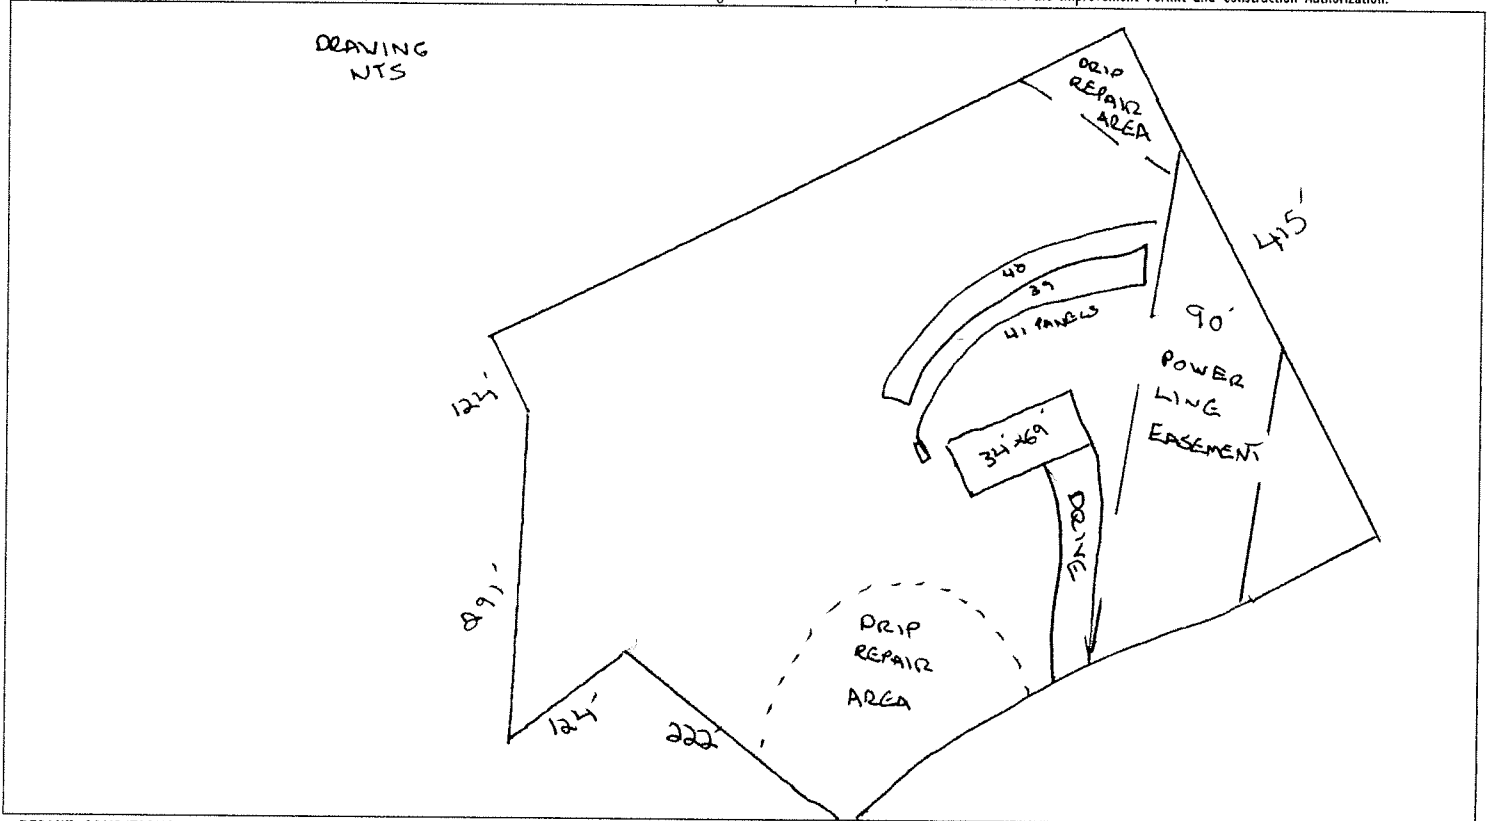

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: COVER CHECKED UPON INSTALLATION

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 2' INFILTRATOR CHAMBER Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of Septic Tank: _____ gallons

Drainage Field ditches 1 of each ditch 480 feet ditches 3 ^{0UG} depth of ditches 12 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] REJS Date 11/10/09