

HTE# 09-500-22774

Harnett County Department of Public Health

25513

Improvement Permit

A building permit cannot be issued with only an Improvement Permit

ISSUED TO: BARRY PATTERSON PROPERTY LOCATION: SR 1272 - LAWRENCE RD
 NEW ☒ REPAIR ☐ EXPANSION ☐ SUBDIVISION _____ LOT # 1
 Type of Structure: 60x45-3BR SFD Site Improvements required prior to Construction Authorization Issuance: 1.29 ac
 Proposed Wastewater System Type: Pump to 25% Reduction Sys.
 Projected Daily Flow: 360 GPD
 Number of bedrooms: 3 Number of Occupants: 6 max
 Basement ☐ Yes ☒ No
 Pump Required: ☒ Yes ☐ No ☐ May be required based on final location and elevations of facilities
 Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well 100' feet Permit valid for: ☒ Five years
 Permit conditions: Meet onsite for Final Layout maintain all set back ☐ No expiration
NOTE All underground utilities must be 10' from any part of septic system
Keep system 15' from Ditch

Authorized State Agent: Jim WicksDate: 09-16-09

SEE ATTACHED SITE SKETCH

The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: BARRY PATTERSON PROPERTY LOCATION: 1272
 SUBDIVISION _____ LOT # 1
 Facility Type: SFD-60x45-3BR ☒ New ☐ Expansion ☐ Repair
 Basement? ☐ Yes ☒ No Basement Fixtures? ☐ Yes ☒ No
 Type of Wastewater System** Pump to 25% Reduction system (Initial) Wastewater Flow: 360 GPD
 (See note below, if applicable) ☒ 25% Reduction system (Repair)
 Installation Requirements/Conditions
 Septic Tank Size 1000 gallons Number of trenches 1
 Pump Tank Size 1000 gallons Exact length of each trench 180 feet
 Trench Spacing: 9 Feet on Center
 Trenches shall be installed on contour at a
 Maximum Trench Depth of: 18-24 inches
 (Trench bottoms shall be level to $\pm 1/4"$ in all directions)
 Soil Cover: 6 inches
 (Maximum soil cover shall not exceed 36" above the trench bottom)
 Pump Requirements: _____ ft. TDH vs. _____ GPM
 Aggregate Depth: _____ inches below pipe
 _____ inches above pipe
 _____ inches total
 Conditions: _____

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.

Owner/Legal Representative Signature: _____ Date: _____

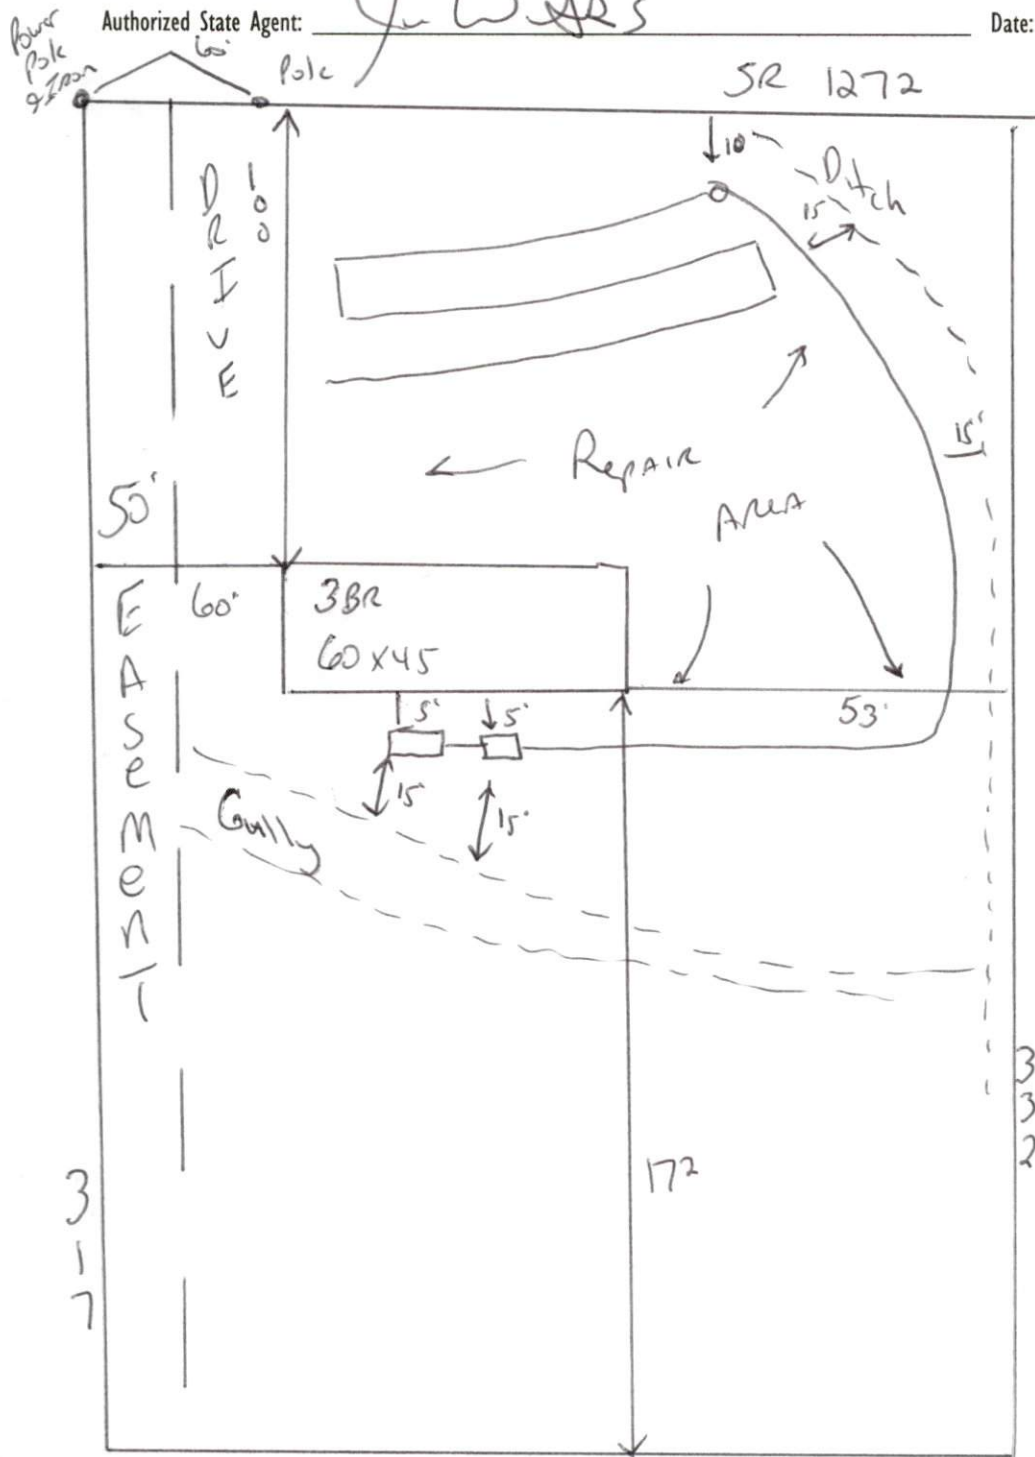
This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.

SEE ATTACHED SITE SKETCH

Authorized State Agent: Jim Wicks Date: 09-16-09
 Construction Authorization Expiration Date: 09-16-2014

HTE# 09-500-22774Permit # 25513

Harnett County Department of Public Health Site Sketch

ISSUED TO: Barry PattersonPROPERTY LOCATOR: 1272SUBDIVISION LOT # 11.29acAuthorized State Agent: J. W. H. S.Date: 9-16-09

Please note that
All utilities must
enter home from the
Drive way side of the
home & stay 10' from
Any part of septic system

Meet onsite for Final
Layout

Maintain All set Backs

Install 180' of 25%
Reduction system at
18" to 24" Deep.