

HTE# 09-5-23211

Harnett County Department of Public Health

PERMIT # 25801

Operation Permit

21644

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: Old Boies Creek Rd

Name: (owner) Bobby Joe Long SUBDIVISION _____ LOT # _____

System Installer: Gerald Temple Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: II b Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

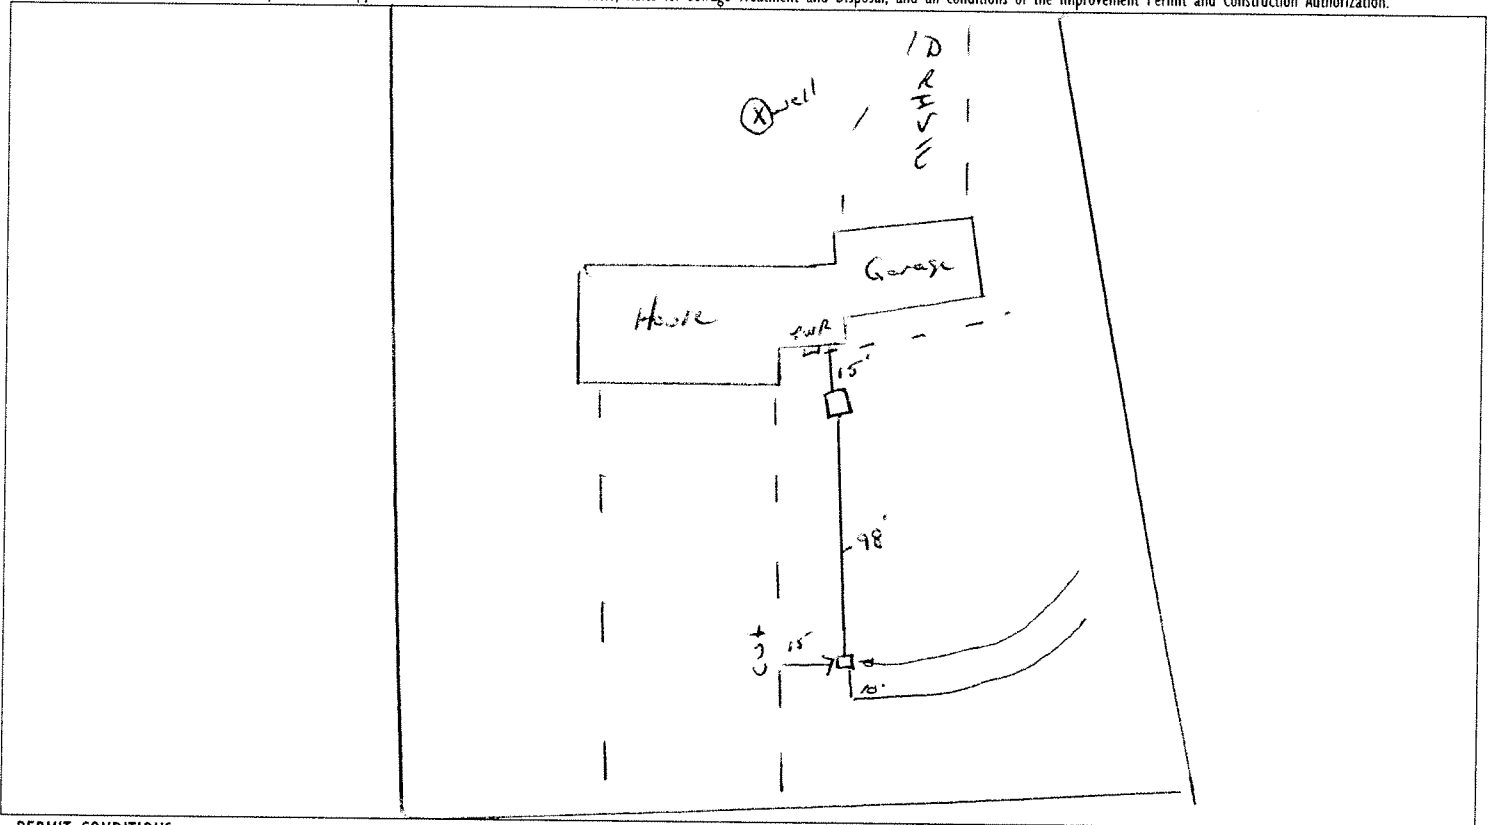

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: 9/29/2010 Ban

V. Other: * Tank, filter & supply line

D-Box Pump Alarm 9/29/10 Ban H2O Line 9/29/10 Ban PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other _____ Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 2 of each ditch 100 feet ditches 3 feet ditches 24 inches

French Drain Required: _____ Linear feet

Authorized State Agent James E. Manhart Date 10-8-10