

HTE# 09-5-23319

Harnett County Department of Public Health

21446

PERMIT # 25852

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: PONDEROSA RD

Name: (owner) LDS HOMES LLC

SUBDIVISION CAROLINA SEASONS

LOT # 91

System Installer: TEO BROWN

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: III Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

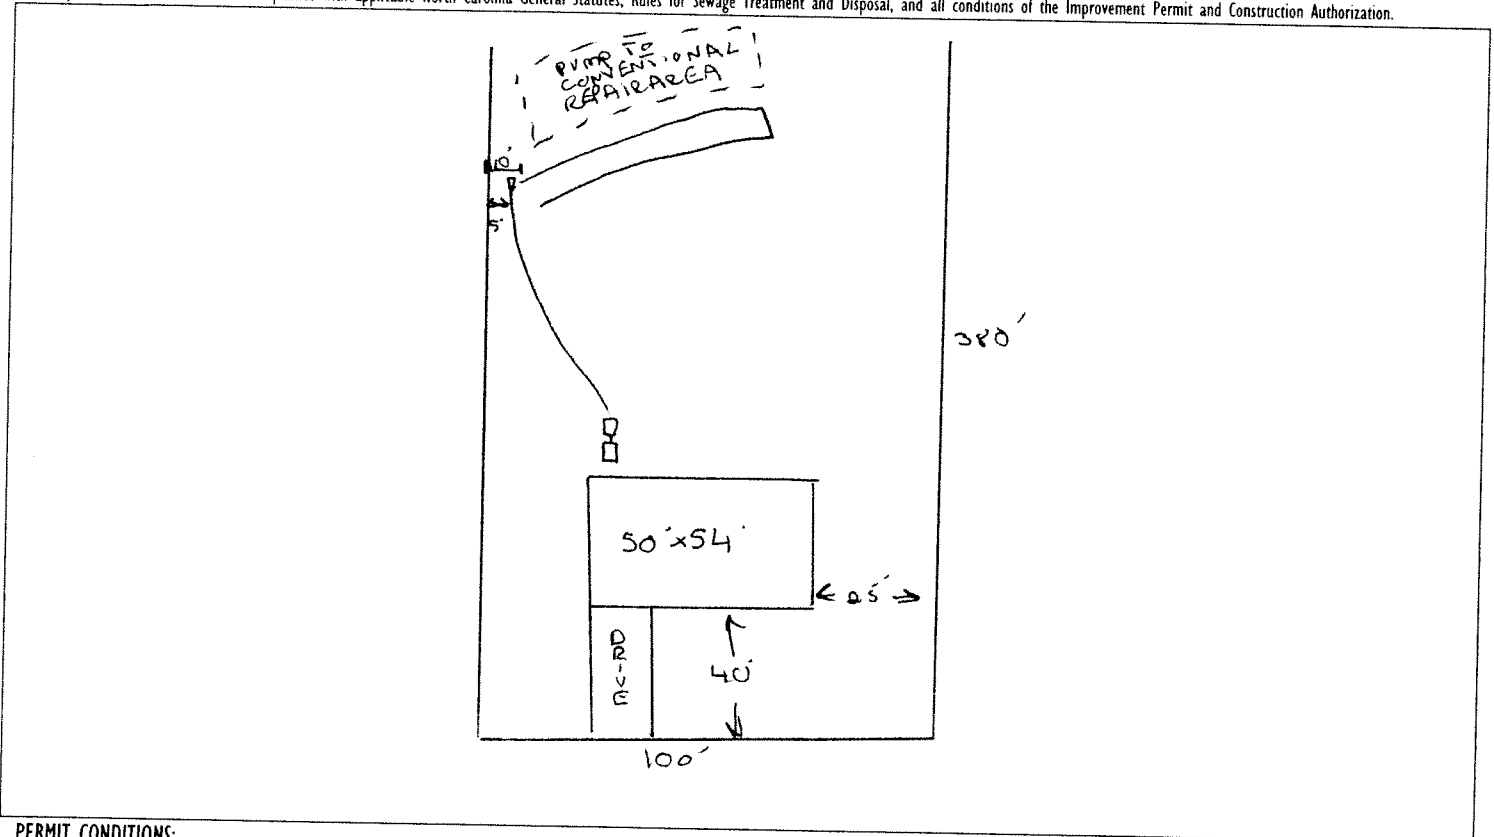

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: Pump & Alarm Still To Be Checked, checked 5/26/10 OK

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump To Chamber (Quick) Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field: No. of ditches 2 exact length of each ditch 60 feet width of ditches 3 feet depth of ditches 24 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] EGHS Date 5/26/10