

HTE# 04-5-23347LR

Harnett County Department of Public Health

21311

PERMIT # 26154

Operation Permit

☒ New Installation ☒ Septic Tank ☐ Repair ☒ Nitrification Line ☐ ExpansionPROPERTY LOCATION: Brinkley Rd.Name: (owner) New Horizon BuildersSUBDIVISION Herbert JohnsonLOT # ASystem Installer: Ricky Holland

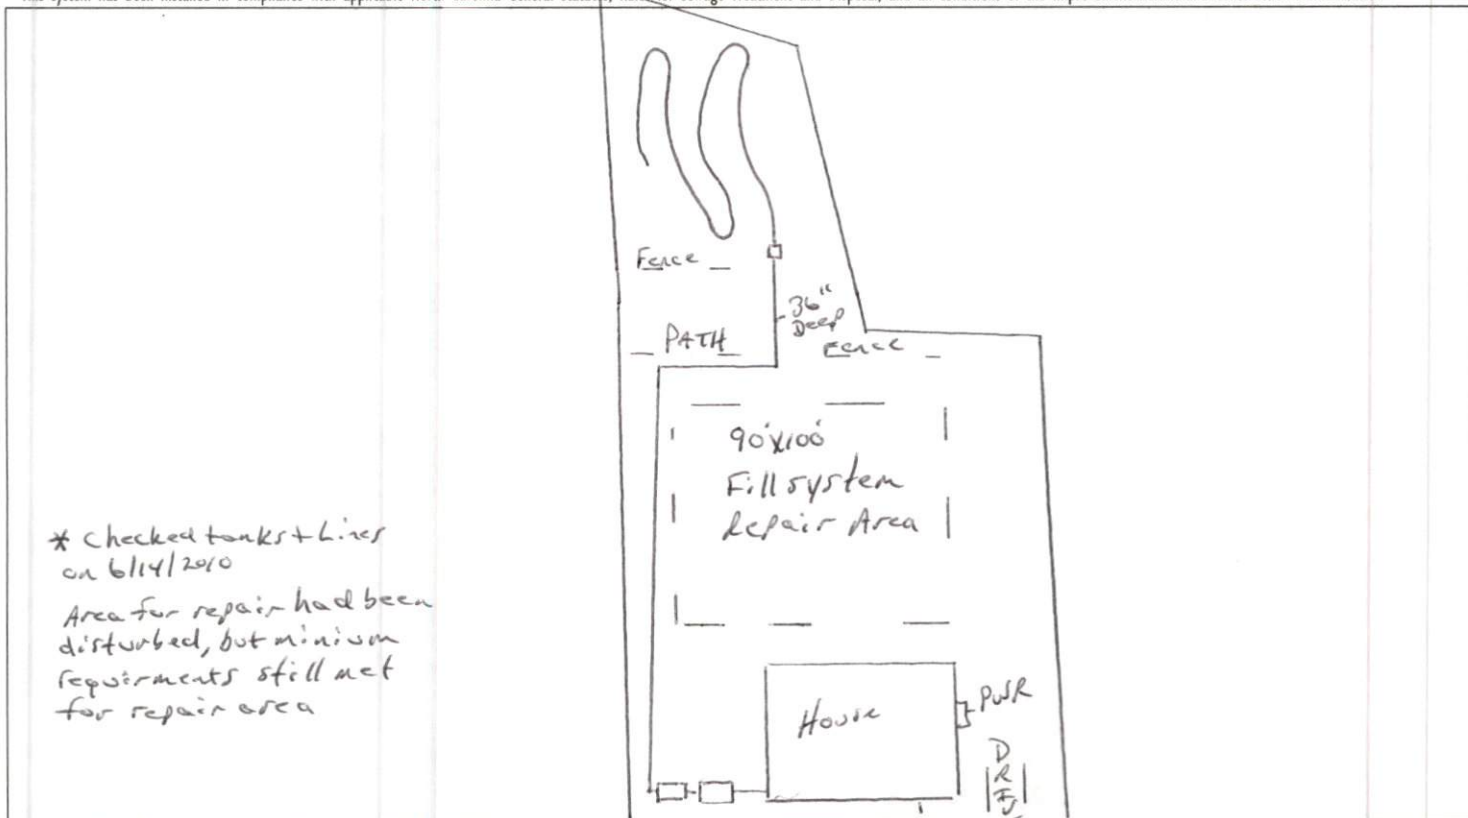
Registration # _____

Basement with plumbing: ☐ Garage ☐ Number of Bedrooms 4Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feetSystem Type: TII b Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

* Checked tanks + Lines
on 6/14/2010Area for repair had been
disturbed, but minimum
requirements still met
for repair area

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes ☐ No ☒

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other Pump to E2 FlowSeptic Tank: 1000 gallons Pump Tank: 1000 gallonsSubsurface No. of exact length
Drainage Field ditches 1 of each ditch 320 feetwidth of
ditches 3 feet depth of
ditches 18-12 inches

French Drain Required: _____ Linear feet

Authorized State Agent

Ricky Holland, REHDate 6/15/2010