

HTE# 09-5-23464

Harnett County Department of Public Health

21445

PERMIT # 25800

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: PONDEROSA RD

Name: (owner) JASON PRYKE CONSTRUCTION INC SUBDIVISION CAROLINA SEASONS LOT # 40

System Installer: LEO BROWN Registration # _____

Basement with plumbing: Garage Number of Bedrooms 5


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: IIIb Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

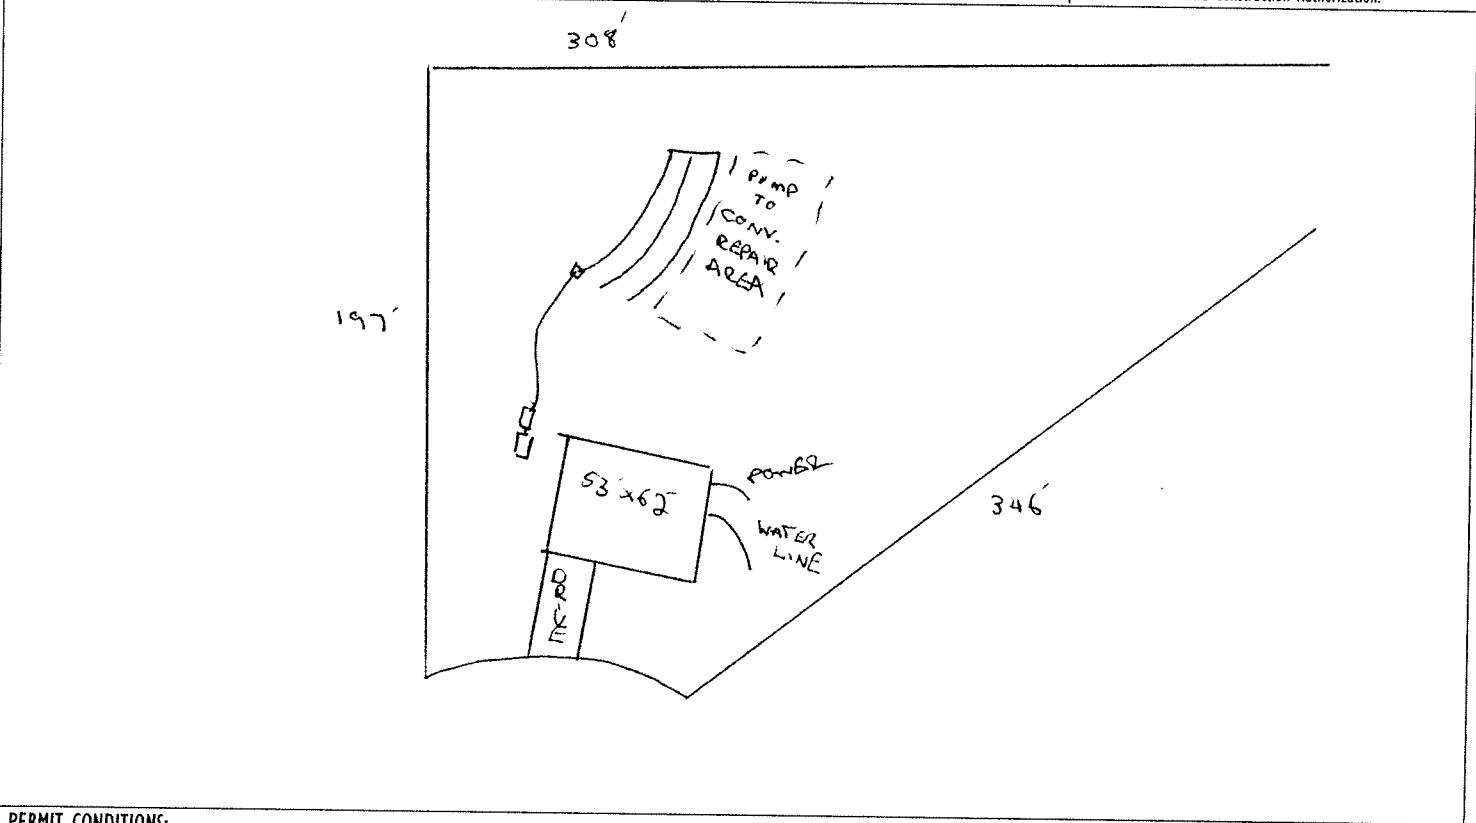

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: HOLD FOR PUMP & ALARM CHECK 5/13/10

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other PUMP TO CHAMBER (QUICKY) Septic Tank: 1250 gallons Pump Tank: 1250 gallons

Subsurface Drainage Field: No. of ditches 3 exact length of each ditch 65 feet width of ditches 3 feet depth of ditches 24 inches

French Drain Required: Linear feet

Authorized State Agent _____ Date 5/13/10