

HTE# 10-5-25527

Harnett County Department of Public Health

21493

PERMIT # 25874

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: LASATER RD

Name: (owner) KEITH BULLOCK BUILDERS INC SUBDIVISION WALNUT GROVE LOT # 22

System Installer: Jay Adcox Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: III Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

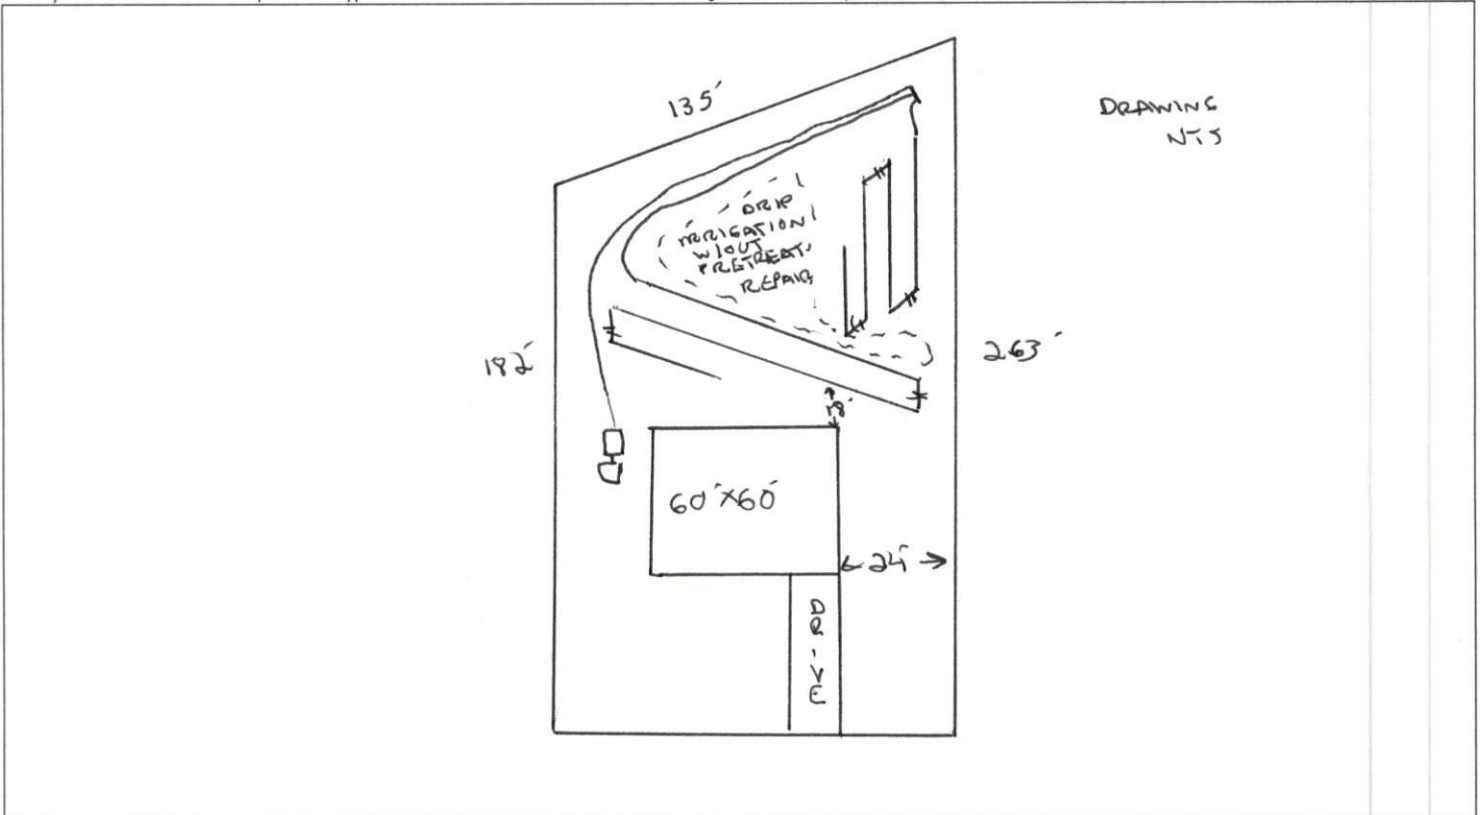

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: MANDATEE - 2 VALVES 3/4 SCH 80 1/2 SCH 40

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump To EZFLOW w/ MANDATEE Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface No. of exact length 100 width of depth of
Drainage Field ditches 2 of each ditch 210 feet ditches 3 feet ditches 12 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] REHS Date 6/24/10