

HARNETT DEPARTMENT OF PUBLIC HEALTH PERMIT
TO CONSTRUCT A DRINKING WATER SUPPLY WELL

PIN #: 0635-56-3430.000 Parcel #: 050635 0315 01 Application #: 10-5-23624 Subdivision: Benny Sears Lot #: 5

Applicant Name: Charles L. Galloway
Address: 104 Rudolph Rd. Dunn, NC 28334

Type of Facility Served by Well: SFD

Sewage System: conventional

Permit Conditions: WELL TO BE DRILLED IN AREA PERMITTED

General Permit Conditions:

- Drinking water supply well construction must meet 15A NCAC 02C.100 rules
- The permitted drinking water supply well shall be located in accordance with the **SITE PLAN**
- **ANY ALTERATION** of the site of the site (including location of structures and appurtenance) or modification in use of the well, may subject this Permit to revocation

Authorized State Agent _____ Date _____

Grouting Inspection Witnessed _____ Date _____

Grouting self-certified by driller GW-1 provided? Yes No

See attachment for construction sketch

WELL CERTIFICATE OF COMPLETION

Date: 10/4/2010 Application #: 10-5-23624 Well Contractor: Jackson Well Co.

Applicant Name: Charles Gallloway
Address: 5953 Cokesbury Rd. Duncan, NC 27526

Directions to Site: 401 to Christian Light turn R go to Cokesbury turn left go about 2-3 from Hwy 42 on left

Use of Well: sfd Date Drilled: 9/22/2010 Total Depth: 160ft Replacement Well? Yes No
Static Water Level: 20 ft Top of Casing is 12 in. above surface. Yield: 25 gpm at _____ ft.
Disinfection: Type hth Amount 16 oz

Water Zone (depth)

Casing

Grout

From 85 To 90

From 0 To 70

From 0 To 20

From 122 To 124

Diameter: 6 in Material: pvc Thickness: sr 21

Material: sand/cement Method: pour

From _____ To _____

From _____ To _____

From _____ To _____

Diameter: _____ Material: _____ Thickness: _____

Material: _____ Method: _____

From _____ To _____

From _____ To _____

Diameter: _____ Material: _____ Thickness: _____

Material: _____ Method: _____

Inspector: _____ On Hold Date: _____ Release Date: 10/6/2010

Remarks: _____

Well Head Information


Casing Height: 1 ft (above finished grade) Access Port: yes Vent Stack: yes
Well ID Tag: yes Pump ID Tag: yes Sampling Tap: yes Backflow Preventer: yes
Sample Taken? Yes No Well Head properly sealed: yes

Remarks: _____

Authorized State Agent Bryan McSwain, PE HS Date 10/6/2010

See Attachment for completion sketch

Well Construction Sketch

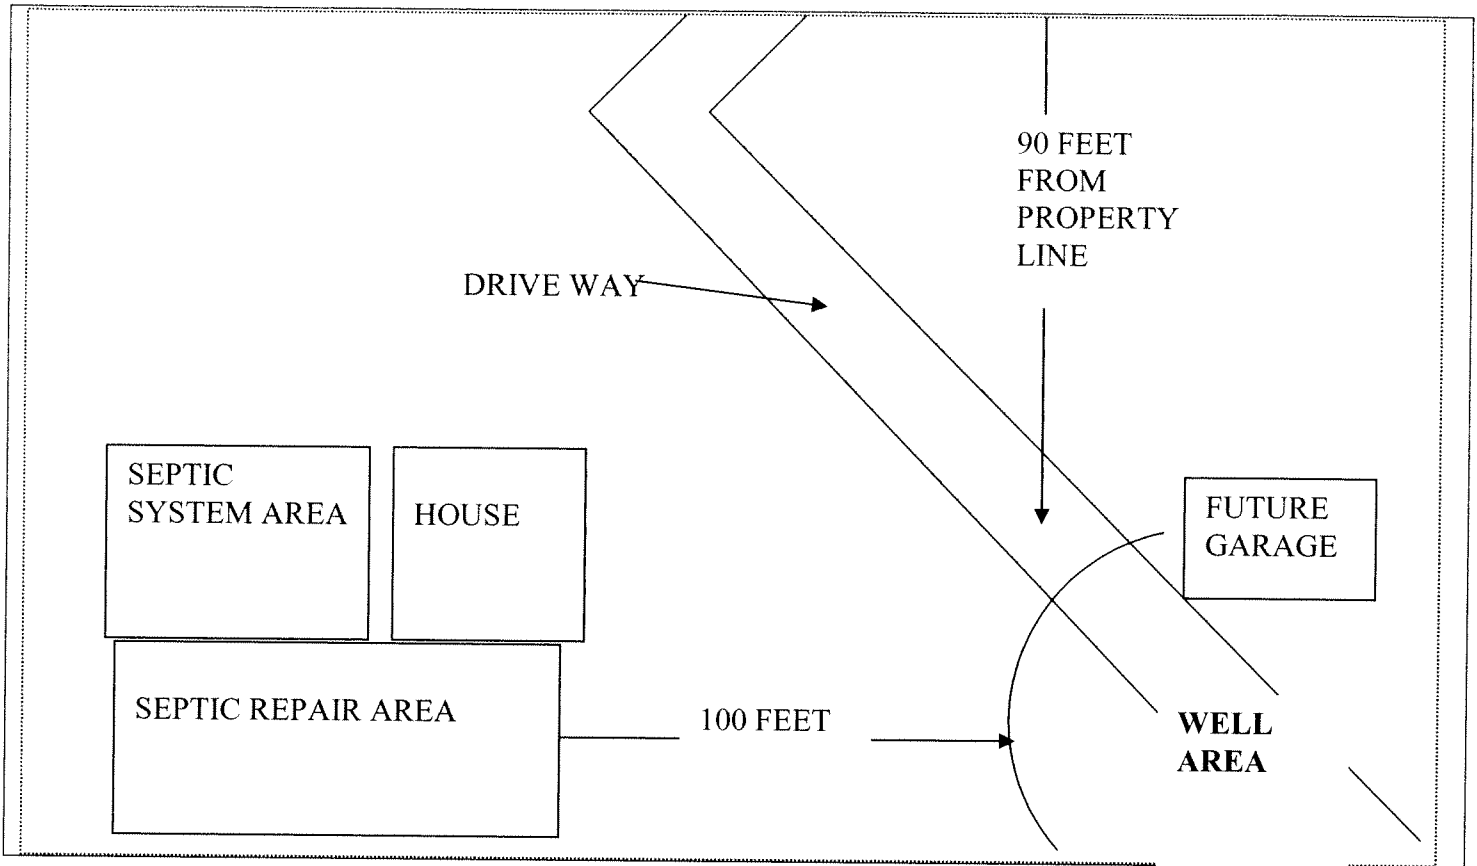

Well Completion Sketch

