

HTE# 10-5-23688

Harnett County Department of Public Health

21302

PERMIT # 25827

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: Nursery Rd.

Name: (owner) Caviness Land Development

SUBDIVISION Forest Oaks

LOT # 172

System Installer: Jay Adcock

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 4


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: III G Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

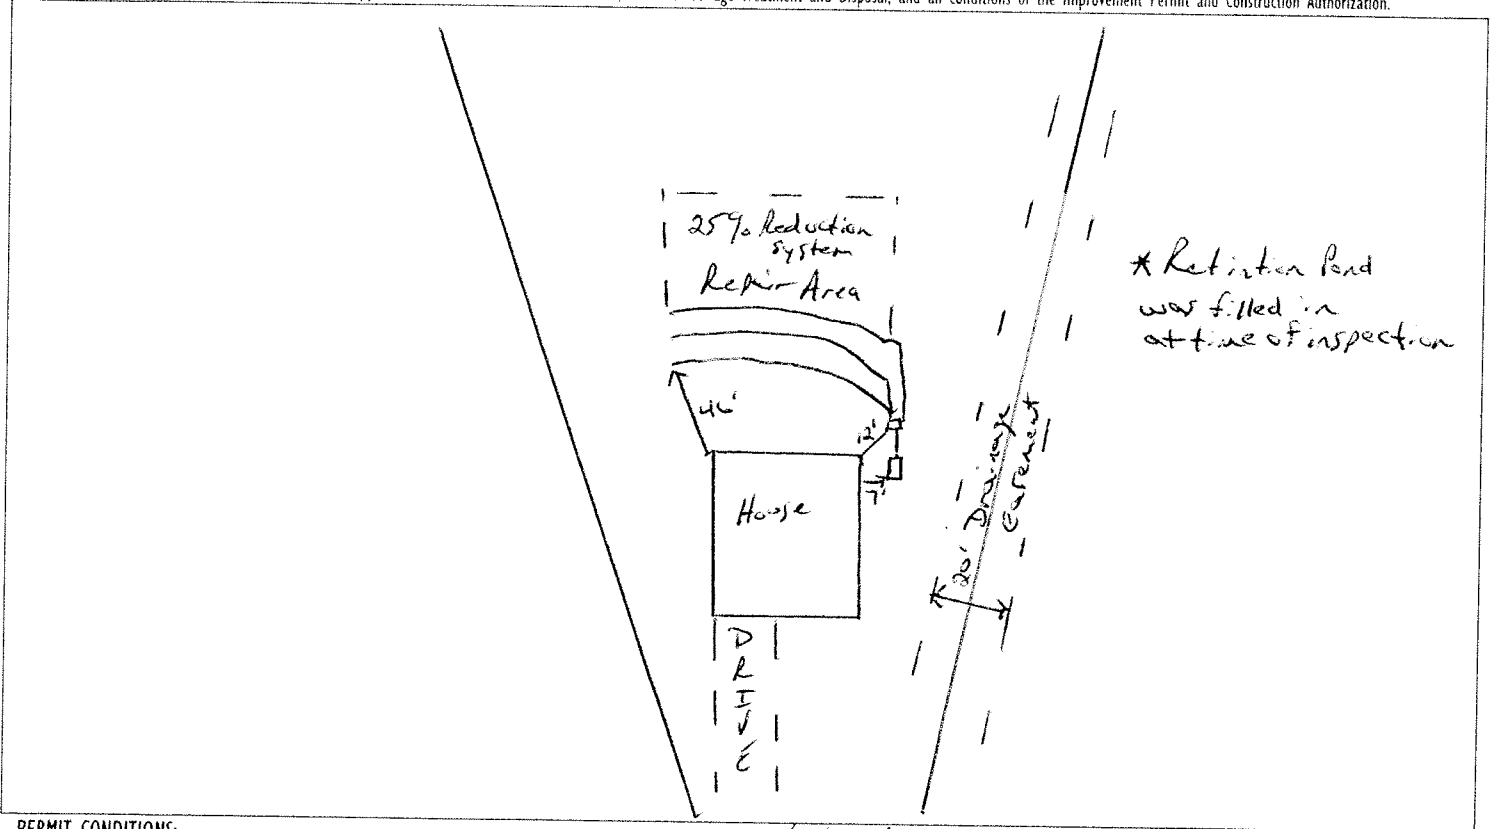

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: BM 5/12/2010 TANK, Lines, 2 Be, 1 PWR OK

* Needs water line checked

V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZFlow Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 3 exact length of each ditch 80 feet width of ditches 3 feet depth of ditches 20 inches

French Drain Required: _____ Linear feet

Authorized State Agent _____

RGMS

Date 8/10/15