

HTE# 10-5-23763

Harnett County Department of Public Health

21462

PERMIT # 25905

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: TINGEN RD

Name: (owner) BILL CLARK HOMES INC SUBDIVISION PATONS POINT LOT # 15

System Installer: LARRY SHARPE Registration # _____

Basement with plumbing: Garage Number of Bedrooms 4 ^{0 2 1/2} - WRONG INFO ENTERED DURING INSPECTION


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

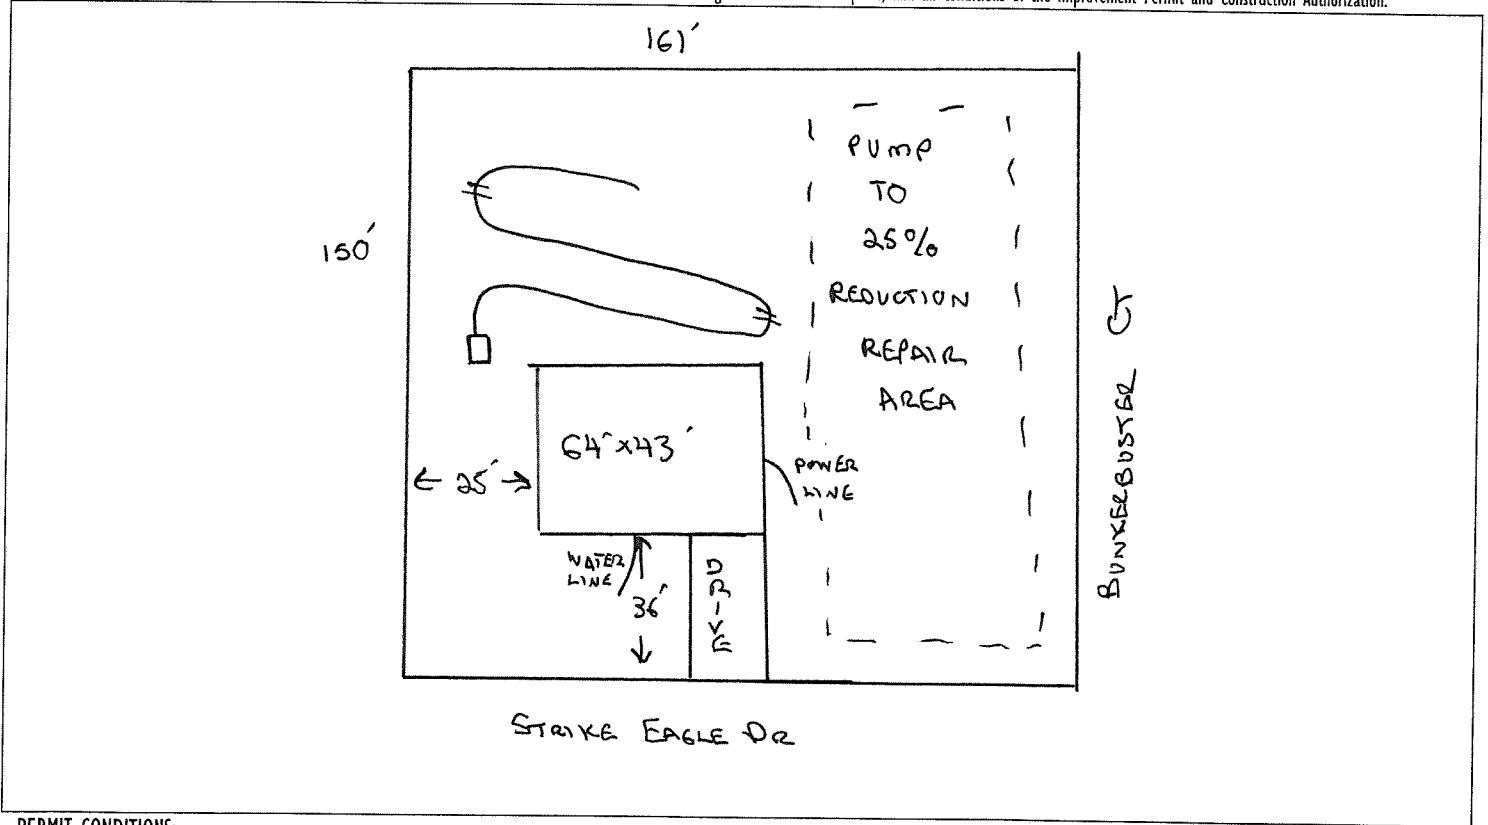

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other TIRE CHIPS Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface Drainage Field: No. of ditches 1 exact length of each ditch 200 feet width of ditches 3 feet depth of ditches 24 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] RENS Date 5/25/10