

HTE#10-5-24324

Hai t County Department of Public Health

21054

PERMIT # 25748

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: 31484 Bruce Johnson RD

Name: (owner) STEPHENSON Brothers Inc SUBDIVISION Johnson Farms LOT # 32

System Installer: Adcoce Excavation Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: 25% REDUCED (ACCEPTED) Type III EZ Lay Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

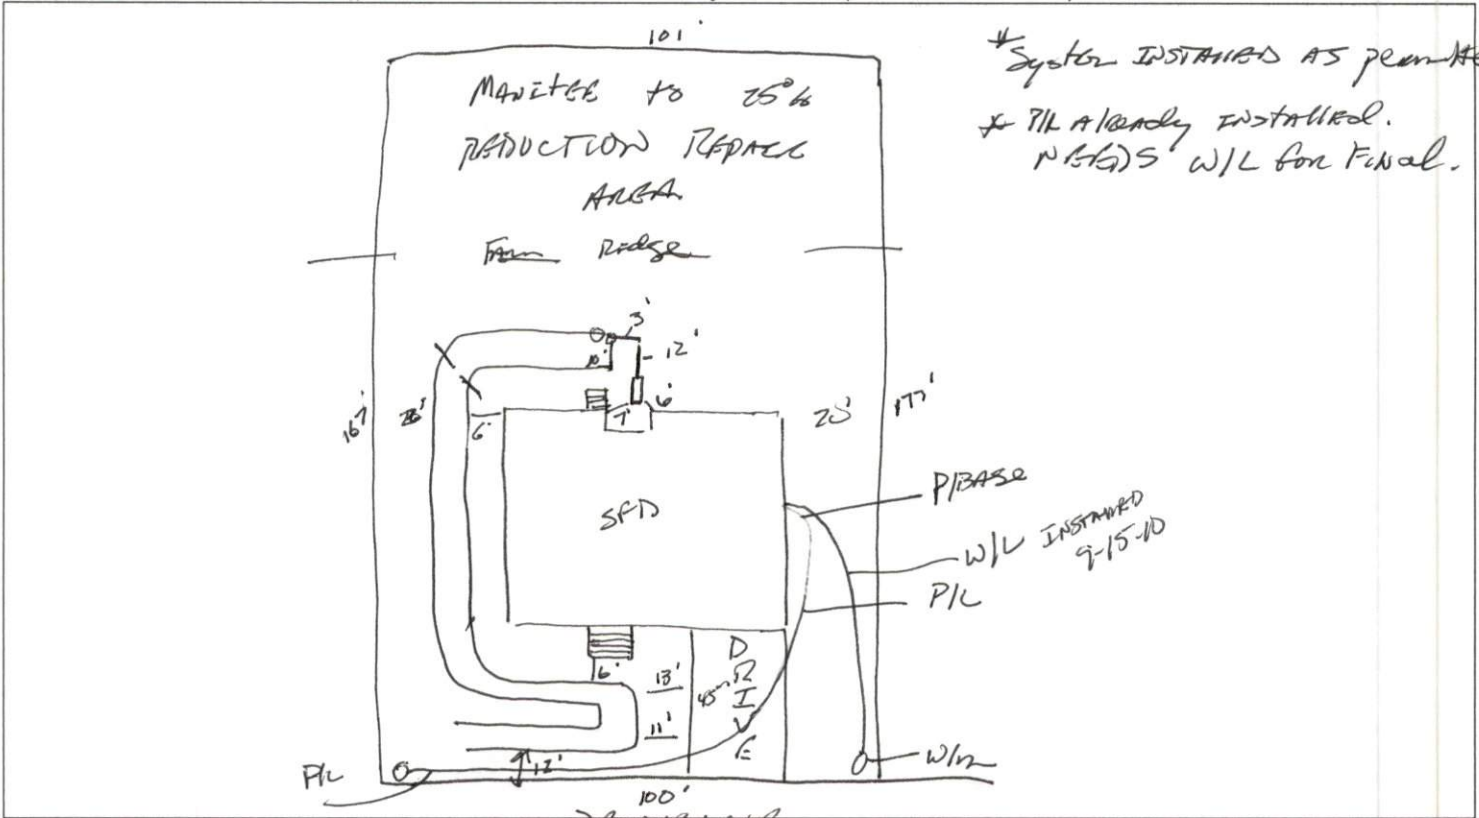

* System INSTALLED AS permitted
* P/L already installed.
* W/L'S W/L for Final.

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage-disposal system on the above captioned property.

Type of system: Conventional Other 25% REDUCED System Type III EZ Lay
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 2 of each ditch 150 feet ditches 3 feet ditches 24-28 inches
 French Drain Required: _____ Linear feet

Authorized State Agent James E. Mandant Date 9-16-10