

HTE# 11-5-27451

# Harnett County Department of Public Health

23498

PERMIT # 26529

## Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION:  Hwy 55

Name: (owner) David + Pamela Byrd SUBDIVISION Powders Creek LOT # 3

System Installer: Stancel Budd Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 8


Type of Water Supply:  Community  Public  Well Distance from well 110 feet

System Type: Pump to 25% Reduction System Type II B ECL Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

100' +

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

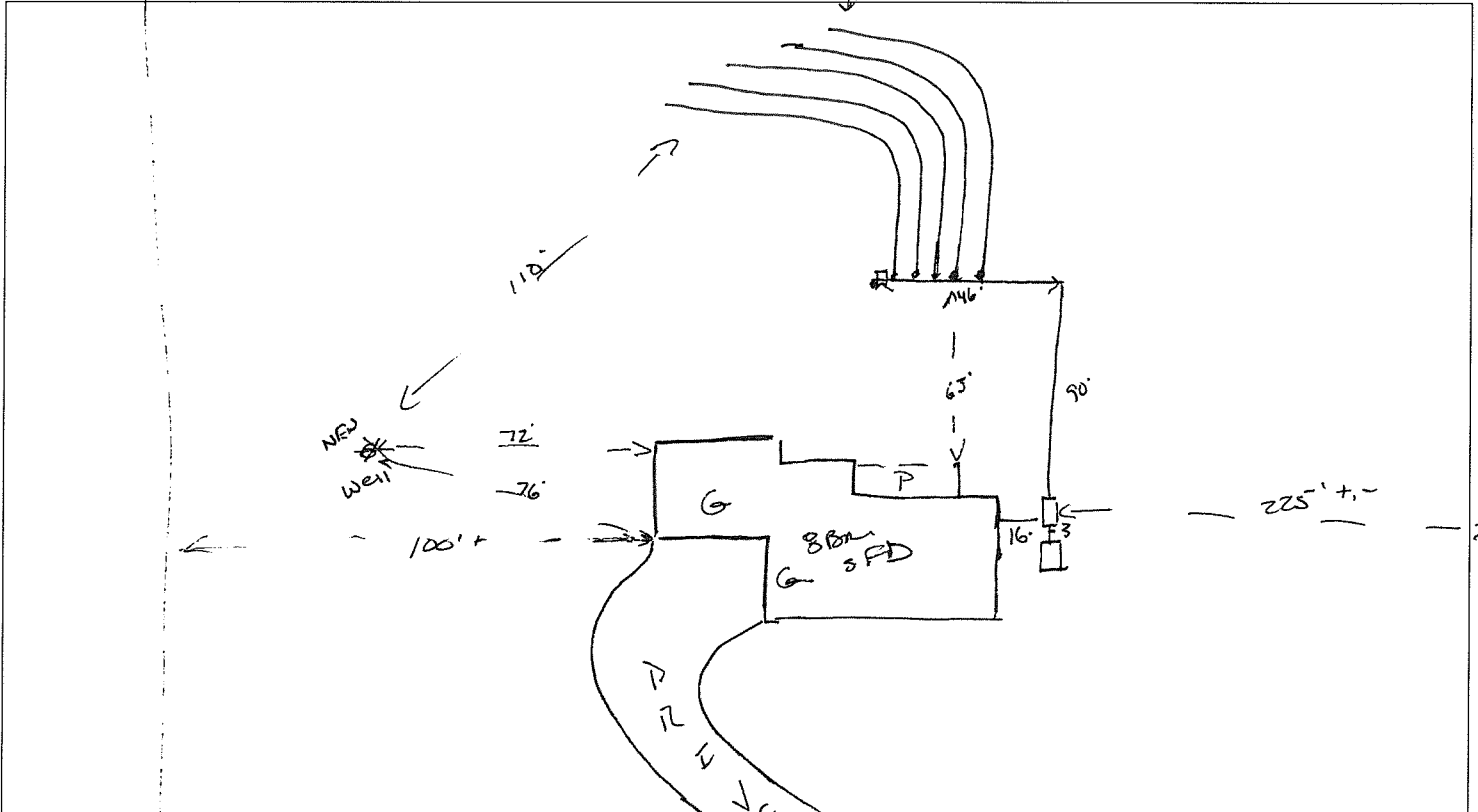

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other Pump to 25% Reduction Septic Tank: 1000 gallons Pump Tank: 2000 gallons

Subsurface Drainage Field: No. of ditches 5 exact length of each ditch 150 feet width of ditches 3 feet depth of ditches 24 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent James E. Markson Jr Date 2-6-15