

**SOIL/SITE EVALUATION**  
**for ON-SITE WASTEWATER SYSTEM**

Owner:                      Applicant:  
 Address:                      Date Evaluated:  
 Proposed Facility: 3800m                      Design Flow (.1949): 360 gal  
 Location of Site:                      Property Recorded:  
 Water Supply:                       Public  Individual  Well  Spring  Other  
 Evaluation Method:  Auger Boring  Pit  Cut  
 Type of Wastewater:  Sewage  Industrial Process  Mixed


P R O F I L E #	.1940 Landscape Position/ Slope %	Horizon Depth (In.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
1	<u>LS S-7</u>	<u>0-10"</u>	<u>G LS</u>	<u>VF2 NS/NP</u>					
		<u>10-40"</u>	<u>SBX SCL<sup>x</sup></u>	<u>R2 SS/NP</u>					<u>PS .5</u>
2		<u>0-14"</u>	<u>G LS</u>	<u>VF2 NS/NP</u>					
		<u>14"</u>	<u>SBX SCL<sup>x</sup></u>	<u>R2 SS/NP</u>					<u>PS .5</u>
3		<u>0-12"</u>	<u>G LS</u>	<u>VF2 NS/NP</u>					
		<u>12-37"</u>	<u>SBX SCL</u>	<u>R2 SS/NP</u>					<u>PS .5</u>
		<u>37"</u>	<u>GS</u>	<u>VF2 NS/NP</u>					

Description	Initial System	Repair System	Other Factors (.1946): <u>NONE</u> Site Classification (.1948): <u>PS</u> Evaluated By: <u>OT</u> Others Present: <u>NONE</u>
Available Space (.1945)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
System Type(s)	<u>PUMP</u>	<u>25%</u>	
Site LTAR	<u>5</u>	<u>5</u>	

FRENCH DRAIN 100' LONG 1' WIDE 3' DEEP

1" = 20'

1' WIDE  
3' DEEP

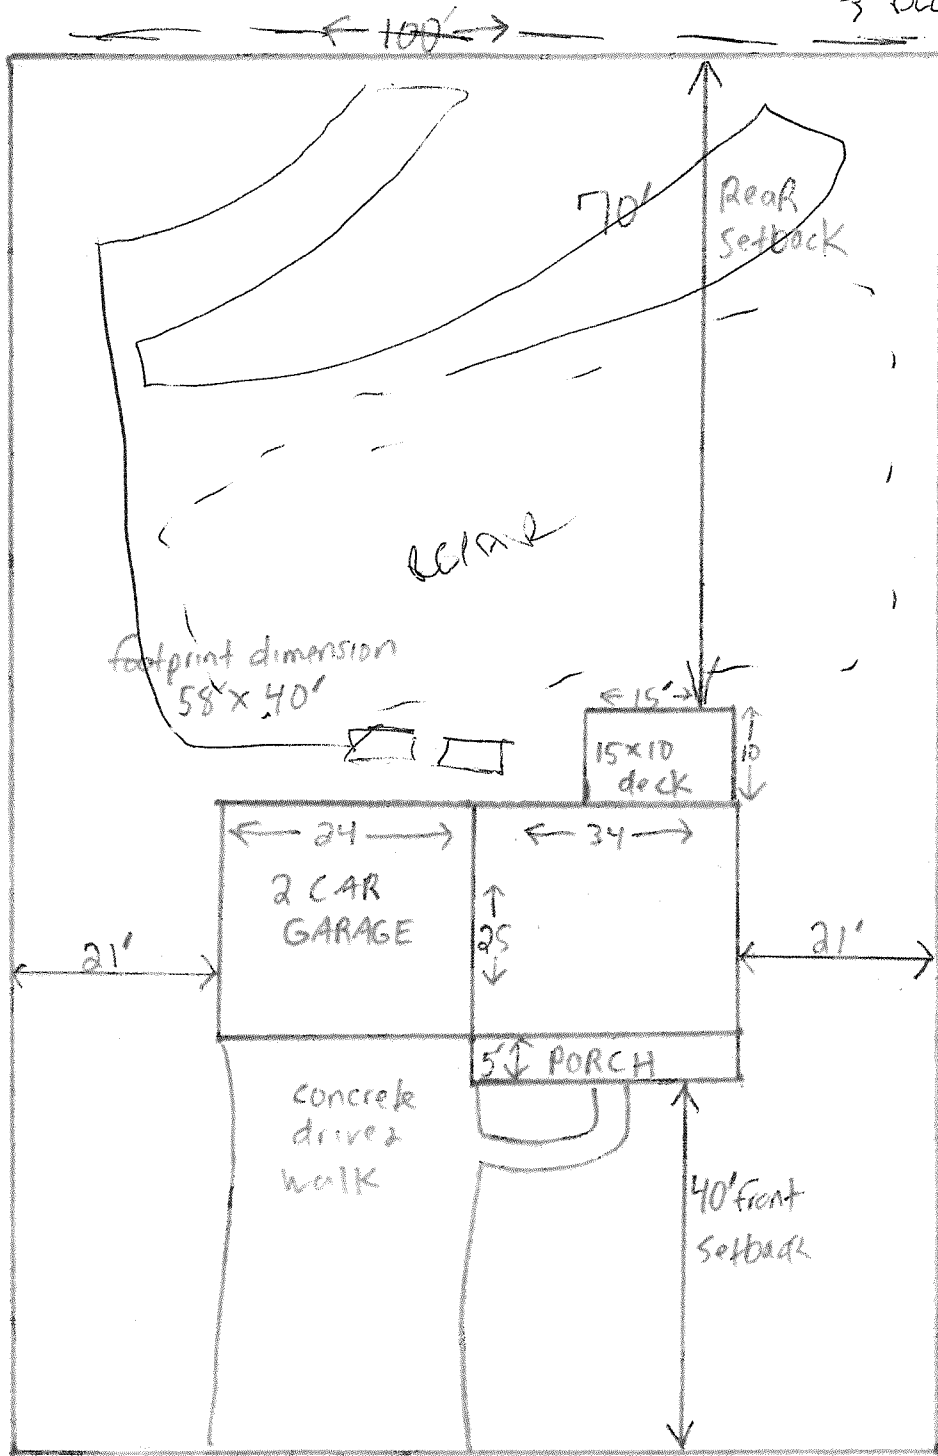

↑ 150  
↓

1 x 200' @ 18"

lot 73 Pattons Point, 26 Eisenhower Ct, Broadway 27505  
Parcel ID # 9597-30-3507.000

Israel Lucas 919-770-0902