

HTE# 13-5-30881

Harratt County Department of Public Health

PERMIT # 27367

Operation Permit

22670

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: SR 2006 Crawford Rd

Name: (owner) DENISE Matthews 2 LLC SUBDIVISION _____ LOT # _____

System Installer: LARRY SNYPER Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well subfactor feet

System Type: Pump to 25% REDUCTION System Type II B Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

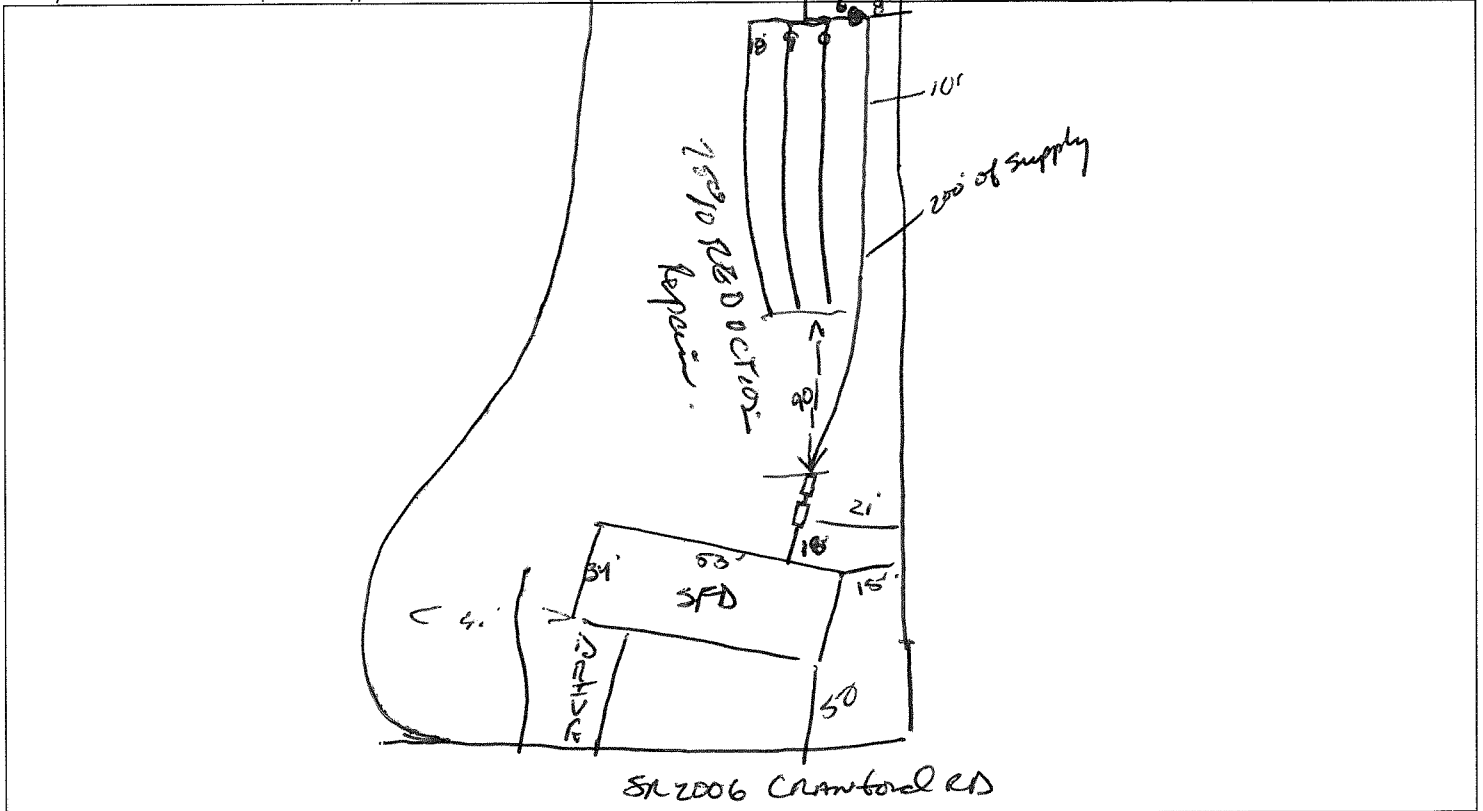

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump to 25% RBD System Chamber Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field: No. of ditches 3 exact length of each ditch 100 feet width of ditches 3 feet depth of ditches 26-18 inches

French Drain Required: _____ Linear feet

Authorized State Agent James E. Matthews Date 5-31-13