

HTE# 13-5-31058

# Harnett County Department of Public Health

PERMIT # 27375

## Operation Permit

22992

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 561437 Ballard RD

Name: (owner) Cumberland Homes Inc SUBDIVISION Ballard Woods LOT # 144

System Installer: TED Brown Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: Pump to 25% REDUCED System Type II B Chamber V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

*For Electric  
check-4*

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

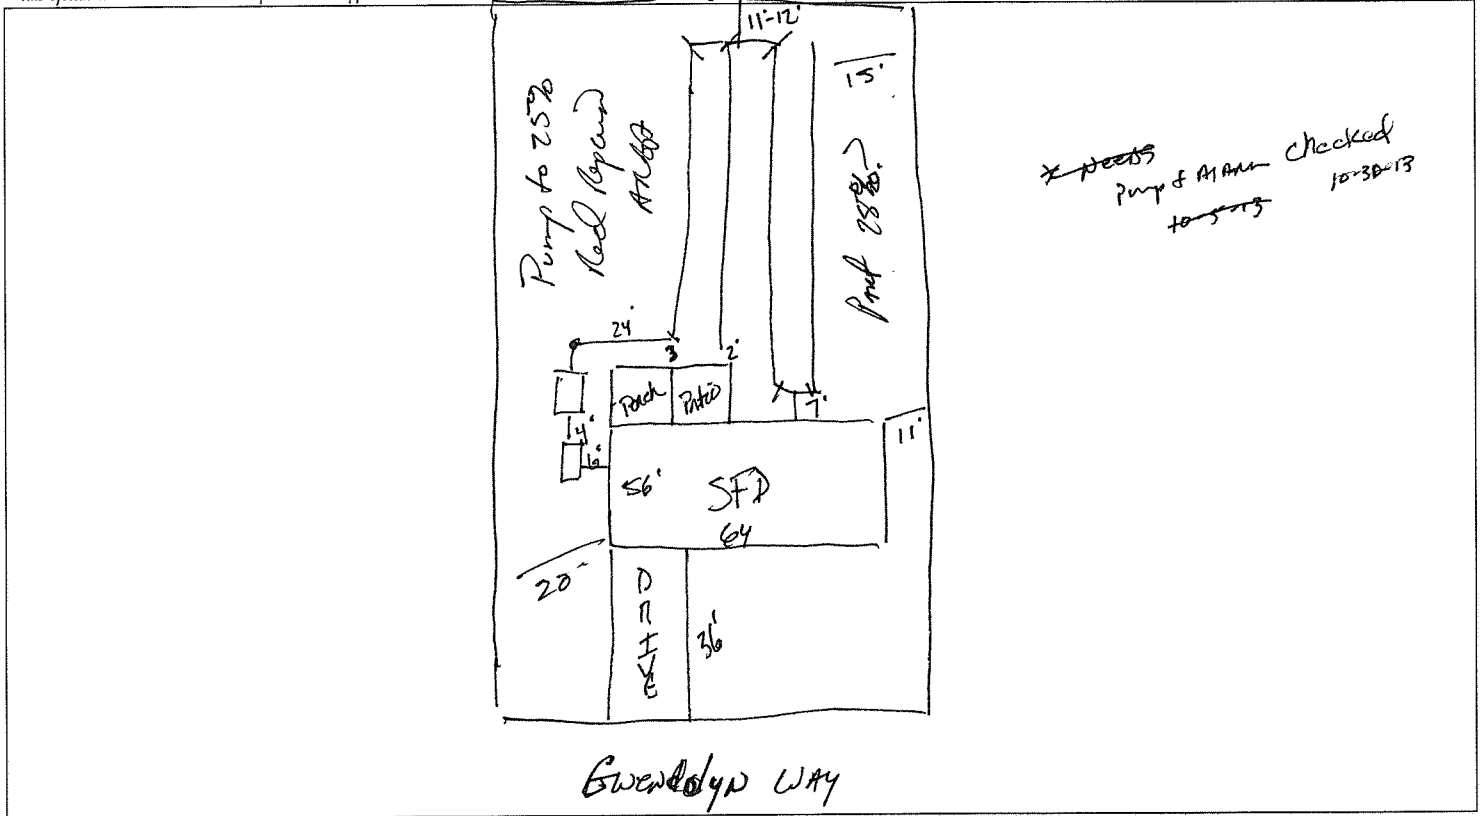

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes  No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other Pump to 25% REDUCED Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 1 exact length of each ditch 280 feet width of ditches 3 feet depth of ditches 20-18 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent: James E. Markant Date: 10-29-13