

HTE# 13-5-31453

Harnett County Department of Public Health

PERMIT # 27398

Operation Permit

23008

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 827412 Christina Light Rd

Name: (owner) Weslyn Clark SUBDIVISION Mels Meadows LOT # 32

System Installer: SPD Registration # _____


Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Pump to 2500 RESIDUUM Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Type II B Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes/ Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

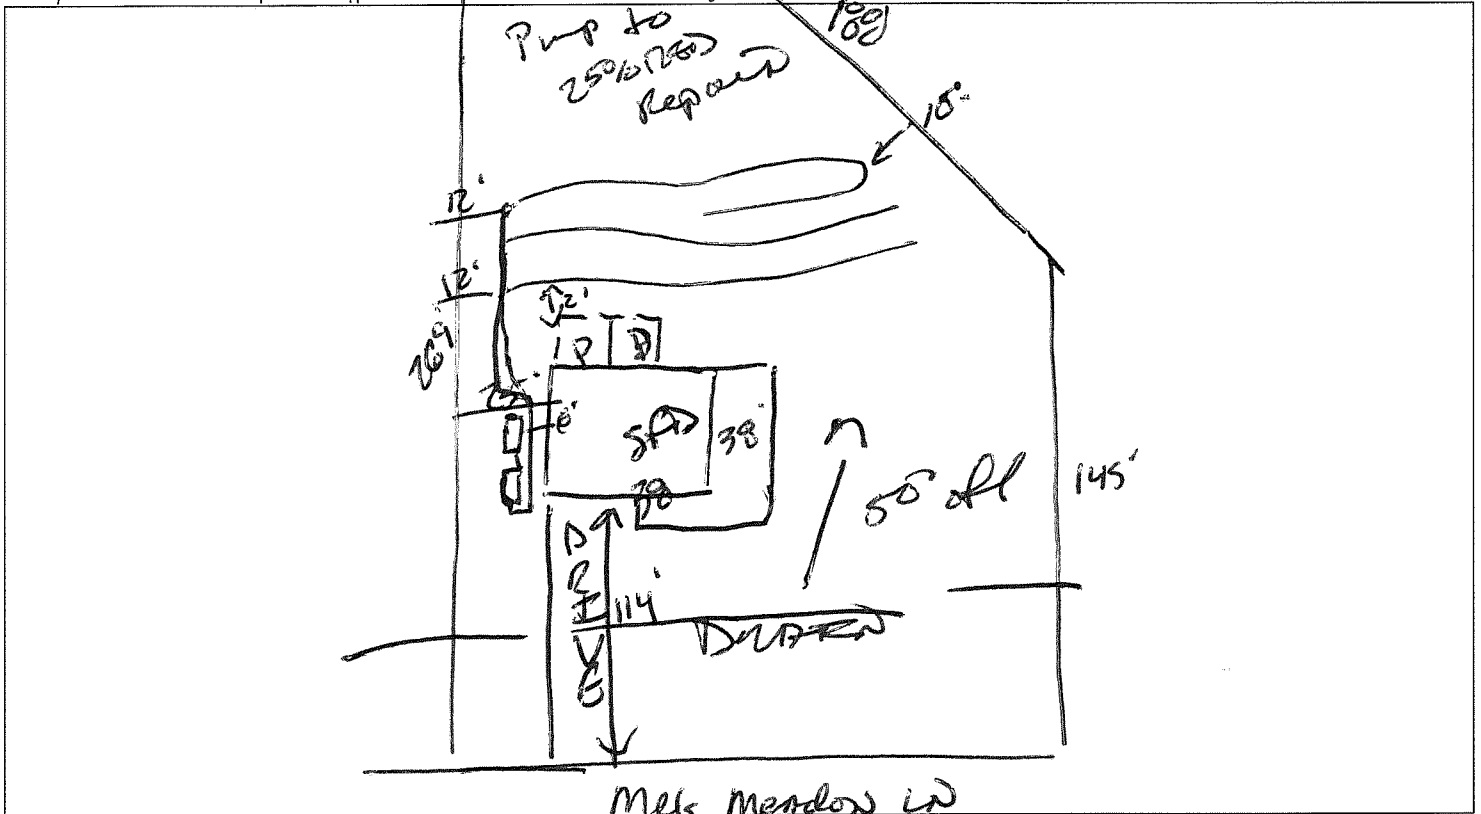

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 2500 RESIDUUM Septic Tank: 1000 gallons Pump Tank: 1000 gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 3 of each ditch 80 feet ditches 3 feet ditches 24-22-18 inches
 French Drain Required: _____ Linear feet

Authorized State Agent James E. Mankart Date 12/27/13