## HTE#13-5-32299

## Harnett County Department of Public Health

27687

**Improvement** Permit

A	building	permit	cannot	be i	ssued	with	only	an	Improvement Permit	
		•	00	000	0.TV I		~~ `	$\sim$	- 1121	

PROPERTY LOLA	ATION: ULD Ha	<u> </u>	
ISSUED TO: NEXT GENERATION HOMES SUBDIVISION	THOMAS	MANOR	LOT # 35
NEW 🗶 REPAIR 🗆 🛛 EXPANSION 🗆	Site Improvements	required prior to Construction Author	ization Issuance:
Type of Structure: SEO (GT'X47)			
Proposed Wastewater System Type: 2520 REDUCTION SYSTEM			
Projected Daily Flow: 360 GPD			
Number of bedrooms: <u>3</u> Number of Occupants: <u>6</u> max			
Basement □Yes Ko Pump Required: □Yes Ko □ May be required based on final location and elev			
Pump Required: IYes No IMay be required based on final location and elevery Type of Water Supply: I Community K Public I Well Distance from well	ations of facilities		
Type of Water Supply: 🗆 Community 🛛 K Public 🛛 Well Distance from well 🔟	<u> </u>	Permit valid for:	Five years
Permit conditions:			No expiration
			•
Authorized State Agent:: Date:	10/22/13	SEE ATT	ACHED SITE SKETCH

The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.


## **Construction Authorization**

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958. and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: NEXT GENERATIO	N HOMES PROPERTY LOCATION: Or	0 421
Facility Type: SFO (57'747')	🛛 📉 New 🛛 Expansion 🛛 Repair	
Basement? □ Yes ⊠ No Basement Fi Type of Wastewater System** _ →5℃	xtures? 🗆 Yes 🛛 No	
Type of Wastewater System**	REDUCTION SYSTEM	(Initial) Wastewater Flow: <u>360</u> GPD
(See note below, if applicable 🗆)	0	•
25%	REDUCTION (Repair)	
Installation Requirements/Conditions	Number of trenches	0
Septic Tank Size <u>1000</u> gallons	Exact length of each trench <u>75</u> feet	Trench Spacing: Feet on Center
Pump Tank Size gallons	Trenches shall be installed on contour at a	Soil Cover: <u>6-18</u> inches
	Maximum Trench Depth of: <u>18-30</u> inches	(Maximum soil cover shall not exceed
	(Trench bottoms shall be level to $+/-1/4$ "	36" above the trench bottom)
	in all directions)	,
Pump Requirements:ft. TDH vs	GPM	inches below pipe
		Aggregate Depth: inches above pipe
Conditions:		inches total

## WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA. NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.

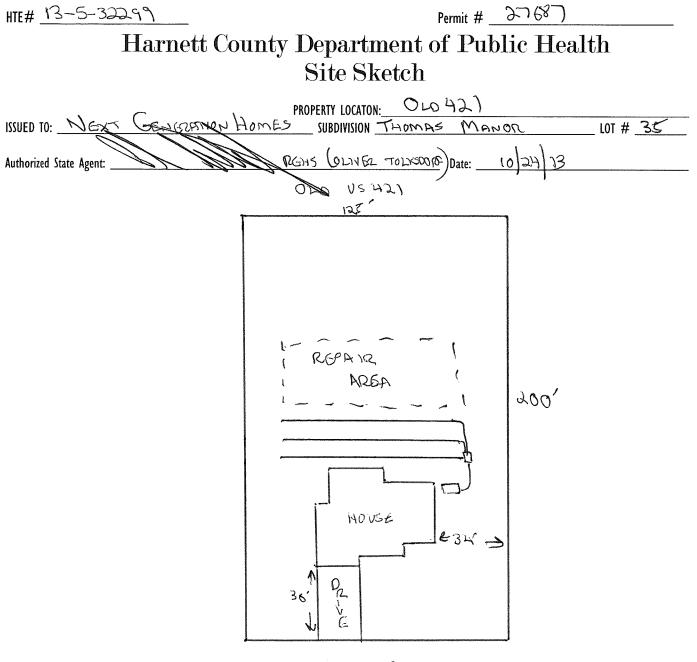

PINTAIL DOL