

HTE# 13-5-32550R

Harnett County Department of Public Health

23332

PERMIT # 27707

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 51440 James Norcross RD

Name: (owner) Gerald & Leif Owens SUBDIVISION Nezils Creek Farm LOT # 20

System Installer: Quality Septic Greg Batchelor Registration # _____


Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: 1590 RGD Down System Type II G Down Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

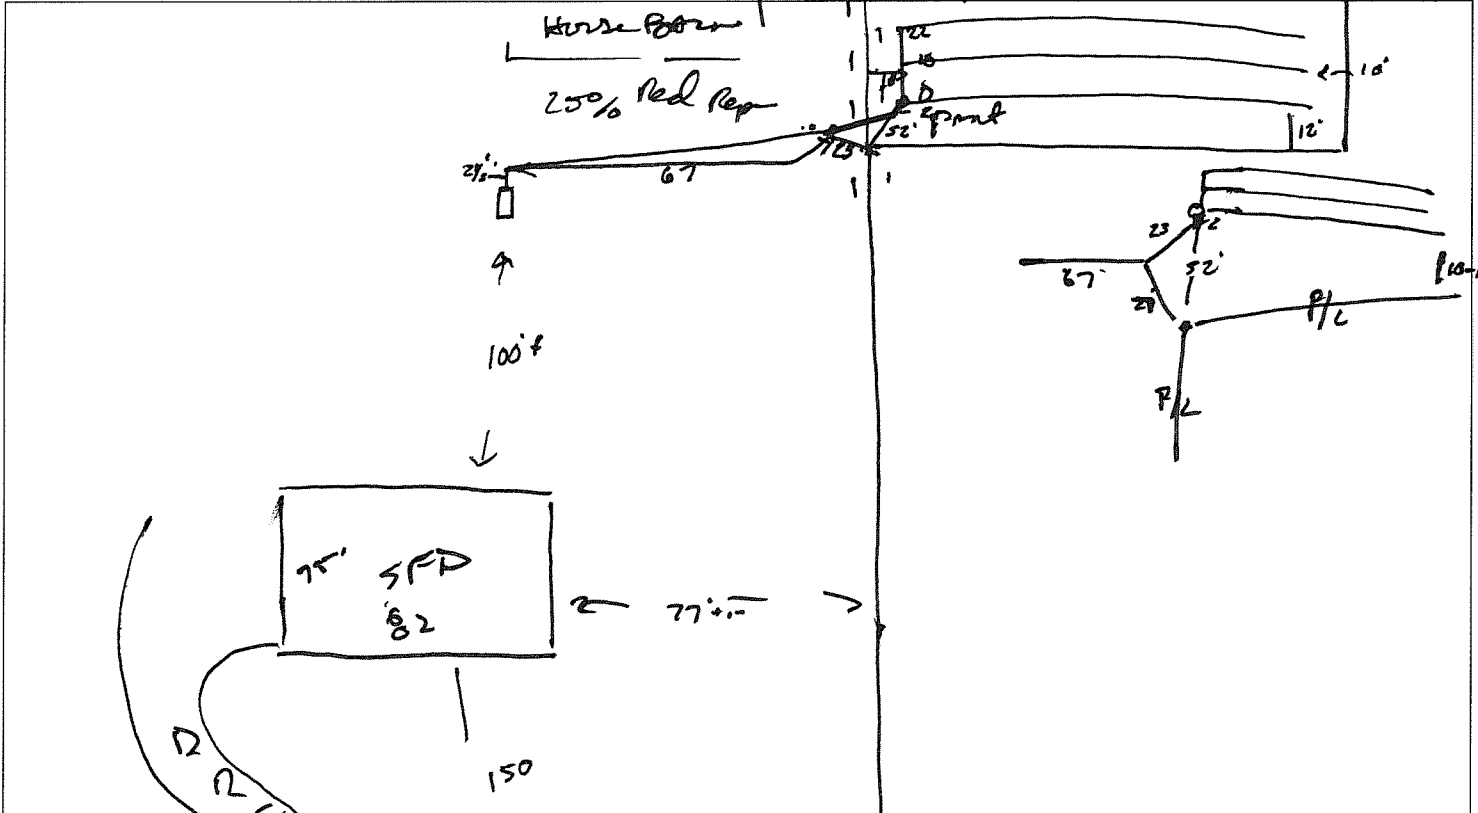

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other:
 - Subsurface system operator required? Yes No
 - If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 1590 RGD Down Septic Tank: 1200 gallons Pump Tank: _____ gallons

Subsurface Drainage Field: No. of ditches 3 exact length of each ditch 140 feet width of ditches 3 feet depth of ditches 24-28 inches

French Drain Required: _____ Linear feet

Authorized State Agent: James E. Manhart Date: 7-14-14