

HTE# 14-5-33621  
PERMIT # 27877

# Harnett County Department of Public Health

23363

## Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 51434 Bruce Johnson Rd

Name: (owner) Darry Robinson Homes SUBDIVISION Joanna Farms LOT # 73  
System Installer: EDGE GARNER Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: Pumps 250 Gallon Pump Type V Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.  
Q-4

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

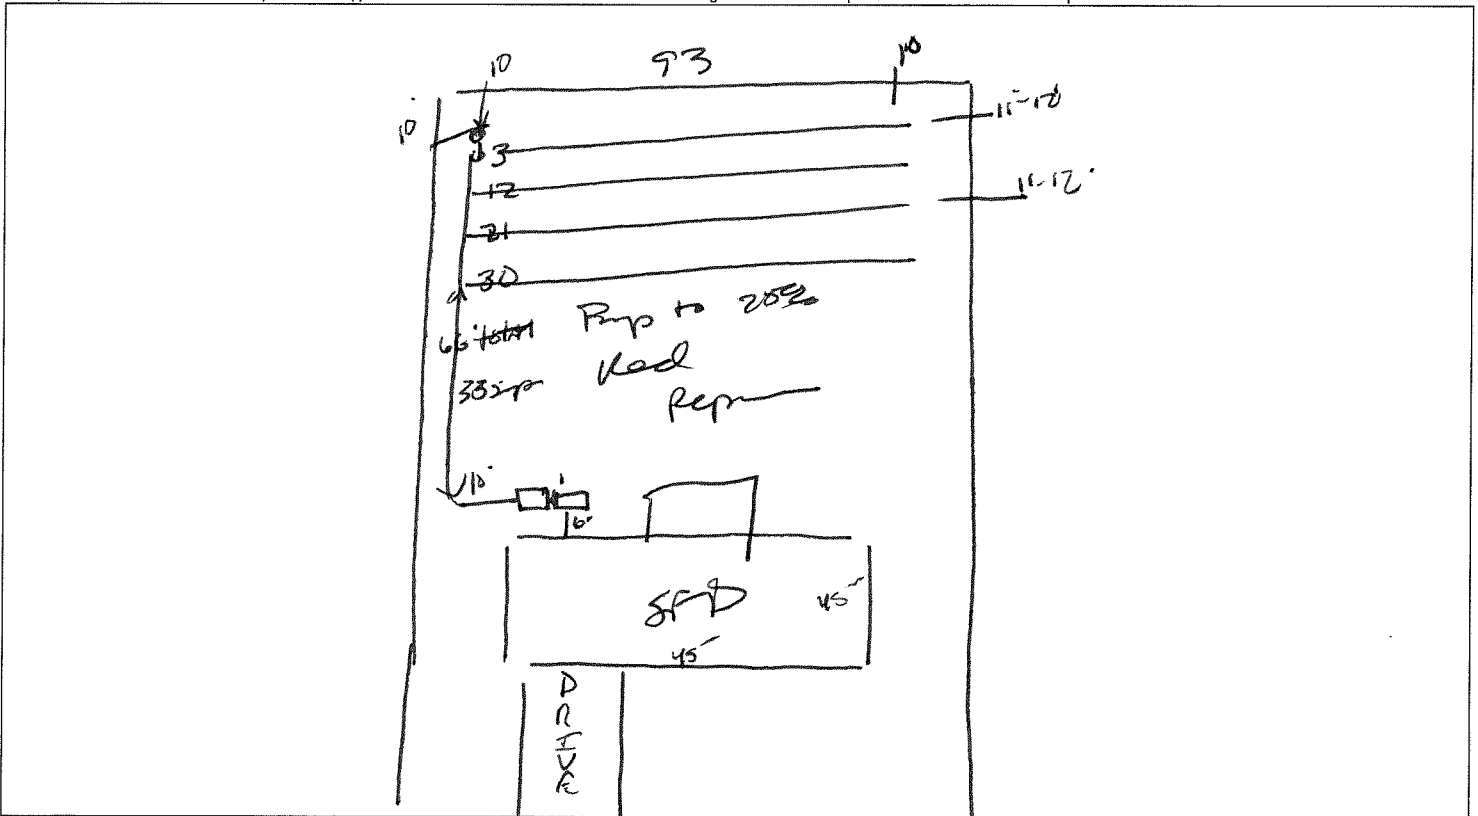

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961. Saddle AN
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other 250 Gallon Pump Septic Tank: 1000 gallons Pump Tank: 1000 gallons  
Subsurface Drainage Field: No. of ditches 4 exact length of each ditch 76 feet width of ditches 3 feet depth of ditches 24-18 inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent James E. Markham Date 11-10-14