

HTE# 15-5-37677R

Harnett County Department of Public Health

24122

PERMIT # 28650

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: off old road to Oxford Woods Dr.

Name: (owner) Comfort Homes SUBDIVISION Oxford Woods LOT # 38

System Installer: Russell Phillips Registration # 3905


Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well NA. feet

System Type: 25% Reduction Type IIIb Chamber Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

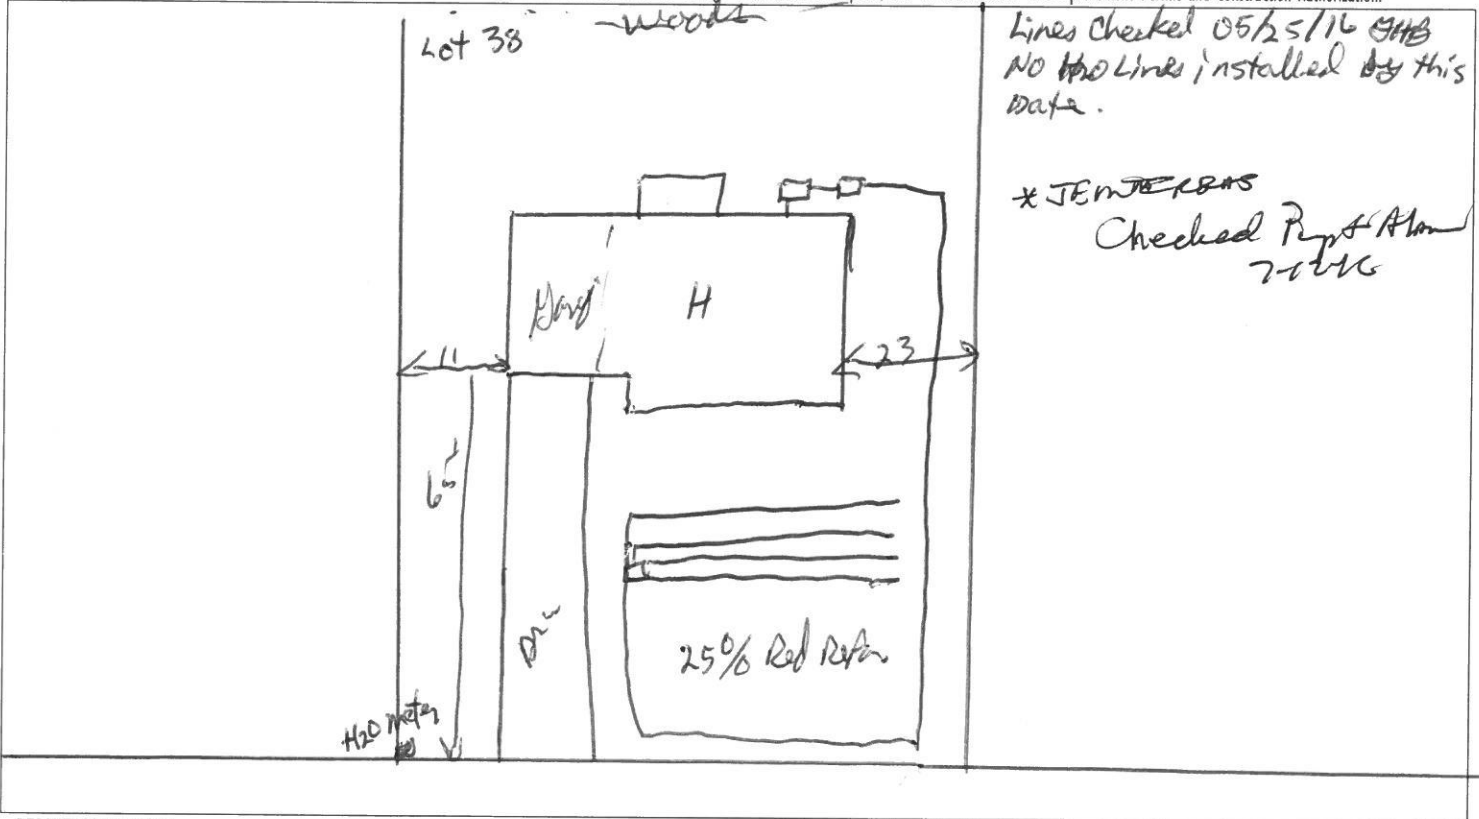

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% Red Refr Septic Tank: _____ gallons Pump Tank: _____ gallons

Subsurface No. of 4 exact length 60 width of 3 depth of _____

Drainage Field ditches _____ of each ditch _____ feet ditches 3 feet ditches 22 inches

French Drain Required: _____ Linear feet

Authorized State Agent James E. Mark Date 7-12-16