

HTE# 16-5-3600R ³⁸¹⁰

Harnett County Department of Public Health

24253

PERMIT # 28907

Operation Permit

- New Installation
- Septic Tank
- Nitrification Line
- Repair
- Expansion

PROPERTY LOCATION: 521437 Ballantyne RD

Name: (owner) Cumberland Homes LLC SUBDIVISION Ballantyne Woods LOT # 174

System Installer: Teal Brown Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Top to 25% Red Accepted Type Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

Chanchei QUICK 4

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

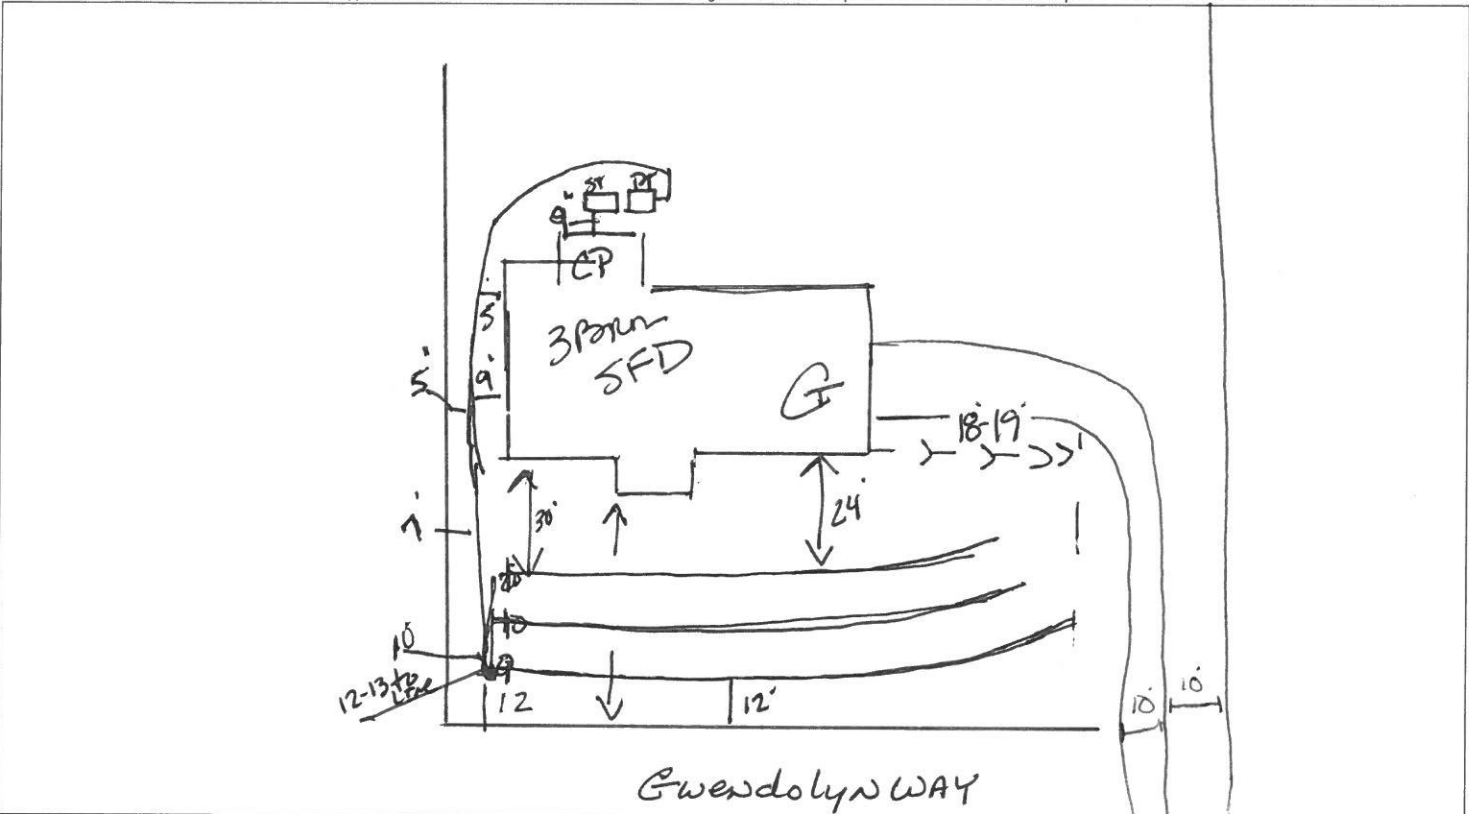

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 15' Red System Septic Tank: 1000 gallons Pump Tank: 1000 gallons
 Subsurface Drainage Field No. of ditches 3 exact length of each ditch 75 feet width of ditches 3 feet depth of ditches 18" inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] REHS Date 1/12/17