

Improvement Permit

A building permit cannot be issued with only an Improvement Permit

ISSUED TO: JACK CLAYTON
PROPERTY LOCATION: JACKSON RD
NEW [X] REPAIR [] EXPANSION []
Type of Structure: SFD (100'x44)
Proposed Wastewater System Type: PUMP TO CONVENTIONAL
Projected Daily Flow: 600 GPD
Number of bedrooms: 5 Number of Occupants: 10 max
Basement [X] Yes [] No
Pump Required: [X] Yes [] No
Type of Water Supply: [] Community [] Public [X] Well
Distance from well: 100 feet
Permit valid for: [X] Five years [] No expiration

Authorized State Agent: [Signature] Date: 10/27/16 SEE ATTACHED SITE SKETCH

The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: JACK CLAYTON
PROPERTY LOCATION: JACKSON RD
Facility Type: SFD (100'x44) [X] New [] Expansion [] Repair
Basement? [X] Yes [] No Basement Fixtures? [X] Yes [] No
Type of Wastewater System: PUMP TO CONVENTIONAL (Initial) Wastewater Flow: 600 GPD
(See note below, if applicable [])

Installation Requirements/Conditions

Number of trenches: 6
Septic Tank Size: 1250 gallons
Pump Tank Size: 1250 gallons
Exact length of each trench: 100 feet
Trench Spacing: 9 Feet on Center
Soil Cover: 6 inches
Maximum Trench Depth: 18 inches
(Pump Requirements: ft. TDH vs. GPM)
Aggregate Depth: inches below pipe, inches above pipe, inches total

WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA. NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.
Owner/Legal Representative Signature: Date:

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH

Authorized State Agent: [Signature] Date: 10/27/16
Construction Authorization Expiration Date: 10/27/20


HTE# 16-5-39821

Permit # 29107

Harnett County Department of Public Health Site Sketch

ISSUED TO: JACK CLAYTON PROPERTY LOCATOR: JACKSON R
SUBDIVISION _____ LOT # _____

Authorized State Agent: ~~_____~~ PHHS (OLIVER TOLKSDOTT) Date: 10/27/16

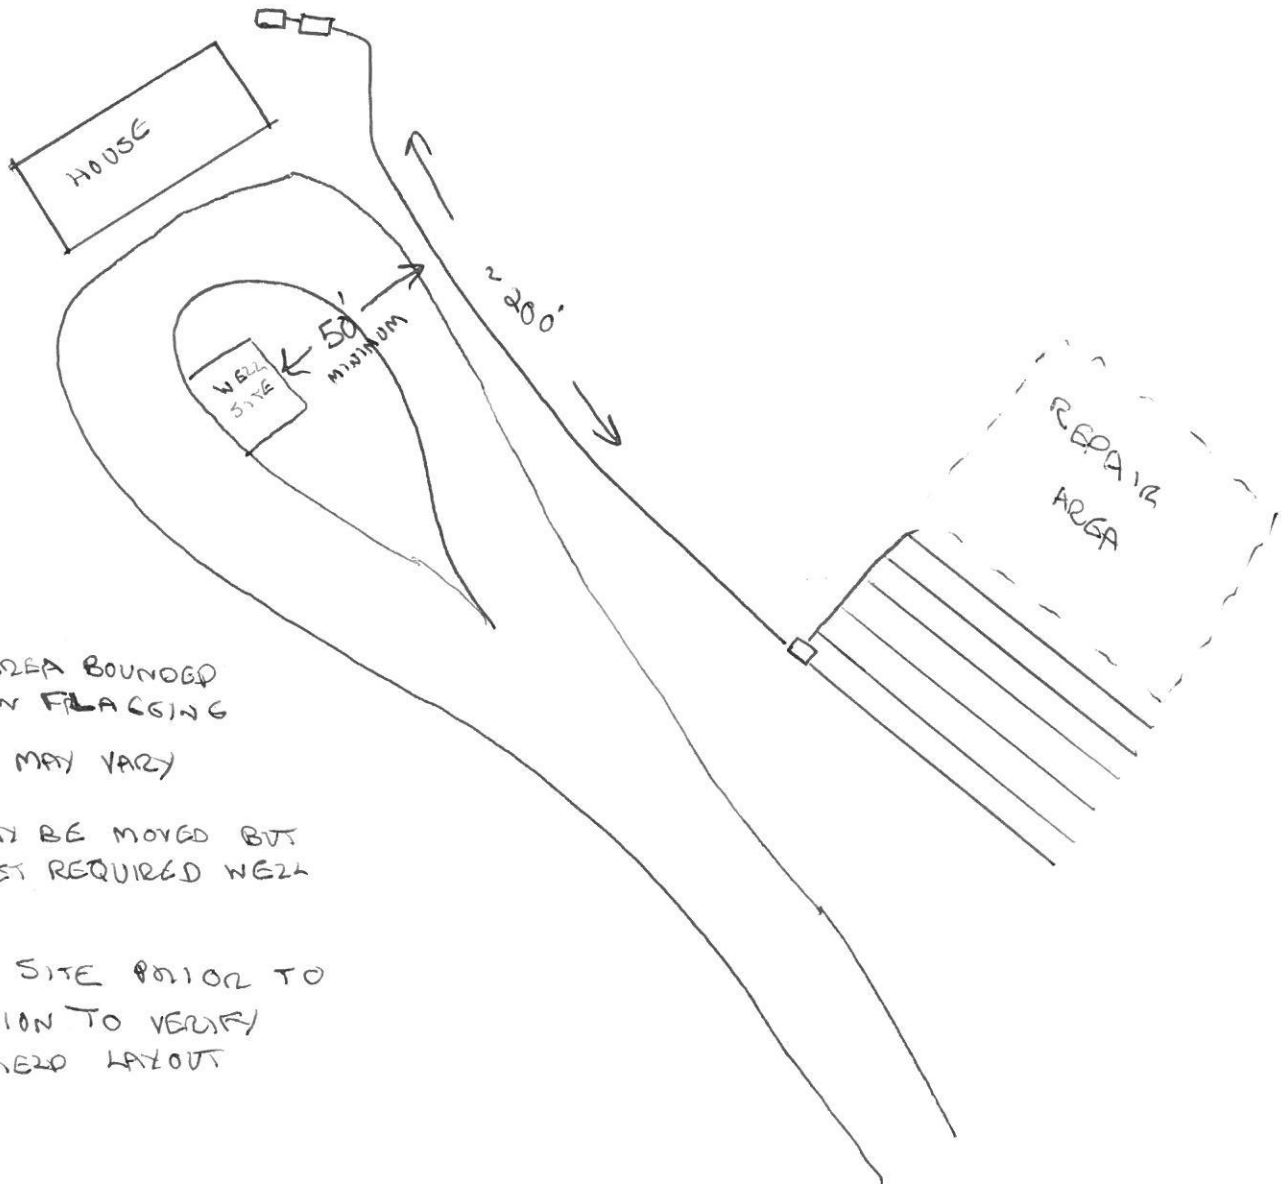

- * SYSTEM AREA BOUNDED BY YELLOW FLAGGING
- * CONTOUR MAY VARY
- * TANKS MAY BE MOVED BUT MUST MEET REQUIRED WELL SETBACK
- * MEET ON SITE PRIOR TO INSTALLATION TO VERIFY DRAIN FIELD LAYOUT