

HTE# 17-5-40734

Harnett County Department of Public Health

29415

Improvement Permit

A building permit cannot be issued with only an Improvement Permit

ISSUED TO: PAUL LYON PROPERTY LOCATION: 1265 GRIFFIN RD
 SUBDIVISION _____ LOT # 2
 NEW REPAIR EXPANSION
 Type of Structure: SFO (60'x50') Site Improvements required prior to Construction Authorization Issuance:
 Proposed Wastewater System Type: 25% REDUCTION SYS.
 Projected Daily Flow: 480 GPD
 Number of bedrooms: 4 Number of Occupants: 8 max
 Basement Yes No
 Pump Required: Yes No May be required based on final location and elevations of facilities
 Type of Water Supply: Community Public Well Distance from well _____ feet Permit valid for: Five years
 No expiration
 Permit conditions: _____

Authorized State Agent: [Signature] Date: 2/28/17 SEE ATTACHED SITE SKETCH
 The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: PAUL LYON PROPERTY LOCATION: 1265 GRIFFIN RD
 SUBDIVISION _____ LOT # 2
 Facility Type: SFO (60'x50') New Expansion Repair
 Basement? Yes No Basement Fixtures? Yes No
 Type of Wastewater System** 25% REDUCTION SYSTEM (Initial) Wastewater Flow: 480 GPD
 (See note below, if applicable) Pump To 25% RED SYS. (Repair)
 Installation Requirements/Conditions
 Septic Tank Size 1000 gallons
 Pump Tank Size _____ gallons
 Number of trenches 1
 Exact length of each trench 350 feet
 Trenches shall be installed on contour at a
 Maximum Trench Depth of: 18-30 inches
 (Trench bottoms shall be level to +1-1/4" in all directions)
 Trench Spacing: 9 Feet on Center
 Soil Cover: 6-28 inches
 (Maximum soil cover shall not exceed 36" above the trench bottom)
 Pump Requirements: _____ ft. TDH vs. _____ GPM
 Aggregate Depth: _____ inches below pipe
 _____ inches above pipe
 _____ inches total
 Conditions: _____

**WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA.
NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.**

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.
 Owner/Legal Representative Signature: _____ Date: _____

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH

Authorized State Agent: [Signature] Date: 2/28/17
 Construction Authorization Expiration Date: 2/28/22


HTE# 17-5-40734

Permit # 29415

Harnett County Department of Public Health Site Sketch

ISSUED TO: PAUL LYON PROPERTY LOCATOR: 1265 GRIFIN RD
SUBDIVISION: - LOT # 2

Authorized State Agent: ~~REAS (OLIVER TOLSON)~~ Date: 2/28/17

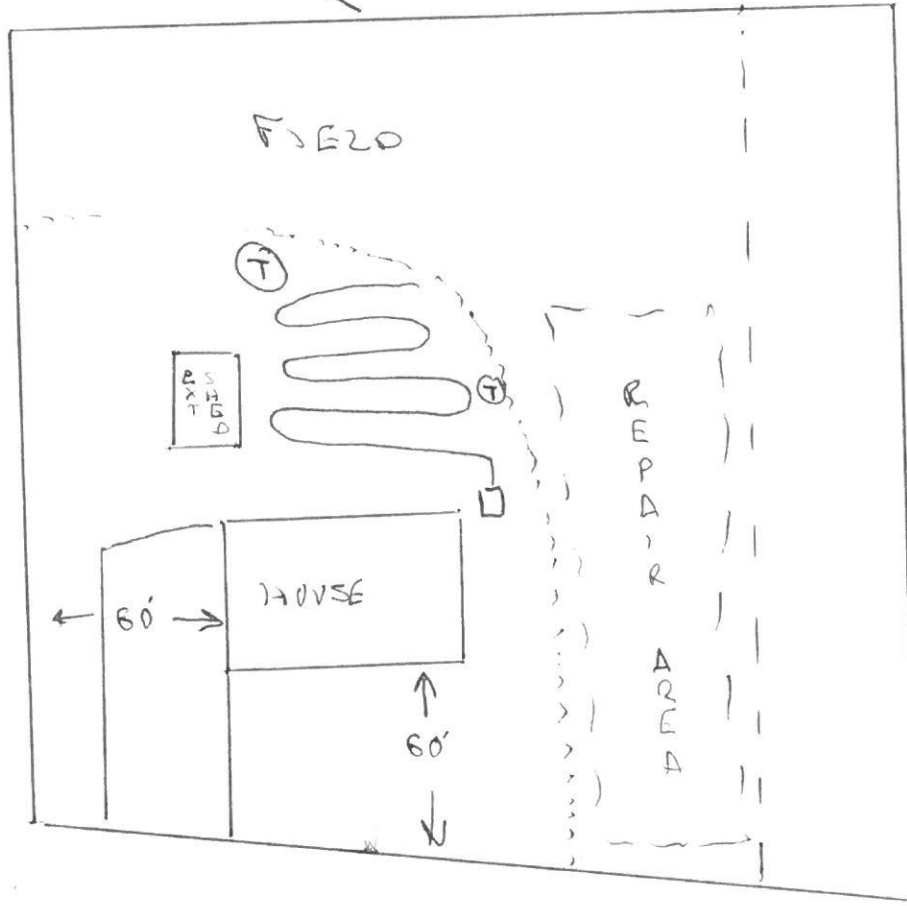

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: Applicant:
 Address: Date Evaluated:
 Proposed Facility: 1300 Design Flow (.1949): 1.58 Property Size:
 Location of Site: Property Recorded:
 Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed

P R O F I L E #	.1940 Landscape Position/ Slope %	Horizon Depth (In.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
1	<u>LS</u> <u>0-2</u>	<u>0-20</u>	<u>G S</u>	<u>very soft</u>					
		<u>20-44</u>	<u>SBX SC</u>	<u>F2 S/S</u>					<u>P3</u> <u>.35</u>
2		<u>0-24</u>	<u>G S</u>	<u>very soft</u>					
		<u>24-36</u>	<u>SBX SCL</u>	<u>F2 S/S</u>					
		<u>36-48</u>	<u>SBX C</u>	<u>F2 S/S</u>					<u>P3</u> <u>.4</u>
3		<u>0-24</u>	<u>G S</u>	<u>very soft</u>					
		<u>24-36</u>	<u>SBX SCL</u>	<u>F2 S/S</u>					
		<u>36-48</u>	<u>SBX C</u>	<u>F2 S/S</u>	<u>107127) 2 C 42"</u>				<u>P3</u> <u>.4</u>
4		<u>0-24</u>	<u>G S</u>	<u>very soft</u>					
		<u>24-36</u>	<u>SBX SCL</u>	<u>F2 S/S</u>	<u>107127) 2 C 36"</u>				<u>P3</u> <u>.35</u>

Description	Initial System	Repair System	Other Factors (.1946): Site Classification (.1948): <u>P3</u> Evaluated By: <u>[Signature]</u> Others Present:
Available Space (.1945)	<u>✓</u>	<u>✓</u>	
System Type(s)	<u>2-5" (4-6")</u>	<u>6-10"</u>	
Site LTAR	<u>.35</u>	<u>.4</u>	

LA 300 05 12 13