

ADDRESS : 17 AFTON CT
CONTRACTOR : ROYAL OAKS BUILDING GROUP LLC
OWNER : ROYAL OAKS BUILDING GROUP
PARCEL : 04-0664- - -0020- -38-
APPL NUMBER: 17-50040975 CP NEW RESIDENTIAL (SFD)
DIRECTIONS : T/S: 03/21/2017 08:39 AM JBROCK ----
ATKINS VILLAGE #36
T/S: 07/31/2017 01:24 PM JBROCK ----
premise # 83259146

SUBDIV: ATKINS VILLAGE PH 3
PHONE : (919) 233-3886
PHONE :

STRUCTURE: 000 000 55X42 3BDR CRAWL W/ GARAGE & DECK

FLOOD ZONE : FLOOD ZONE X
BEDROOMS : 3.00 PROPOSED USE : SFD
SEPTIC - EXISTING? : NEW TANK WATER SUPPLY : COUNTY

PERMIT: CPSF 00 CP * SFD

TYP/SQ	REQUESTED COMPLETED	INSP RESULT	DESCRIPTION RESULTS/COMMENTS
A814 01	7/19/17 7/19/17	SB AP	ADDRESS CONFIRMATION TIME: 17:00 VRU #: 002999068 17 AFTON CT FUQUAY VARINA 27526 T/S: 07/19/2017 12:39 PM SBENNETT -----
B101 01	8/01/17 <u>8-1</u>	TI <u>DA</u>	R*BLDG FOOTING / TEMP SVC POLE TIME: 17:00 VRU #: 003006079 T/S: 07/31/2017 01:08 PM JBROCK ----- eng letter on site
B103 01	8/01/17 <u>8-1</u>	TI <u>AP DA</u>	R*BLDG FOUND & TEMP SVC POLE TIME: 17:00 VRU #: 003006095 T/S: 07/31/2017 01:09 PM JBROCK -----

COMMENTS AND NOTES

VIOLATION NOTICE

DO NOT REMOVE!

Harnett County Inspection Department

108 East Front Street • P.O. Box 65

Lillington, NC 27546

Phone: (910) 893-7525 Ext. 1 • Fax: (910) 893-2793

Job Name: Royal Oaks Date: 8-1-17

Address: 17 Apton Ct.


Lot No.: _____ Permit No.: 40975

(Check Box for Violation)

- | | | | | | | | |
|-------------------------------------|-------------------------------------|----------------------------------|--|-------------------------------------|---------------------------------------|---------------------------------|--------------------------------------|
| <input type="checkbox"/> Footing | <input type="checkbox"/> Foundation | <input type="checkbox"/> Bldg. | <input type="checkbox"/> Elec. | <input type="checkbox"/> Plumb. | <input type="checkbox"/> Mech. | <input type="checkbox"/> Insul. | <input type="checkbox"/> Floor Fram. |
| <input type="checkbox"/> Floor Slab | <input type="checkbox"/> MFG. Home | <input type="checkbox"/> Modular | <input type="checkbox"/> Damp/Water Proof. | <input type="checkbox"/> Structural | <input type="checkbox"/> Wall Sheath. | <input type="checkbox"/> Other | |

Violations Found: ① Footing letter doesnot state that it met the NC Residential Code.
② - T-pole conduit Broken at base of meter can.
Foundation was OK

Code Enforcement Official

Signature:  Date: 8-1-17

It is unlawful for any subcontractor, general contractor, or owner to cover or cause to be covered any part of the work with flooring, sheetrock, earth or other material until the proper inspector had ample time to approve the installation

July 24, 2017

Mr. Rich Sherman
Royal Oaks Homes
rsherman@royaloakshomes.com**Report of Observations
Atkins Village North, Lot 36
Fuquay Varina, North Carolina
Our Project Number 121-15-78801**

Gentlemen:


As requested, a representative of TerraTech Engineers, Inc. was present at the above referenced site on July 18, 2017 to perform testing on the crawl space footing excavations for the proposed residential home located in the area of Lot #36. The purpose of our testing was to verify that the design soil bearing pressure is available for the concrete foundations. We understand that an allowable soil bearing pressure of 2,000 pounds per square foot (psf) is required. Our services did not include surveying. Locations are based on the excavations performed by others.

Our field examinations consisted of visual observations, dynamic cone penetrometer testing in accordance with ASTM STP-399, and hand rod probing at selected locations. Dynamic cone penetrometer testing was performed at select locations and to a maximum depth of 3 feet below the over-excavated foundation bearing elevation. Our scope did not include mechanically drilled soil test borings to evaluate deeper subsurface soil conditions that could affect foundation support. Such services can be provided, if desired.


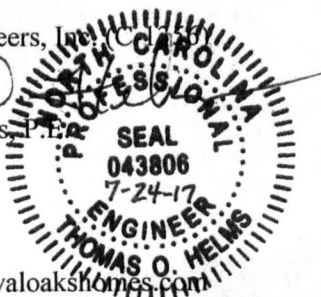
During our recent site visit and prior to our testing, we were informed by the contractor that the footings would be over-excavated approximately 2 to 3 feet below the foundation bearing elevation. We were also informed by the contractor that the footing excavations would be backfilled with consolidated #57 washed stone to re-establish the foundation bearing elevation. Prior to placement of #57 washed stone, the results of the footing examinations indicated that an allowable bearing capacity of 2,000 pounds per square foot (psf) was available at the locations and depths tested at the time of our investigation. Additionally, the foundation dimensions met the plan minimum requirements.

Exposure to the environment, especially rainfall, may weaken the soils beneath the foundation bearing surface, if they are exposed for extended periods of time prior to concrete placement. If the over-excavated soils beneath the foundation bearing surface become softened due to exposure, the soft soils should be compacted or removed and replaced prior to placement of washed stone and concrete.

If you have any questions concerning this information, please do not hesitate to call.

Sincerely,
TerraTech Engineers, Inc.
Thomas O. Helms, P.E.
Project Engineer

TOH/sk

cc: rsargent@royaloakshomes.comChristopher S. Pilz, P.E.
Principal Geotechnical Engineer

DAILY REPORT

Project: Atkins Village Lot 36 Job Number _____

Day Tuesday Date 7-18-17

Weather: Clear Partly Cloudy Overcast Rain

Representative: Chris Hoston

Temperature: <32 32-50 50-70 70-90 >90

Arrival Time: _____ Mileage: _____

Total Hours: _____ Standby: _____

Remarks: TerraTech arrives on site to check footings for load bearing capacity. After testing I contacted project engineer who concluded that the footings met required load bearing minimums. Tests were taken at a depth of -5' (relative to ground level)

All evaluations are subject to review by a TerraTech project engineer. Soils exposed to inclement weather can degrade. Any soils exposed to inclement weather should be re-evaluated by TerraTech prior to further construction.

TerraTech Representative: Chris Hoston Received by: _____