

HTE# 17-5-41015R

Harnett County Department of Public Health

24811

PERMIT # 29632

Operation Permit

- New Installation
- Septic Tank
- Nitrification Line
- Repair
- Expansion

Name: (owner) Wynn's Construction Inc PROPERTY LOCATION 501429 Chalgrave Rd
 System Installer: Thornton Plumbing SUBDIVISION Avery Paved LOT # 23
 Registration # _____


Basement with plumbing: Garage Number of Bedrooms _____
 Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Prop to 25% Reductive System Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

TYPE V EZUAG ~~TYPE VI~~ must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

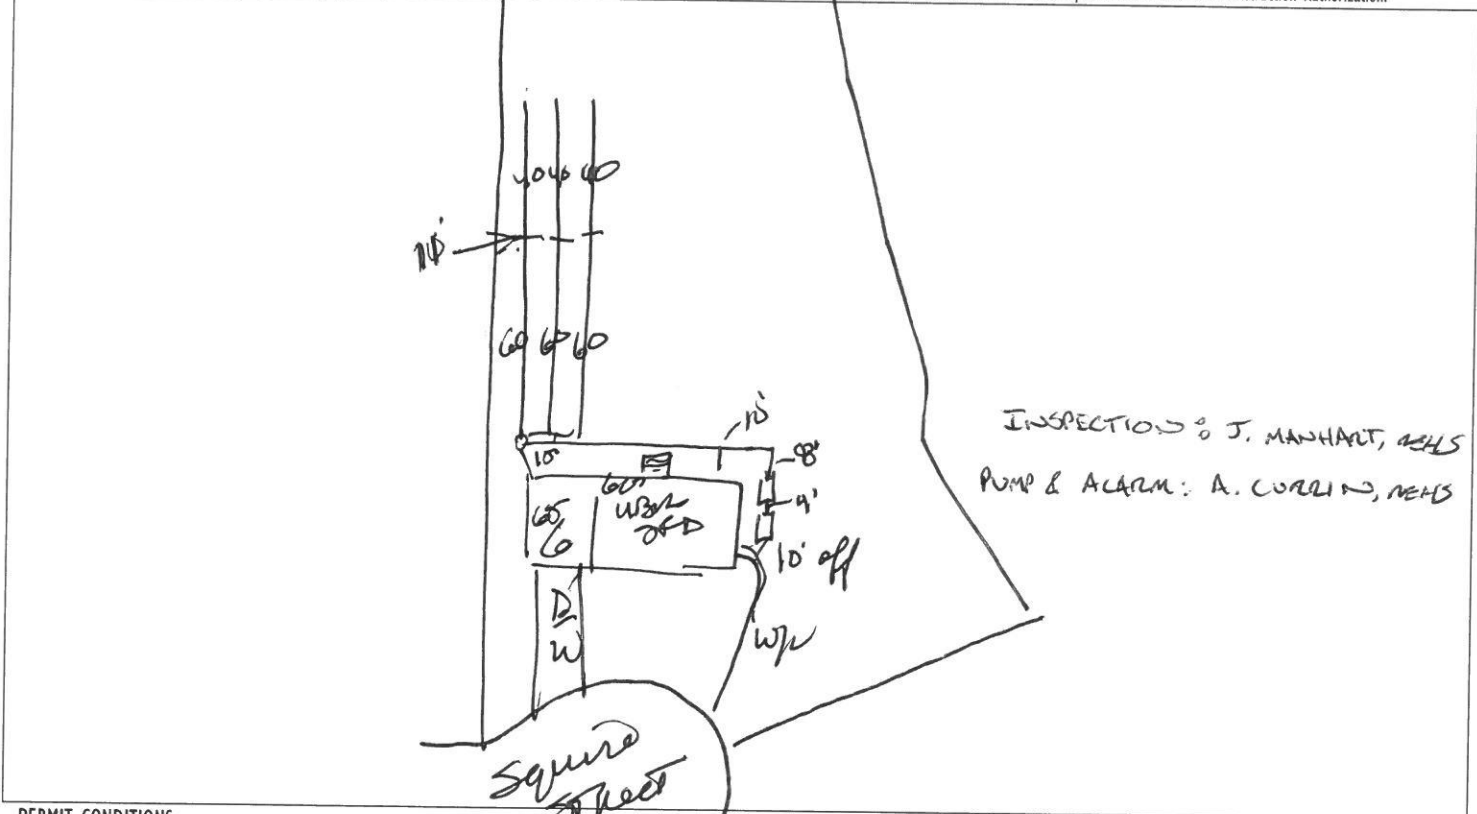

INSPECTION: J. MANHART, NCHS
 PUMP & ALARM: A. COLLINS, NCHS

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.
 Type of system: Conventional Other 25% Reductive System Septic Tank: 1250 gallons Pump Tank: 1250 gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 3 of each ditch 100 feet ditches 3 feet ditches 18-16 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 07/06/2018