


**SOIL/SITE EVALUATION
 for ON-SITE WASTEWATER SYSTEM**

Owner: Applicant: Date Evaluated: 6/23/17
 Address: Design Flow (.1949): 400 gpd
 Proposed Facility: 4 5000 Property Size:
 Location of Site: Property Recorded:
 Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed

P R O F I L E #	.1940 Landscape Position/ Slope %	Horizon Depth (In.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
1	LS 2-5%	0-6	G LS	VF NS/MP					
		6-24	SBK C	F2 S/P					PS 3
		24" ¹¹⁴	PM						
2		0-21	G LS	VF NS/MP					
		21-36	SBK C	F1 S/P					PS 3
		36" ¹¹⁴	PM						
3		0-31	G S	VF NS/MP					
		31-42	SBK SCL	F2 SS/SP					PS 4
4		0-18	G LS	VF NS/MP					
		18-34	SBK SCL	F1 SS/SP					PS 4
		34" ¹¹⁴	PM						
5		0-18	G LS	VF NS/MP					
		18-32	SBK C	F1 S/P					
		32" ¹¹⁴	PM						PS 3

Description	Initial System	Repair System	Other Factors (.1946): Site Classification (.1948): PS Evaluated By: ST Others Present: -
Available Space (.1945)	✓	✓	
System Type(s)	25% R20	25% R20	
Site LTAR	3	3	

1x400' @ 8" CONDUIT MAY AFFECT

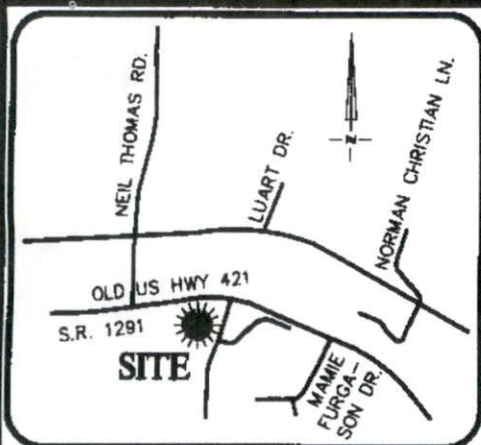

VICINITY MAP
Not To Scale

IMPERVIOUS SURFACE AREA	
DESCRIPTION	AREA
HOUSE w/ PORCH	1,292 S.F.
PATIO/HVAC/MISC	27 S.F.
DRIVEWAY & WALKS	630 S.F.
TOTAL (PROPOSED)=	1,949 S.F.
LOT AREA =	29,152 S.F.
% IMPERVIOUS AREA	=6.7%

NOTE:
ALL DIMENSIONS, LOCATIONS AND FEATURES SHOWN ON THIS PLOT PLAN ARE APPROXIMATE AND ARE ONLY AN ARTIST'S RENDITION, EXACT LOCATION OF ALL FEATURES ARE SUBJECT TO CHANGE AND MAY NOT BE INSTALLED EXACTLY AS SHOWN ON PLANS AND/OR IN MODELS, PLACEMENT OF HOME, DRIVEWAY, SIDEWALKS AND EXTERIOR FEATURES ARE SUBJECT TO MODIFICATION AS DEEMED NECESSARY BY FIELD PERSONNEL.

CUSTOMER _____ DATE _____


CUSTOMER _____ DATE _____

WADE JOURNEY REPRESENTATIVE _____ DATE _____

SETBACKS

- FRONT - 35'
- SIDE - 10'
- REAR - 25'
- CORNER SIDE - 20'

OLD US 421
NCSR # 1291

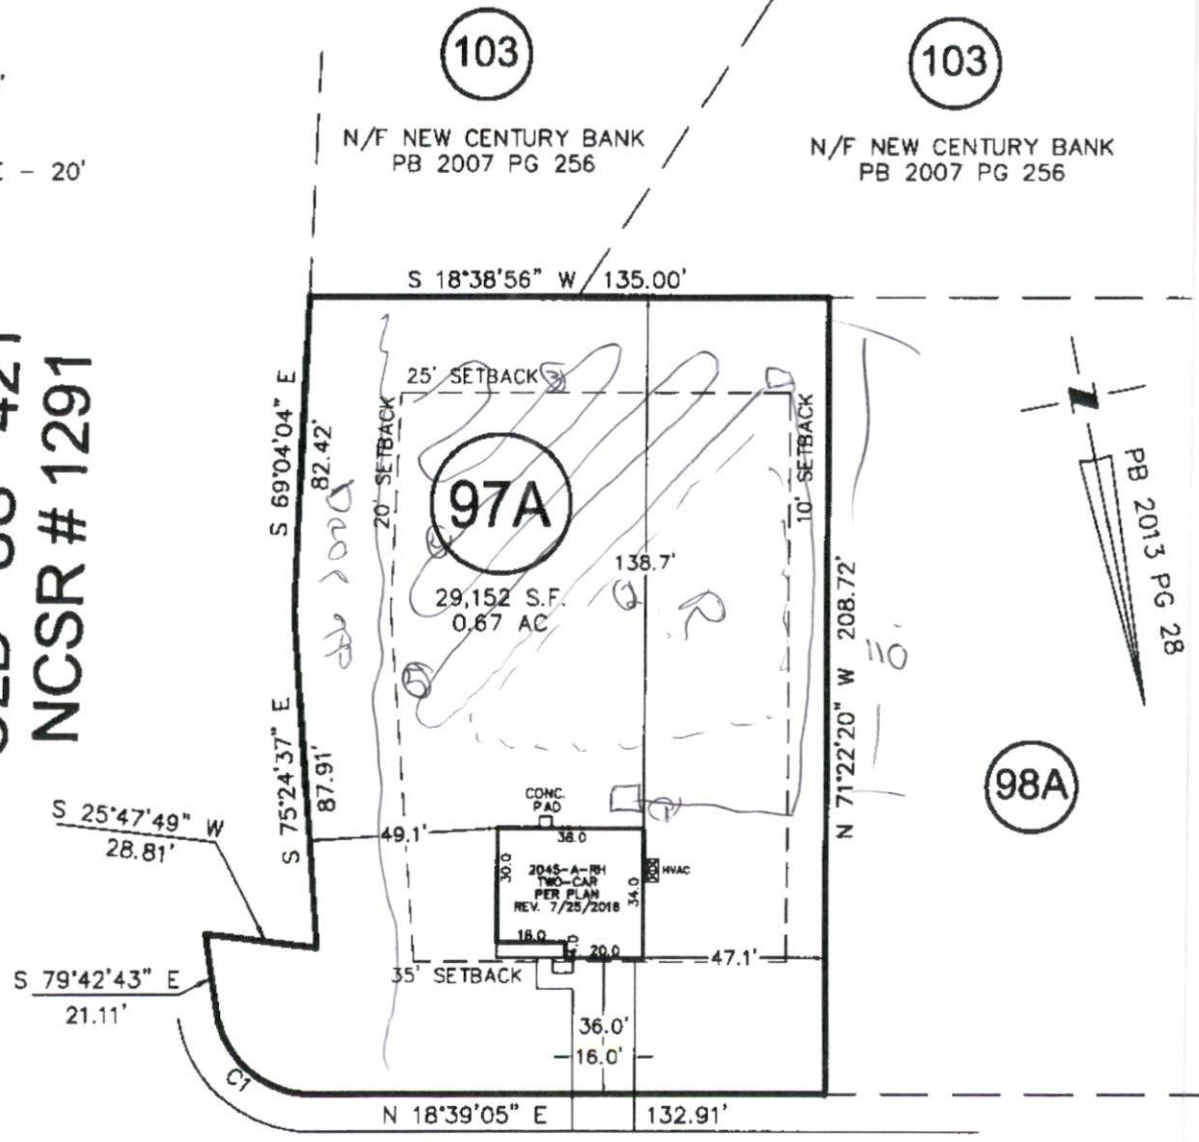

TILDEN
HOWINGTON DRIVE

APPROVAL
RABO USE 50' PUBLIC R/W
4
SIAIN

APPROVAL FOR STAKING:
THIS PLOT PLAN AS PREPARED BY RESIDENTIAL LAND SERVICES, IS CORRECT AND IS HEREBY APPROVED FOR STAKING ON THE DATE SHOWN BELOW.