

HTE# 17-5-41830

Harnett County Department of Public Health

24906

PERMIT # 29679

Operation Permit

☒ New Installation ☒ Septic Tank ☒ Nitrification Line ☐ Repair ☐ ExpansionPROPERTY LOCATION: PONDEROSA RDName: (owner) CUMBERLAND HOMES

SUBDIVISION

CAROLINA SEASONSLOT # 33System Installer: TEO BROWN


Registration # _____

Basement with plumbing: ☐ Garage ☒ Number of Bedrooms 4Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feetSystem Type: IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

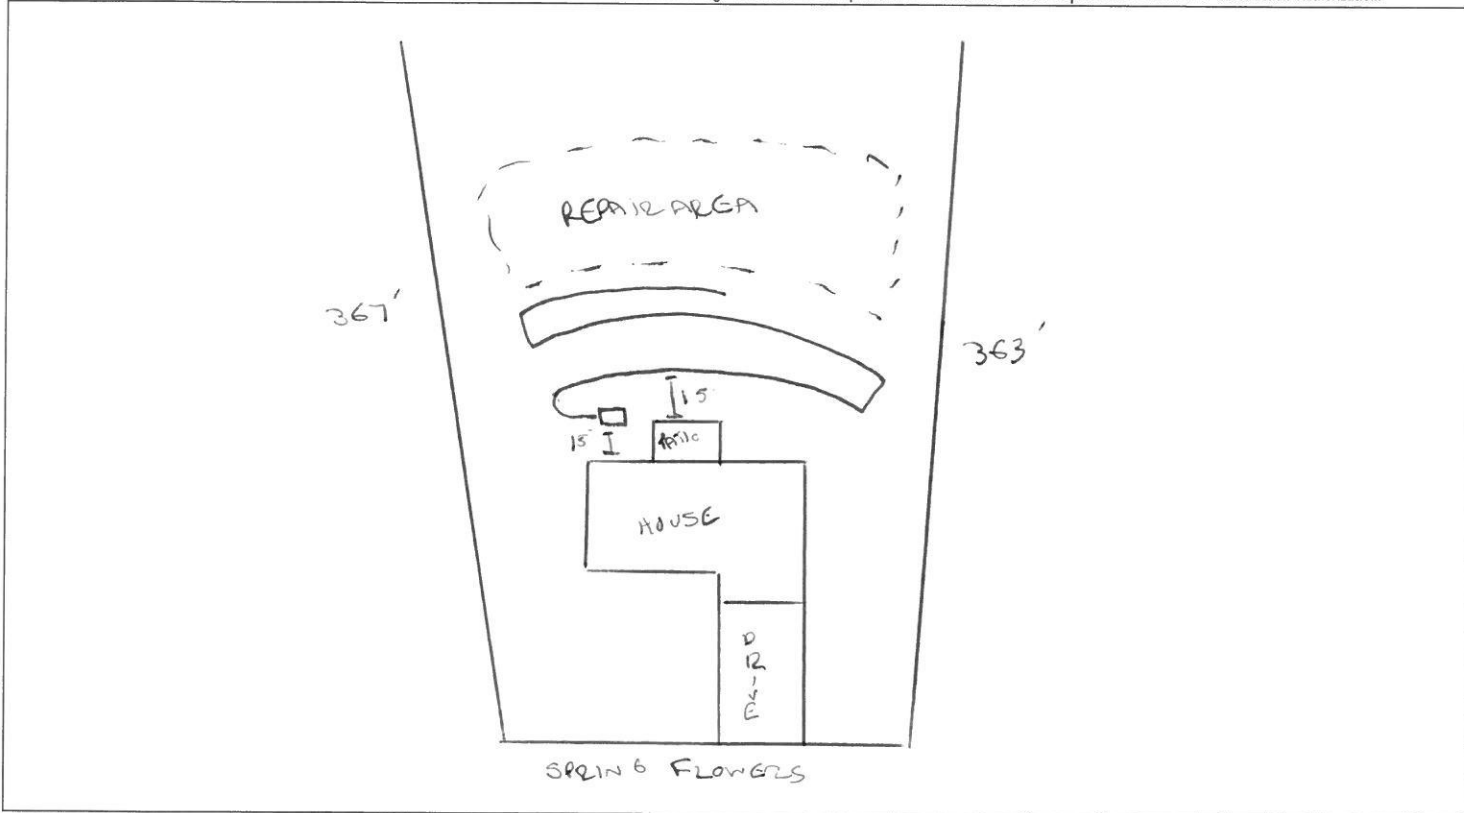

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes ☐ No ☒

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

☐ D-Box ☐ Pump ☐ Alarm ☐ H2O Line ☐ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other CHAMBER (24")Septic Tank: 1000 gallons Pump Tank: _____ gallonsSubsurface
Drainage Field No. of ditches 1 exact length of each ditch 200 feetwidth of ditches 3 feet depth of ditches 36-24 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature]REHSDate 2/8/18